

October 25, 2004

U. S. Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555

Subject: **Docket No. 50-362**
Special Report: Inservice Inspection of Steam Generator Tubes, Cycle 13
San Onofre Nuclear Generating Station, Unit 3

Reference: Steam Generator Program Guidelines, Nuclear Energy Institute Document
Number NEI 97-06, Revision 1

Gentlemen:

On October 14, 2004, Southern California Edison (SCE) completed the inservice inspection of steam generator tubes at San Onofre Nuclear Generating Station Unit 3. The attached report is submitted in accordance with Technical Specification (TS) 5.7.2.c reporting requirements:


- Report the number of tubes plugged in each steam generator within 15 days of completing the inspection;
- Report the complete results of steam generator tube inspections within 12 months of inspection completion.

The attachment to this letter, "Special Report: Inservice Inspection of Steam Generator Tubes," which was prepared in accordance with the referenced industry guidance, satisfies these reporting requirements. This report contains no new commitments.

Independent from the TS 5.7.2.c reporting requirements, this report also incorporates results of a secondary side inspection of eggcrate tube supports using remote video equipment.

If you require any additional information, please advise.

Sincerely,

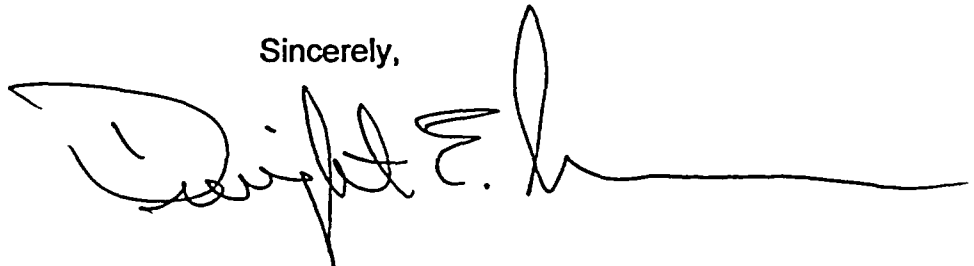

Attachments

cc: B. S. Mallett, NRC Regional Administrator, Region IV
B. M. Pham, NRC Project Manager, San Onofre Units 2 & 3
C. C. Osterholtz, NRC Senior Resident Inspector, San Onofre Units 2 & 3
Institute of Nuclear Power Operations (INPO)

AO-17

SPECIAL REPORT: INSERVICE INSPECTION OF STEAM GENERATOR TUBES

Regulatory Reporting Requirements

Reporting Requirement 5.7.2.c of Appendix A, Technical Specification to Facility Operating License NPF-15, requires the number of tubes plugged and tubes sleeved in each steam generator to be reported to the Nuclear Regulatory Commission within 15 days following completion of the inspection.

Reporting Requirement 5.7.2.c of Appendix A, Technical Specification to Facility Operating License NPF-15, requires the complete results of steam generator tube inservice inspection to be reported to the Nuclear Regulatory Commission within 12 months following completion of the inspection.

Inspection Scope

Tables 1 and 2 summarize the inspection scope. Also, when indications by the bobbin probe were non-quantifiable or distorted, the inspection program included inspection with the Plus-Point Probe. Table 3 provides the list of Nondestructive Examination (NDE) techniques utilized for each degradation mechanism.

Inspection Scope Expansion

Row 3 of Tables 1 and 2 shows the only significant inspection program scope expansion in response to inspection results. In response to one indication, the planned cold leg top-of-tubesheet rotating plus point probe inspection (30% in SG E-088 and 29% in SG E-089) was expanded to 100% in both steam generators. No indications were detected in this expanded scope inspection. Additional Information on this expansion response follows.

One circumferential indication was detected at the cold leg top-of-tubesheet in Steam Generator E-089 during planned rotating plus point probe inspection. That indication, in Tube Row 51 Column 129 at TSC + 0.06 inches, had an amplitude of 0.14 volts and a phase angle indicative of outside diameter initiation. The indication's rotating plus point probe data was used to produce the following size information. The indication's maximum depth was 39% and the length was 0.24 inches (approximately 37 degrees of the 360 degree circumference of the tube).

Results

This report satisfies the listed regulatory reporting requirements.

Table 4 summarizes the number of tubes repaired and active degradation mechanisms found. Each tube is only counted once in this listing, although it may also have an eddy current indication of a type below the point in the listing where it appears. The Appendices provide the complete results of the steam generator tubing inservice inspection.

Condition Monitoring was performed on all rotating plus point probe indications using established criteria. All indications were within the criteria acceptance range. Thus, there was no insitu pressure or leak testing of tubing. Condition Monitoring results provide assurance that performance criteria in the NEI guidance (structural integrity and accident-induced leakage) were met during operation prior to this inspection.

Results of Secondary Side Inspection (SSI) of Eggcrate Tube Supports

Visual inspections of the steam generator tube lattice supports for both steam generators at SONGS Unit 3 were completed using remote video equipment. The Unit 3 Cycle 13 (U3C13) inspection encompassed 17 camera drops on each of the two steam generators. These inspections were conducted from the fifth to the tenth or uppermost lattice support structure.

The results indicate no evidence of ongoing Flow Accelerated Corrosion (FAC). These results are similar to the last lattice inspection on Unit 3 conducted in the Cycle 11 refueling outage. Using the conservative plugging criteria developed from the initial FAC discovery, no tubes were plugged.

Repair of Tubes

Tables 5 and 6 list the tubes repaired by plugging for each steam generator. Although approved for use, sleeves have not been used to date in Unit 3.

Table 5 provides an itemized listing of the tubes plugged in steam generator E-088 along with the corresponding Table 4 category specifying the indication orientation/location.

Table 6 provides an itemized listing of the tubes plugged in steam generator E-089 along with the corresponding Table 4 category specifying the indication orientation/location.

Repair Methods, Number of Tubes Repaired and Effective Plugging Percentage

All tube plugging was performed using the design, materials, and installation methods of AREVA. A "roll" method was used for all tube plugs. Three tubes in Steam Generator E-088 and five tubes in Steam Generator E-089 were "stabilized" in the vicinity of the top of the tubesheet using the design, materials, and installation methods of AREVA.

46 tubes were plugged in Steam Generator E-088 during the Cycle 13 refueling outage. A total of 704 tubes have been plugged. No tubes have ever been sleeved in this steam generator. The design number of tubes is 9350 tubes. The effective plugging percentage for E-088 is 7.6%.

62 tubes were plugged in Steam Generator E-089 during the Cycle 13 refueling outage. A total of 651 tubes have been plugged. No tubes have ever been sleeved in this steam generator. The design number of tubes is 9350 tubes. The effective plugging percentage for E-089 is 7.0%.

Description of Tables and Appendices

- Table 1 - Summary of the Inspection Scope for Steam Generator E-088 for the U3C13 Refueling Outage
- Table 2 - Summary of the Inspection Scope for Steam Generator E-089 for the U3C13 Refueling Outage
- Table 3 - List of Nondestructive Examination (NDE) Techniques Utilized for Each Degradation Mechanism for the U3C13 Refueling Outage
- Table 4 - Number of Tubes Repaired and Active Degradation Mechanisms Found During the U3C13 Refueling Outage
- Table 5 - U3C13 Refueling Outage Tubes Plugged, Steam Generator E-088
- Table 6 - U3C13 Refueling Outage Tubes Plugged, Steam Generator E-089
- Appendix 1 - Steam Generator Reference Information
- Appendix 2 - Legend for Appendices 3 and 4
- Appendix 3 - Inspection Summary, Steam Generator E-088
- Appendix 4 - Inspection Summary, Steam Generator E-089

**TABLE 1 - Summary of the Inspection Scope for Steam Generator E-088
for the U3C13 Refueling Outage**

| Inspection Scope Item | Number of Tubes / % of Tubes In Steam Generator E-088 | |
|--|--|-------------|
| | Planned | Actual |
| Full length of tube with the Bobbin Probe (excluding U-bends for Rows 1-3) | 8692 / 100% | 8692 / 100% |
| Hot leg top-of-tubesheet with the Plus-Point Probe (to 16 inches below the expansion transition) | 8692 / 100% | 8692 / 100% |
| Cold leg top-of-tubesheet with the Plus-Point Probe | 2623 / 30% | 8692 / 100% |
| U-bend regions of Rows 1, 2, and 3 with both mid and high frequency Plus-Point Probes | 184 / 100% | 184 / 100% |
| U-bend regions of Rows 4 through 10 with mid-frequency Plus-Point Probes | 432 / 100% | 432 / 100% |
| Plus-Point Probe examinations of tube support intersections with dents greater than, or equal to, 2 volts | All / 100% | 298 / 100% |
| Plus-Point Probe examinations of dings greater than, or equal to, 4 volts | All / 100% | 305 / 100% |
| Plus-Point Probe examination of all tube support intersections with quantified wear indications by the bobbin probe | All / 100% | 843 / 100% |
| Plus-Point Probe examinations of hot leg scallop bar supports with the above adjacent hot leg square bend and the below one support elevation of tubing freespan | 75 / 20% | 75 / 20% |

**TABLE 2 - Summary of the Inspection Scope for Steam Generator E-089
for the U3C13 Refueling Outage**

| Inspection Scope Item | Number of Tubes / % of Tubes In Steam Generator E-089 | |
|--|--|-------------|
| | Planned | Actual |
| Full length of tube with the Bobbin Probe (excluding U-bends for Rows 1-3) | 8761 / 100% | 8761 / 100% |
| Hot leg top-of-tubesheet with the Plus-Point Probe (to 16 inches below the expansion transition) | 8761 / 100% | 8761 / 100% |
| Cold leg top-of-tubesheet with the Plus-Point Probe | 2610 / 29% | 8761 / 100% |
| U-bend regions of Rows 1, 2, and 3 with both mid and high frequency Plus-Point Probes | 174 / 100% | 174 / 100% |
| U-bend regions of Rows 4 through 10 with mid-frequency Plus-Point Probes | 449 / 100% | 449 / 100% |
| Plus-Point Probe examinations of tube support intersections with dents greater than, or equal to, 2 volts | All / 100% | 327 / 100% |
| Plus-Point Probe examinations of dings greater than, or equal to, 4 volts | All / 100% | 400 / 100% |
| Plus-Point Probe examination of all tube support intersections with quantified wear indications by the bobbin probe | All / 100% | 592 / 100% |
| Plus-Point Probe examinations of hot leg scallop bar supports with the above adjacent hot leg square bend and the below one support elevation of tubing freespan | 73 / 20% | 73 / 20% |

TABLE 3 – List of Nondestructive Examination (NDE) Techniques Utilized for Each Degradation Mechanism for the U3C13 Refueling Outage

| Table 5 Category | Indication Orientation / Location | Probe Type for Detection | Probe Type for Characterization |
|-------------------------|---|---------------------------------|--|
| 1 | Circumferentially oriented ID indications near the expansion transition at the top of the hot leg tubesheet | Plus Point | Plus Point |
| 2, 3 | Circumferentially oriented OD indications near the expansion transition at the top of the hot or cold leg tubesheet | Plus Point | Plus Point |
| 4 | Axially oriented ID indications below the expansion transition at the top of the hot leg tubesheet | Bobbin | Plus Point |
| 5 | Circumferentially oriented ID indications below the expansion transition at the top of the hot leg tubesheet | Plus Point | Plus Point |
| 6 | Indications of wear at tube support locations | Bobbin | Plus Point |
| 7, 8 | Volumetric indications | Bobbin or Plus Point | Plus Point |
| 9 | Miscellaneous preventative plugging | Bobbin or Plus Point | Plus Point |

TABLE 4 – Number of Tubes Repaired and Active Degradation Mechanisms Found During the U3C13 Refueling Outage

| Category | Indication Orientation / Location | SG E-088 | SG E-089 |
|----------|--|----------|----------|
| 1 | Tubes with circumferentially oriented ID indications near the expansion transition at the top of the hot leg tubesheet. (ID Circ @ TSH) | 3 | 3 |
| 2 | Tubes with circumferentially oriented OD indications near the expansion transition at the top of the hot leg tubesheet. (OD Circ @ TSH) | 0 | 1 |
| 3 | Tubes with circumferentially oriented OD indications near the expansion transition at the top of the cold leg tubesheet. (OD Circ @ TSC) | 0 | 1 |
| 4 | Tubes with axially oriented ID indications below the inlet top-of-tubesheet. (ID Axial below TSH) | 1 | 6 |
| 5 | Tubes with circumferentially oriented ID indications below the inlet top-of-tubesheet. (ID Circ below TSH) | 6 | 2 |
| 6 | Tubes with indications of wear at tube support locations. (Wear @ Support) | 36 | 45 |
| 7 | Tubes with apparent previous loose part wear (not an active degradation mechanism). (OD Vol @ TSH) | 0 | 2 |
| 8 | Tubes with miscellaneous volumetric indications (not an active degradation mechanism). (OD Vol @ Miscellaneous) | 0 | 1 |
| 9 | Tubes with Data Quality/ALARA complications (Data Quality @ Miscellaneous) | 0 | 1 |
| | Total | 46 | 62 |

**TABLE 5 – SONGS U3C13 Refueling Outage Tubes Plugged
STEAM GENERATOR E-088**

| Row | Column | Reason for Plugging Tube (per Table 4) |
|-----|--------|--|
| 78 | 26 | Wear @ Support |
| 8 | 38 | ID Circ @ TSH |
| 10 | 56 | ID Circ @ TSH |
| 57 | 67 | ID Circ below TSH |
| 40 | 68 | Wear @ Support |
| 139 | 69 | Wear @ Support |
| 46 | 78 | Wear @ Support |
| 48 | 80 | Wear @ Support |
| 53 | 83 | Wear @ Support |
| 58 | 84 | Wear @ Support |
| 53 | 85 | Wear @ Support |
| 55 | 85 | Wear @ Support |
| 67 | 89 | Wear @ Support |
| 69 | 89 | Wear @ Support |
| 60 | 90 | Wear @ Support |
| 53 | 91 | Wear @ Support |
| 55 | 91 | Wear @ Support |
| 69 | 91 | Wear @ Support |
| 57 | 93 | Wear @ Support |
| 68 | 94 | Wear @ Support |
| 62 | 96 | Wear @ Support |
| 146 | 96 | Wear @ Support |
| 55 | 97 | Wear @ Support |
| 52 | 98 | Wear @ Support |
| 54 | 98 | Wear @ Support |
| 145 | 99 | Wear @ Support |
| 44 | 100 | Wear @ Support |
| 50 | 100 | Wear @ Support |
| 47 | 101 | Wear @ Support |
| 47 | 103 | Wear @ Support |
| 131 | 103 | Wear @ Support |
| 81 | 111 | Wear @ Support |
| 18 | 112 | ID Axial below TSH |

**TABLE 5 (CONT.) – SONGS U3C13 Refueling Outage Tubes Plugged
STEAM GENERATOR E-088**

| Row | Column | Reason for Plugging Tube (per Table 4) |
|------------|---------------|---|
| 48 | 112 | Wear @ Support |
| 47 | 113 | Wear @ Support |
| 81 | 113 | Wear @ Support |
| 10 | 114 | ID Circ below TSH |
| 11 | 125 | ID Circ below TSH |
| 11 | 127 | ID Circ @ TSH |
| 48 | 128 | Wear @ Support |
| 8 | 132 | ID Circ below TSH |
| 11 | 139 | ID Circ below TSH |
| 80 | 140 | Wear @ Support |
| 11 | 149 | ID Circ below TSH |
| 54 | 156 | Wear @ Support |
| 14 | 174 | Wear @ Support |

**TABLE 6 – SONGS U3C13 Refueling Outage Tubes Plugged
STEAM GENERATOR E-089**


| Row | Column | Reason for Plugging Tube (per Table 4) |
|-----|--------|--|
| 27 | 3 | OD Vol @ TSH |
| 29 | 3 | OD Vol @ TSH |
| 65 | 27 | Wear @ Support |
| 46 | 36 | Wear @ Support |
| 38 | 40 | Wear @ Support |
| 27 | 47 | ID Circ @ TSH |
| 33 | 55 | Wear @ Support |
| 66 | 60 | Wear @ Support |
| 78 | 60 | OD Vol @ Miscellaneous |
| 27 | 61 | ID Axial below TSH |
| 31 | 63 | ID Circ below TSH |
| 9 | 65 | Data Quality @ Miscellaneous |
| 31 | 65 | ID Axial below TSH |
| 31 | 67 | ID Axial below TSH |
| 111 | 67 | ID Circ below TSH |
| 33 | 71 | Wear @ Support |
| 35 | 71 | Wear @ Support |
| 39 | 73 | Wear @ Support |
| 47 | 73 | Wear @ Support |
| 49 | 77 | Wear @ Support |
| 56 | 80 | Wear @ Support |
| 128 | 80 | Wear @ Support |
| 53 | 81 | Wear @ Support |
| 59 | 81 | Wear @ Support |
| 63 | 81 | Wear @ Support |
| 56 | 82 | Wear @ Support |
| 64 | 82 | Wear @ Support |
| 63 | 83 | Wear @ Support |
| 101 | 83 | ID Circ @ TSH |
| 55 | 85 | Wear @ Support |
| 61 | 85 | Wear @ Support |
| 58 | 86 | Wear @ Support |
| 62 | 88 | Wear @ Support |
| 55 | 89 | Wear @ Support |
| 58 | 90 | Wear @ Support |

**TABLE 6 (CONT.) – SONGS U3C13 Refueling Outage Tubes Plugged
STEAM GENERATOR E-089**

| Row | Column | Reason for Plugging Tube (per Table 4) |
|-----|--------|--|
| 65 | 91 | Wear @ Support |
| 145 | 91 | Wear @ Support |
| 51 | 93 | Wear @ Support |
| 146 | 94 | Wear @ Support |
| 61 | 95 | Wear @ Support |
| 51 | 101 | Wear @ Support |
| 145 | 101 | Wear @ Support |
| 144 | 106 | Wear @ Support |
| 31 | 107 | ID Axial below TSH |
| 37 | 107 | Wear @ Support |
| 40 | 110 | Wear @ Support |
| 47 | 111 | Wear @ Support |
| 50 | 114 | Wear @ Support |
| 27 | 115 | ID Axial below TSH |
| 102 | 118 | ID Axial below TSH |
| 60 | 122 | OD Circ @ TSH |
| 57 | 123 | Wear @ Support |
| 110 | 124 | Wear @ Support |
| 79 | 125 | Wear @ Support |
| 51 | 129 | OD Circ @ TSC |
| 79 | 129 | Wear @ Support |
| 45 | 131 | Wear @ Support |
| 47 | 133 | Wear @ Support |
| 106 | 142 | Wear @ Support |
| 43 | 145 | Wear @ Support |
| 30 | 146 | ID Circ @ TSH |
| 78 | 160 | Wear @ Support |

Appendix 1
Steam Generator Reference Information

**Steam Generator
CE Model 3410 Tube Support Drawing**

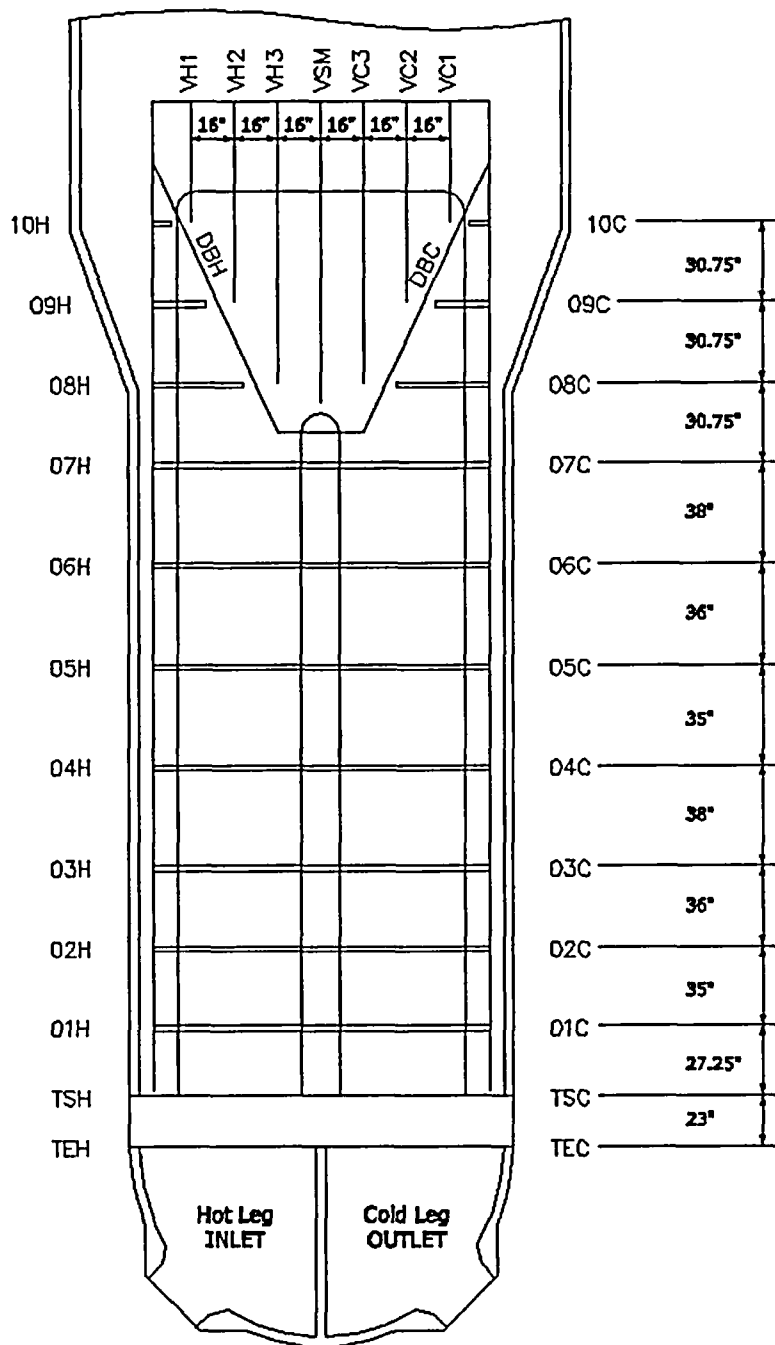


**STEAM GENERATOR TUBE SUPPORT INTERSECTIONS
ABOVE THE 7TH (FULL) EGGCRATE SUPPORT**

| SUPPORT INTERSECTIONS | | | | | | | | | | | | | | | |
|------------------------------|-------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| ROW | STRUCTURES | | | | | | | | | | | | | | |
| 122-147 | 08H | 09H | 10H | DBH | VH1 | VH2 | VH3 | VSM | VC3 | VC2 | VC1 | DBC | 10C | 09C | 08C |
| 120-121* | 08H | 09H | 10H | DBH | VH1 | VH2 | VH3 | VSM | VC3 | VC2 | VC1 | DBC | 10C | 09C | 08C |
| 115-119 | 08H | 09H | | DBH | VH1 | VH2 | VH3 | VSM | VC3 | VC2 | VC1 | DBC | | 09C | 08C |
| 86-114 | 08H | 09H | | DBH | | VH2 | VH3 | VSM | VC3 | VC2 | | DBC | | 09C | 08C |
| 84-85* | 08H | 09H | | DBH | | VH2 | VH3 | VSM | VC3 | VC2 | | DBC | | 09C | 08C |
| 83 | 08H | | | DBH | | VH2 | VH3 | VSM | VC3 | VC2 | | DBC | | | 08C |
| 51-82 | 08H | | | DBH | | | VH3 | VSM | VC3 | | | DBC | | | 08C |
| 49-50* | 08H | | | DBH | | | | VSM | | | | DBC | | | 08C |
| 19-48 | | | | DBH | | | | VSM | | | | DBC | | | |
| 1-18 | | | | DBH | | | | | | | | DBC | | | |

* Indicates those rows adjacent to scallop bars

SOUTHERN CALIFORNIA EDISON, SAN ONOFRE

CE MODEL 3410 STEAM GENERATOR

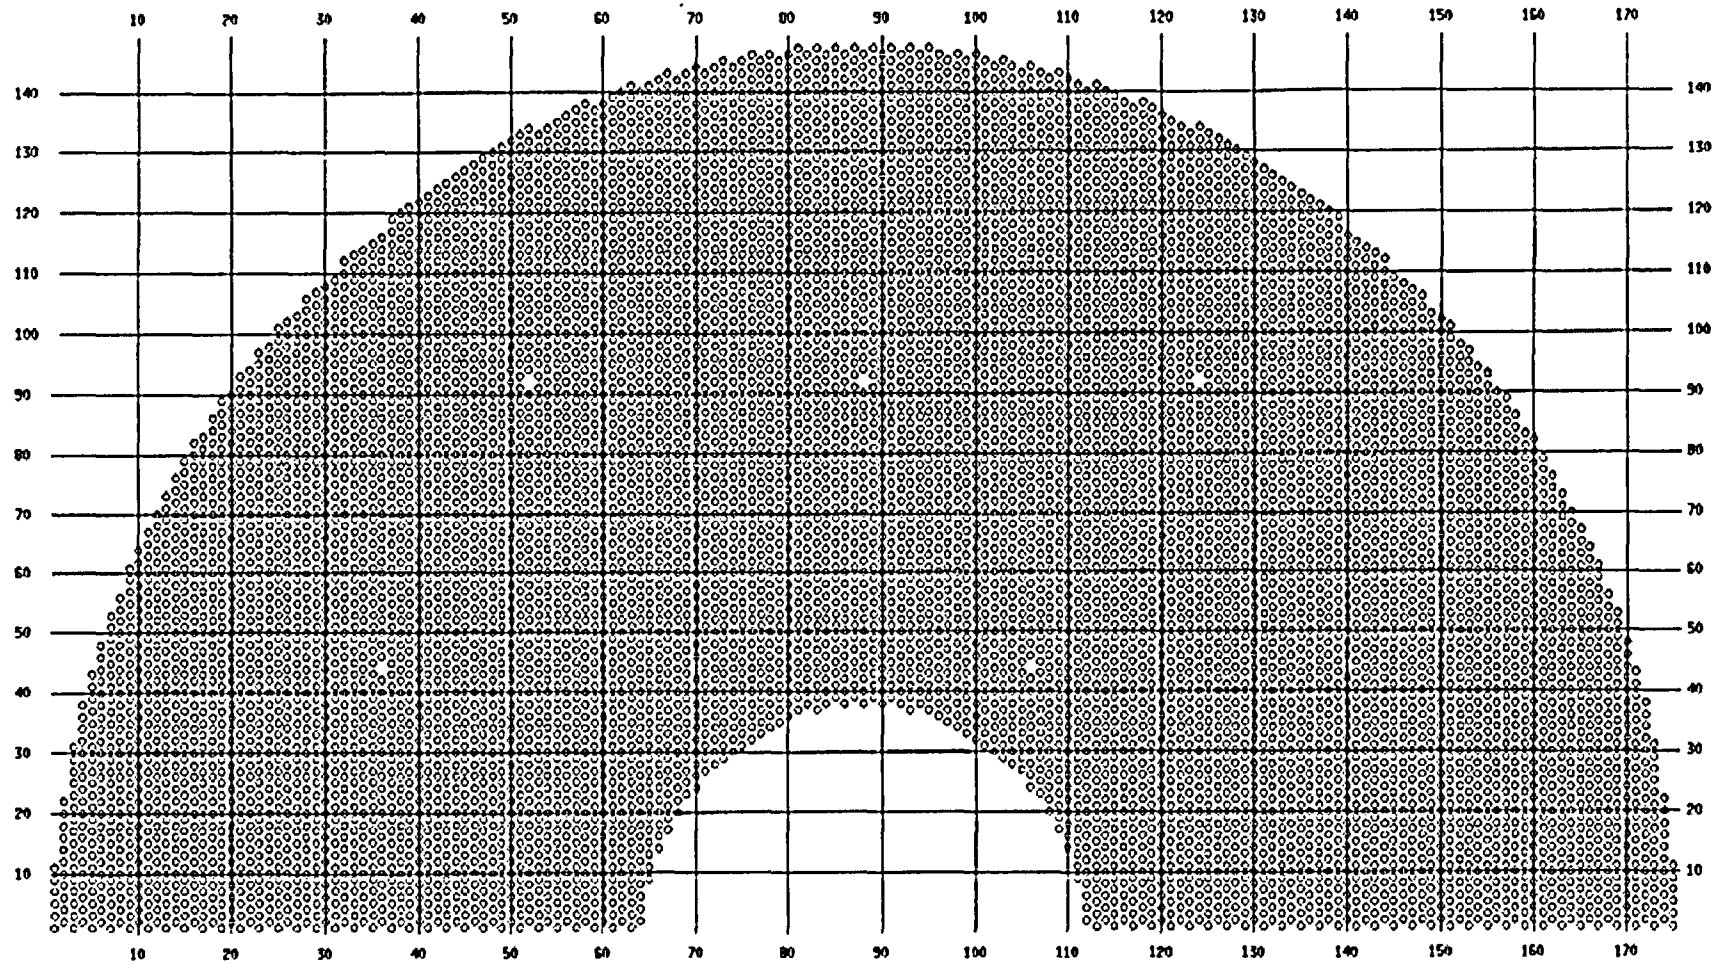

Appendix 2

Legend for Appendices 3 and 4

**List of Abbreviations and Format Used to Describe
Indications from Rotating Probe Testing**

| "I-Code" Abbreviations | Explanation of the Abbreviations |
|------------------------|---|
| SCI | Single Circumferential Indication |
| MCI | Multiple Circumferential Indications |
| SAI | Single Axial Indication |
| MAI | Multiple Axial Indications |
| MMI | Mixed Mode Indications |
| SVI | Single Volumetric Indication (i.e. no special axial or circumferential aspect) |
| MVI | Multiple Volumetric Indications (i.e. no special axial or circumferential aspect) |

Format

In Appendices 3 and 4, a single line of data is associated with each individual rotating probe indication. Below is a descriptive example of the format.

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL 1 | UTIL 2 | CAL # | LEG | PROBE |
|-----|------|-------------|-----------|-----|------|-----|----------|-----|-----|--------|--------|-------|-------------------|--------------|
| 4 | 12 | +P VOLTS | +P DEG | CH# | CODE | % | LOCATION | EXT | EXT | INCHES | INCHES | # | HOT OR COLD | TYPE CODE |

- All "I-Code" indications require a single line entry. The example above displays the form of a Resolution Report line. The VOLTS field contains the Plus-Point P-to-P voltage of the largest, most representative response. The DEG field contains the corresponding phase angle. The CHN field contains the reporting channel (i.e. the appropriate 300kHz Plus-Point channel). The IND field contains the appropriate 3-letter code (see list above). The %TW field indicates the percent wall loss for wear indications. The LOCATION field contains the abbreviation for the referenced landmark and the (FROM-TO) distance for the indication. The EXT fields contain the landmarks of the beginning and end of the test extent. The UTIL 1 field contains the axial or circumferential length. The UTIL 2 field was used to document the actual inspection distance below the hot leg top-of-tubesheet for applicable inspections. The CAL # field identifies the sequence number of the Calibration Group to obtain the data. The LEG field indicates the leg the probe originated from. The PROBE field contains the abbreviated identification of the type of probe used. Exceptions to this general guidance are provided in paragraphs 2 and 3 below.
- For axial indications of extended length, the location should be ranged (FROM-TO) in the LOCATION field. If the range of such an indication includes any part of a support structure, it should be referenced from that landmark.
- Some data lines contain a note abbreviation in the UTIL 1 or UTIL 2 column. These are the definitions of common abbreviations:
LAR: Lead Analyst Reviewed
LOCOK: Location Verification
IDOK: Tube ID Verification
HR: INF (indication not found) is reported and tube encode is correct

Appendix 3
Inspection Summary
Steam Generator E-088

Query Name : rpc_icode_and_0-100%twd qry

Query Title: MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

| | | |
|--------------------------|-------------|--------------------------|
| Selected Outages/Scopes: | 10/04 RFO13 | Out of Scope |
| | 10/04 RFO13 | BOBBIN |
| | 10/04 RFO13 | RPC TSH |
| | 10/04 RFO13 | RPC TSC +1/-1 |
| | 10/04 RFO13 | RPC TSC +3/-1 |
| | 10/04 RFO13 | RPC UBENDS R1-3 |
| | 10/04 RFO13 | RPC UBENDS R4-10 |
| | 10/04 RFO13 | RPC 20% H/L SCALLOP BARS |
| | 10/04 RFO13 | H/L SPECIAL INTEREST |
| | 10/04 RFO13 | C/L SPECIAL INTEREST |
| | 10/04 RFO13 | UBEND SPECIAL INTEREST |
| | 10/04 RFO13 | Special Retest with RPC |
| | 10/04 RFO13 | PLP and Boundings |

Input Selected : All Tubes
Output File Selected :
Selected Indications : MAI, MCI, MMI, MVI, SAI, SCI, SVI, TWD,
Selected Probes : ALL
Selected Channels : ALL
Selected Cals : ALL
Selected Extent1 : ALL
Selected Extent2 : ALL
Selected Util 1 :
Selected Util 2 :
Selected Tube Heat :
TWD Range :
Volts Range :
Degrees Range :
Radius from Center Range :
Location Range :
Inspection Leg Queried : BOTH
Include In-Service or Out-Service Tubes : In-Service only
Advanced User Query :

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|-----|-------|
| 7 | 1 | 0.27 | 45 | P 3 | TWD 11 | DBC | +1.06 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 16 | 2 | 0.34 | 76 | P 2 | TWD 14 | 05H | -0.57 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 43 | 5 | 0.48 | 102 | P 2 | TWD 21 | 04C | -0.14 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 33 | 7 | 0.22 | 121 | P 2 | TWD 11 | VSM | -0.92 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 35 | 7 | 0.32 | 53 | P 2 | TWD 12 | VSM | -0.88 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 49 | 7 | 0.18 | 117 | P 2 | TWD 10 | 06H | -1.12 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 43 | 9 | 0.16 | 143 | P 2 | TWD 9 | VSM | -0.86 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 67 | 11 | 0.33 | 133 | P 2 | TWD 16 | VH3 | -0.78 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 29 | 13 | 0.30 | 87 | P 3 | TWD 15 | DBH | +1.25 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 43 | 13 | 0.39 | 137 | P 2 | TWD 15 | VSM | -0.78 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 66 | 14 | 0.23 | 129 | P 2 | TWD 12 | 04C | -0.20 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 68 | 14 | 0.52 | 123 | P 2 | TWD 20 | VH3 | -0.95 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 70 | 14 | 0.49 | 135 | P 2 | TWD 22 | VH3 | +0.00 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 72 | 14 | 0.29 | 71 | P 3 | TWD 16 | DBC | -1.73 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 69 | 15 | 0.32 | 150 | P 2 | TWD 16 | VH3 | -0.76 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 71 | 15 | 0.19 | 68 | P 2 | TWD 8 | VH3 | -0.73 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| | | 0.18 | 85 | P 2 | TWD 8 | VSM | -1.02 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 75 | 15 | 0.09 | 26 | P 3 | TWD 4 | DBC | -1.85 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| | | 0.14 | 192 | P 3 | TWD 7 | DBC | +2.12 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 77 | 15 | 0.25 | 99 | P 3 | TWD 14 | DBC | -1.81 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 51 | 17 | 0.23 | 129 | P 2 | TWD 13 | VH3 | +0.74 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 22 | 18 | 0.29 | 43 | P 2 | TWD 15 | VSM | -0.82 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 67 | 19 | 0.27 | 89 | P 2 | TWD 15 | VH3 | -0.98 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 83 | 19 | 0.36 | 99 | P 2 | TWD 15 | VH2 | +0.89 | TEC | TEH | | | | | 24 | | HOT | 600UL |
| 74 | 20 | 0.19 | 173 | P 3 | TWD 11 | DBH | +1.91 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 78 | 20 | 0.35 | 85 | P 3 | TWD 17 | DBH | +1.73 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 82 | 20 | 0.17 | 30 | P 3 | TWD 8 | DBC | +2.03 | TEC | TEH | | | | | 24 | | HOT | 600UL |
| 43 | 21 | 0.27 | 101 | P 2 | TWD 15 | VSM | +0.59 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 79 | 21 | 0.22 | 128 | P 3 | TWD 12 | DBC | +1.81 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| | | 0.52 | 110 | P 3 | TWD 24 | DBH | +1.63 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 80 | 22 | 0.21 | 75 | P 3 | TWD 12 | DBH | +1.91 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 82 | 22 | 0.30 | 61 | P 3 | TWD 13 | DBC | +1.75 | TEC | TEH | | | | | 24 | | HOT | 600UL |
| 71 | 23 | 0.20 | 52 | P 3 | TWD 11 | DBH | +1.67 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 56 | 24 | 0.15 | 67 | P 3 | TWD 8 | DBH | +1.47 | TEC | TEH | | | | | 8 | | HOT | 600UL |
| 98 | 24 | 0.23 | 154 | P 2 | TWD 11 | 06C | +0.89 | TEC | TEH | | | | | 23 | | HOT | 600UL |
| | | 0.16 | 50 | P 2 | TWD 8 | 06C | +0.06 | TEC | TEH | | | | | 23 | | HOT | 600UL |
| 91 | 25 | 0.22 | 158 | P 2 | TWD 9 | VH2 | +0.82 | TEC | TEH | | | | | 24 | | HOT | 600UL |
| 78 | 26 | 0.94 | 67 | P 2 | TWD 31 | VC3 | +0.99 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| | | 0.40 | 84 | P 2 | TWD 18 | VC3 | -0.74 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 77 | 27 | 0.26 | 15 | P 3 | TWD 12 | DBC | +1.53 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 76 | 28 | 0.16 | 40 | P 3 | TWD 8 | DBC | +1.83 | TEC | TEH | | | | | 54 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-------|-----|------|---|------|---|-----|---|-----|-------|
| 82 | 28 | 0.27 | 71 | P 3 | TWD 12 | | DBH | -1.75 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 94 | 28 | 0.47 | 71 | P 2 | TWD 19 | | VSM | -0.76 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.35 | 100 | P 2 | TWD 14 | | VH2 | -1.09 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.28 | 66 | P 2 | TWD 12 | | VH3 | +0.82 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 98 | 28 | 0.16 | 48 | P 3 | TWD 7 | | DBH | -2.00 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 102 | 28 | 0.29 | 97 | P 2 | TWD 13 | | VH2 | +0.86 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 77 | 29 | 0.26 | 146 | P 2 | TWD 12 | | VC3 | -0.75 | TEC | TEH | | | | 54 | | HOT | 600UL |
| | | 0.24 | 108 | P 3 | TWD 11 | | DBC | -1.86 | TEC | TEH | | | | 54 | | HOT | 600UL |
| 79 | 29 | 0.30 | 123 | P 2 | TWD 14 | | VC3 | -0.85 | TEC | TEH | | | | 11 | | HOT | 600UL |
| | | 0.18 | 156 | P 3 | TWD 10 | | DBH | +1.47 | TEC | TEH | | | | 11 | | HOT | 600UL |
| 89 | 29 | 0.30 | 116 | P 2 | TWD 13 | | VH2 | +0.93 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.48 | 102 | P 2 | TWD 19 | | VH2 | -0.05 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 99 | 29 | 0.28 | 123 | P 3 | TWD 13 | | DBH | +1.68 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 107 | 29 | 0.20 | 153 | P 2 | TWD 9 | | VH2 | -0.62 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 60 | 30 | 0.35 | 116 | P 2 | TWD 15 | | VH3 | -0.82 | TEC | TEH | | | | 54 | | HOT | 600UL |
| 78 | 30 | 0.75 | 110 | P 2 | TWD 28 | | VSM | +0.79 | TEC | TEH | | | | 11 | | HOT | 600UL |
| | | 0.26 | 25 | P 2 | TWD 13 | | VSM | +0.08 | TEC | TEH | | | | 11 | | HOT | 600UL |
| | | 0.41 | 50 | P 2 | TWD 18 | | VH3 | +0.69 | TEC | TEH | | | | 11 | | HOT | 600UL |
| | | 0.33 | 150 | P 2 | TWD 15 | | VH3 | -0.62 | TEC | TEH | | | | 11 | | HOT | 600UL |
| 102 | 30 | 0.39 | 78 | P 2 | TWD 17 | | 08C | -1.00 | TEC | TEH | | | | 23 | | HOT | 600UL |
| | | 0.18 | 55 | P 2 | TWD 7 | | 08C | +0.00 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 73 | 31 | 0.35 | 130 | P 2 | TWD 15 | | VH3 | +0.89 | TEC | TEH | | | | 54 | | HOT | 600UL |
| 75 | 31 | 0.21 | 148 | P 3 | TWD 12 | | DBC | +1.75 | TEC | TEH | | | | 11 | | HOT | 600UL |
| | | 0.22 | 101 | P 2 | TWD 11 | | VH3 | +0.83 | TEC | TEH | | | | 11 | | HOT | 600UL |
| 77 | 31 | 0.30 | 128 | P 2 | TWD 13 | | VC3 | +0.93 | TEC | TEH | | | | 54 | | HOT | 600UL |
| | | 0.53 | 125 | P 2 | TWD 20 | | VSM | +0.97 | TEC | TEH | | | | 54 | | HOT | 600UL |
| | | 0.57 | 139 | P 3 | TWD 22 | | DBH | +1.77 | TEC | TEH | | | | 54 | | HOT | 600UL |
| 107 | 31 | 0.31 | 46 | P 2 | TWD 14 | | VH2 | -0.95 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 109 | 31 | 0.22 | 39 | P 3 | TWD 10 | | DBC | -1.80 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 74 | 32 | 0.30 | 19 | P 3 | TWD 17 | | DBH | +1.34 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 76 | 32 | 0.50 | 34 | P 3 | TWD 20 | | DBH | +1.75 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 110 | 32 | 0.34 | 114 | P 2 | TWD 15 | | 02H | -0.89 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 73 | 33 | 0.27 | 154 | P 2 | TWD 12 | | VH3 | +0.72 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.48 | 112 | P 3 | TWD 19 | | DBH | +1.48 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 75 | 33 | 0.29 | 34 | P 3 | TWD 17 | | DBC | -1.92 | TEC | TEH | | | | 15 | | HOT | 600UL |
| | | 0.27 | 130 | P 2 | TWD 14 | | VC3 | +0.81 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 81 | 33 | 0.32 | 148 | P 2 | TWD 14 | | VSM | -0.92 | TEC | TEH | | | | 23 | | HOT | 600UL |
| | | 0.63 | 133 | P 2 | TWD 24 | | VH3 | +0.80 | TEC | TEH | | | | 23 | | HOT | 600UL |
| | | 0.40 | 49 | P 2 | TWD 18 | | VH3 | +0.06 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 103 | 33 | 0.35 | 97 | P 2 | TWD 15 | | VH2 | +0.73 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 111 | 33 | 0.36 | 98 | P 2 | TWD 15 | | VH2 | -0.96 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 56 | 34 | 0.44 | 123 | P 2 | TWD 18 | | VH3 | -0.89 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 72 | 34 | 0.51 | 110 | P 2 | TWD 20 | | VSM | -0.89 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 74 | 34 | 0.33 | 32 | P 3 | TWD 18 | | DBH | +1.37 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 76 | 34 | 0.54 | 103 | P 2 | TWD 21 | | VH3 | +0.84 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.18 | 150 | P 3 | TWD 9 | | DBC | +1.95 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.22 | 41 | P 3 | TWD 10 | | DBH | +1.55 | TEC | TEH | | | | 16 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-------|-----|-------|
| 114 | 34 | 0.38 | 75 | P 3 | TWD 15 | DBC | +1.86 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 63 | 35 | 0.21 | 68 | P 3 | TWD 13 | DBH | -1.83 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 75 | 35 | 0.12 | 146 | P 3 | TWD 8 | DBC | -1.46 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 81 | 35 | 0.15 | 34 | P 3 | TWD 6 | DBC | -1.60 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 111 | 35 | 0.69 | 97 | P 2 | TWD 24 | VH2 | -0.96 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 76 | 36 | 0.40 | 132 | P 2 | TWD 17 | VH3 | -0.15 | TEC | TEH | | | | | 16 | HOT | 600UL |
| | | 0.56 | 120 | P 2 | TWD 21 | VH3 | -0.64 | TEC | TEH | | | | | 16 | HOT | 600UL |
| | | 0.32 | 107 | P 3 | TWD 14 | DBC | +2.17 | TEC | TEH | | | | | 16 | HOT | 600UL |
| 75 | 37 | 0.14 | 163 | P 3 | TWD 9 | DBC | +1.76 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 109 | 37 | 0.14 | 152 | P 3 | TWD 6 | DBC | +2.15 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 111 | 37 | 0.43 | 119 | P 2 | TWD 17 | VH2 | -0.93 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 113 | 37 | 0.27 | 143 | P 2 | TWD 13 | VH2 | -0.93 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 119 | 37 | 0.18 | 161 | P 3 | TWD 7 | DBC | -1.34 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 8 | 38 | 0.31 | 18 | P 1 | SCI | TSH | -0.20 | TSH | TSH | 0.19 | 19.87 | | | 58 | HOT | 580PP |
| 40 | 38 | 0.26 | 146 | P 2 | TWD 12 | VSM | -0.71 | TEC | TEH | | | | | 16 | HOT | 600UL |
| | | 0.39 | 123 | P 2 | TWD 16 | VSM | +0.73 | TEC | TEH | | | | | 16 | HOT | 600UL |
| 56 | 38 | 0.42 | 83 | P 2 | TWD 17 | VH3 | -0.87 | TEC | TEH | | | | | 16 | HOT | 600UL |
| 74 | 38 | 0.19 | 133 | P 3 | TWD 12 | DBH | +1.68 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 78 | 38 | 0.29 | 137 | P 3 | TWD 17 | DBH | +1.53 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 80 | 38 | 0.20 | 130 | P 2 | TWD 11 | VC3 | +0.69 | TEC | TEH | | | | | 15 | HOT | 600UL |
| | | 0.69 | 125 | P 2 | TWD 28 | VSM | +0.71 | TEC | TEH | | | | | 15 | HOT | 600UL |
| | | 0.28 | 117 | P 2 | TWD 15 | VC3 | -0.89 | TEC | TEH | | | | | 15 | HOT | 600UL |
| | | 0.76 | 129 | P 2 | TWD 29 | VH3 | -0.91 | TEC | TEH | | | | | 15 | HOT | 600UL |
| | | 0.43 | 105 | P 3 | TWD 22 | DBH | +1.46 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 84 | 38 | 0.29 | 147 | P 2 | TWD 12 | VH2 | +0.69 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 110 | 38 | 0.14 | 123 | P 3 | TWD 7 | DBH | +1.69 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 25 | 39 | 0.31 | 108 | P 2 | TWD 14 | VSM | +1.20 | TEC | TEH | | | | | 16 | HOT | 600UL |
| 31 | 39 | 0.19 | 150 | P 2 | TWD 11 | 07H | +0.62 | TEC | TEH | | | | | 15 | HOT | 600UL |
| 81 | 39 | 0.30 | 101 | P 2 | TWD 15 | VC3 | +0.87 | TEC | TEH | | | | | 27 | HOT | 600UL |
| 111 | 39 | 0.31 | 69 | P 2 | TWD 13 | VH2 | -1.01 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 113 | 39 | 0.41 | 98 | P 2 | TWD 16 | VH2 | -0.98 | TEC | TEH | | | | | 24 | HOT | 600UL |
| 115 | 39 | 0.22 | 92 | P 2 | TWD 9 | VH2 | -1.01 | TEC | TEH | | | | | 23 | HOT | 600UL |
| 66 | 40 | 0.21 | 7 | P 3 | TWD 12 | DBC | +1.25 | TEC | TEH | | | | | 19 | HOT | 600UL |
| 76 | 40 | 0.35 | 83 | P 2 | TWD 15 | VH3 | +0.69 | TEC | TEH | | | | | 20 | HOT | 600UL |
| | | 0.20 | 101 | P 3 | TWD 9 | DBC | +1.95 | TEC | TEH | | | | | 20 | HOT | 600UL |
| 80 | 40 | 0.34 | 94 | P 2 | TWD 17 | VH3 | -0.06 | TEC | TEH | | | | | 19 | HOT | 600UL |
| | | 0.14 | 139 | P 2 | TWD 8 | VH3 | +0.61 | TEC | TEH | | | | | 19 | HOT | 600UL |
| | | 0.25 | 88 | P 2 | TWD 15 | VC3 | -0.04 | TEC | TEH | | | | | 19 | HOT | 600UL |
| | | 0.20 | 118 | P 2 | TWD 12 | VC3 | +0.65 | TEC | TEH | | | | | 19 | HOT | 600UL |
| 90 | 40 | 0.35 | 50 | P 2 | TWD 17 | VH2 | -0.93 | TEC | TEH | | | | | 27 | HOT | 600UL |
| 94 | 40 | 0.64 | 130 | P 2 | TWD 25 | VSM | +0.75 | TEC | TEH | | | | | 27 | HOT | 600UL |
| 110 | 40 | 0.10 | 119 | P 3 | TWD 5 | DBH | +1.59 | TEC | TEH | | | | | 27 | HOT | 600UL |
| 118 | 40 | 0.21 | 117 | P 3 | TWD 11 | DBH | -1.51 | TEC | TEH | | | | | 27 | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|-------|---|-----|---|------|-------|
| 39 | 41 | 0.30 | 145 | P 2 | TWD 17 | VSM | -0.83 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| 49 | 41 | 0.60 | 120 | P 2 | TWD 21 | 08H | +1.40 | TEC | TEH | | | LOCOK | | 20 | | HOT | 600UL |
| 81 | 41 | 0.27 | 143 | P 2 | TWD 14 | VSM | +0.79 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| | | 0.28 | 124 | P 2 | TWD 14 | VH3 | +0.81 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| | | 0.43 | 69 | P 2 | TWD 20 | VH3 | +0.06 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| | | 0.20 | 152 | P 2 | TWD 11 | VH3 | -0.93 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 113 | 41 | 0.18 | 169 | P 3 | TWD 10 | DBH | +1.81 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 32 | 42 | 0.27 | 127 | P 2 | TWD 12 | 07H | +0.74 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 48 | 42 | 0.21 | 140 | P 2 | TWD 10 | 07H | -0.71 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 72 | 42 | 0.31 | 101 | P 2 | TWD 13 | VH3 | +0.22 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| | | 0.25 | 90 | P 2 | TWD 11 | VH3 | -0.31 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| | | 0.39 | 131 | P 2 | TWD 14 | VH3 | +0.84 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 110 | 42 | 0.35 | 128 | P 2 | TWD 17 | VH2 | -0.75 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| | | 0.11 | 142 | P 2 | TWD 6 | VH2 | +0.84 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 114 | 42 | 0.13 | 135 | P 3 | TWD 7 | DBH | +1.52 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 120 | 42 | 0.19 | 33 | P 3 | TWD 8 | DBC | +1.90 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 124 | 42 | 0.26 | 85 | P 2 | TWD 11 | 04C | +0.89 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 33 | 43 | 0.15 | 60 | P 2 | TWD 7 | 07H | +0.62 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 37 | 43 | 0.47 | 116 | P 2 | TWD 18 | VSM | +0.66 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 49 | 43 | 0.32 | 85 | P 2 | TWD 11 | 08H | +1.67 | TEC | TEH | | | LOCOK | | 20 | | HOT | 600UL |
| | | 0.39 | 81 | P 2 | TWD 16 | 08H | -1.43 | TEC | TEH | | | LOCOK | | 20 | | HOT | 600UL |
| 97 | 43 | 0.33 | 101 | P 2 | TWD 14 | VH2 | +0.85 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 111 | 43 | 0.47 | 99 | P 2 | TWD 21 | VH2 | -0.99 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 117 | 43 | 0.26 | 67 | P 2 | TWD 11 | VH2 | -1.00 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 123 | 43 | 0.22 | 92 | P 2 | TWD 12 | 08C | +0.87 | TEC | TEH | | | | | 27 | | HOT | 600UL |
| 56 | 44 | 0.41 | 49 | P 2 | TWD 16 | 08H | +0.89 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 58 | 44 | 0.32 | 80 | P 2 | TWD 16 | 08H | -0.44 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| 72 | 44 | 0.23 | 39 | P 3 | TWD 10 | DBC | +2.11 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 120 | 44 | 0.22 | 169 | P 2 | TWD 10 | VH1 | -1.00 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 67 | 45 | 0.17 | 120 | P 2 | TWD 10 | 08H | +0.38 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| 73 | 45 | 0.40 | 74 | P 2 | TWD 16 | VC3 | +0.13 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 75 | 45 | 0.43 | 122 | P 2 | TWD 20 | VSM | +0.69 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| | | 0.34 | 150 | P 2 | TWD 17 | VH3 | +0.79 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| | | 0.21 | 85 | P 2 | TWD 11 | VH3 | +0.10 | TEC | TEH | | | | | 19 | | HOT | 600UL |
| 119 | 45 | 0.54 | 118 | P 2 | TWD 20 | VH1 | +0.81 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 36 | 46 | 0.29 | 137 | P 2 | TWD 13 | VSM | +0.78 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| | | 0.37 | 95 | P 2 | TWD 15 | VSM | -0.76 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| | | 0.22 | 123 | P 2 | TWD 7 | 07H | -0.38 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 56 | 46 | 0.61 | 122 | P 2 | TWD 21 | 08H | +0.67 | TEC | TEH | | | | | 20 | | HOT | 600UL |
| 128 | 46 | 0.25 | 103 | P 2 | TWD 11 | 02C | +0.94 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 17 | 47 | 0.34 | 35 | P 2 | TWD 15 | 02H | -1.19 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 27 | 47 | 0.33 | 67 | P 2 | TWD 15 | 02H | -1.18 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 35 | 47 | 0.34 | 137 | P 2 | TWD 15 | VSM | +0.69 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 61 | 47 | 0.27 | 139 | P 2 | TWD 13 | 08H | +0.65 | TEH | TEC | | | | | 39 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-------|-----|------|---|-------|---|-----|---|------|-------|
| 75 | 47 | 0.27 | 92 | P 2 | TWD 13 | | VH3 | +0.08 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.32 | 114 | P 3 | TWD 13 | | DBC | +1.75 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.21 | 98 | P 2 | TWD 11 | | VC3 | +0.28 | TEH | TEC | | | | 37 | | COLD | 600UL |
| 79 | 47 | 0.28 | 84 | P 2 | TWD 13 | | VC3 | -0.97 | TEH | TEC | | | | 37 | | COLD | 600UL |
| 109 | 47 | 0.23 | 134 | P 2 | TWD 11 | | 09C | -0.89 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 76 | 48 | 0.55 | 128 | P 2 | TWD 22 | | VSM | -0.89 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.36 | 67 | P 2 | TWD 17 | | VC3 | +0.97 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.25 | 142 | P 2 | TWD 12 | | VH3 | +0.20 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.45 | 111 | P 2 | TWD 20 | | VSM | +0.91 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.27 | 121 | P 2 | TWD 13 | | VH3 | +0.71 | TEH | TEC | | | | 37 | | COLD | 600UL |
| | | 0.10 | 139 | P 2 | TWD 6 | | VC3 | -0.85 | TEH | TEC | | | | 37 | | COLD | 600UL |
| 86 | 48 | 0.26 | 86 | P 2 | TWD 12 | | VH2 | -0.80 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 106 | 48 | 0.38 | 119 | P 3 | TWD 17 | | DBH | +2.14 | TEH | TEC | | | | 28 | | COLD | 600UL |
| 118 | 48 | 0.42 | 143 | P 2 | TWD 18 | | VH1 | -0.73 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 122 | 48 | 0.27 | 89 | P 2 | TWD 13 | | VH1 | +0.71 | TEH | TEC | | | | 27 | | COLD | 600UL |
| | | 0.53 | 89 | P 2 | TWD 21 | | VH2 | -0.93 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 49 | 49 | 0.37 | 91 | P 2 | TWD 14 | | 08C | -1.07 | TEH | TEC | | | | 38 | | COLD | 600UL |
| | | 0.42 | 114 | P 2 | TWD 15 | | 08H | +2.15 | TEH | TEC | | LOCOK | | 38 | | COLD | 600UL |
| | | 0.22 | 129 | P 2 | TWD 8 | | 08H | -0.47 | TEH | TEC | | | | 38 | | COLD | 600UL |
| 91 | 49 | 0.27 | 114 | P 2 | TWD 13 | | VH2 | -0.71 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 105 | 49 | 0.25 | 42 | P 2 | TWD 12 | | VH2 | -0.81 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 123 | 49 | 0.29 | 87 | P 2 | TWD 14 | | VH1 | -0.85 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 125 | 49 | 0.31 | 97 | P 2 | TWD 13 | | 08C | +0.83 | TEH | TEC | | | | 28 | | COLD | 600UL |
| 36 | 50 | 0.32 | 130 | P 2 | TWD 13 | | 07H | -0.22 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.33 | 68 | P 2 | TWD 14 | | 07H | +0.39 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.26 | 148 | P 2 | TWD 11 | | 07H | +0.89 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 70 | 50 | 0.30 | 87 | P 2 | TWD 14 | | 08H | -0.99 | TEH | TEC | | | | 37 | | COLD | 600UL |
| 106 | 50 | 0.55 | 87 | P 2 | TWD 22 | | VH2 | +0.94 | TEH | TEC | | | | 27 | | COLD | 600UL |
| | | 0.34 | 130 | P 2 | TWD 15 | | VH2 | -0.80 | TEH | TEC | | | | 27 | | COLD | 600UL |
| | | 0.24 | 115 | P 2 | TWD 12 | | VH3 | +1.04 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 37 | 51 | 0.40 | 47 | P 2 | TWD 16 | | 07H | +0.46 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 53 | 51 | 0.23 | 151 | P 2 | TWD 10 | | 08H | -1.11 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.25 | 142 | P 2 | TWD 11 | | 07H | -0.30 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 73 | 51 | 0.33 | 87 | P 2 | TWD 14 | | VH3 | +0.24 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.29 | 138 | P 2 | TWD 12 | | VSM | -0.86 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.27 | 140 | P 2 | TWD 12 | | VC3 | +0.80 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.39 | 121 | P 2 | TWD 16 | | VC3 | +0.24 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.19 | 25 | P 2 | TWD 9 | | VSM | +0.22 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.30 | 141 | P 2 | TWD 13 | | VH3 | +0.72 | TEH | TEC | | | | 36 | | COLD | 600UL |
| | | 0.31 | 84 | P 2 | TWD 13 | | VSM | +0.72 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 131 | 51 | 0.50 | 110 | P 3 | TWD 20 | | DBC | +1.90 | TEC | TEH | | | | 44 | | HOT | 600UL |
| | | 0.54 | 124 | P 2 | TWD 22 | | VH2 | +0.74 | TEC | TEH | | | | 44 | | HOT | 600UL |
| 133 | 51 | 0.21 | 47 | P 2 | TWD 9 | | 08C | +0.84 | TEC | TEH | | | | 45 | | HOT | 600UL |
| 36 | 52 | 0.34 | 43 | P 2 | TWD 14 | | 06H | +0.42 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 106 | 52 | 0.15 | 25 | P 3 | TWD 7 | | DBC | -1.71 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 112 | 52 | 0.32 | 11 | P 3 | TWD 14 | | DBH | +2.00 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 122 | 52 | 0.33 | 27 | P 2 | TWD 14 | | VH1 | +0.73 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 126 | 52 | 0.43 | 128 | P 2 | TWD 18 | | VH1 | +0.83 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 35 | 53 | 0.22 | 82 | P 2 | TWD 10 | | VSM | -0.76 | TEH | TEC | | | | 35 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|-------|---|-----|---|------|-------|
| 43 | 53 | 0.38 | 139 | P 2 | TWD 16 | VSM | +0.02 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| | | 0.68 | 140 | P 2 | TWD 25 | VSM | +0.77 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| 73 | 53 | 0.42 | 90 | P 2 | TWD 17 | VC3 | +0.78 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.33 | 138 | P 2 | TWD 14 | VC3 | +0.26 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.35 | 123 | P 2 | TWD 15 | VH3 | -0.22 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 28 | 54 | 0.29 | 96 | P 2 | TWD 13 | 06H | +0.14 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| 64 | 54 | 0.32 | 50 | P 2 | TWD 14 | 08H | -0.35 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 116 | 54 | 0.33 | 158 | P 3 | TWD 13 | DBH | +1.94 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 122 | 54 | 0.35 | 114 | P 2 | TWD 14 | VH1 | -0.75 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 124 | 54 | 0.21 | 108 | P 2 | TWD 9 | VH1 | -0.87 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| | | 0.29 | 97 | P 2 | TWD 12 | 10H | +0.73 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 130 | 54 | 0.29 | 138 | P 3 | TWD 13 | DBH | -1.82 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 132 | 54 | 0.19 | 118 | P 3 | TWD 9 | DBH | -1.70 | TEC | TEH | | | | | 44 | | HOT | 600UL |
| 79 | 55 | 0.19 | 167 | P 3 | TWD 7 | DBH | +1.82 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| 131 | 55 | 0.23 | 19 | P 3 | TWD 11 | DBH | +1.86 | TEC | TEH | | | | | 44 | | HOT | 600UL |
| 10 | 56 | 0.58 | 21 | P 1 | SCI | TSH | -0.05 | TSH | TSH | 0.16 | 18.11 | | | 55 | | HOT | 580PP |
| 48 | 56 | 0.39 | 40 | P 2 | TWD 16 | 02H | -1.07 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 76 | 56 | 0.22 | 113 | P 2 | TWD 10 | 05C | +0.91 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.29 | 112 | P 2 | TWD 12 | 04C | +0.90 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.21 | 126 | P 2 | TWD 9 | 03C | +0.96 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 120 | 56 | 0.56 | 95 | P 2 | TWD 21 | 10H | +1.59 | TEH | TEC | | | LOCOK | | 29 | | COLD | 600UL |
| 124 | 56 | 0.21 | 158 | P 3 | TWD 9 | DBH | +2.08 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 126 | 56 | 0.15 | 31 | P 2 | TWD 7 | VH1 | -0.79 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 130 | 56 | 0.17 | 133 | P 3 | TWD 7 | DBH | -1.53 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 132 | 56 | 0.12 | 110 | P 3 | TWD 5 | DBH | -2.05 | TEC | TEH | | | | | 44 | | HOT | 600UL |
| 75 | 57 | 0.27 | 119 | P 2 | TWD 12 | VH3 | +0.79 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.65 | 134 | P 2 | TWD 23 | VSM | +0.81 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.25 | 113 | P 2 | TWD 11 | VC3 | -0.79 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| | | 0.12 | 151 | P 2 | TWD 6 | VH3 | +0.20 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 77 | 57 | 0.38 | 112 | P 2 | TWD 16 | VC3 | +0.18 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| | | 0.55 | 61 | P 2 | TWD 22 | VC3 | +0.86 | TEH | TEC | | | | | 35 | | COLD | 600UL |
| 81 | 57 | 0.44 | 105 | P 2 | TWD 17 | 07H | +0.88 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 85 | 57 | 0.85 | 119 | P 2 | TWD 28 | 08H | -0.76 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 89 | 57 | 0.50 | 122 | P 2 | TWD 19 | 09H | +0.53 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 123 | 57 | 0.31 | 153 | P 3 | TWD 14 | DBH | +2.24 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 131 | 57 | 0.18 | 106 | P 3 | TWD 8 | DBH | +1.76 | TEC | TEH | | | | | 44 | | HOT | 600UL |
| 135 | 57 | 0.31 | 10 | P 3 | TWD 12 | DBH | +1.33 | TEC | TEH | | | | | 45 | | HOT | 600UL |
| 72 | 58 | 0.40 | 108 | P 2 | TWD 16 | 08H | +0.71 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 76 | 58 | 0.21 | 58 | P 3 | TWD 10 | DBC | -2.02 | TEH | TEC | | | | | 36 | | COLD | 600UL |
| 84 | 58 | 0.50 | 148 | P 2 | TWD 19 | VH2 | -0.95 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| | | 0.46 | 98 | P 2 | TWD 19 | 09H | -1.24 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| | | 0.74 | 82 | P 2 | TWD 26 | 09H | +1.65 | TEH | TEC | | | LOCOK | | 29 | | COLD | 600UL |
| 118 | 58 | 0.33 | 13 | P 3 | TWD 15 | DBH | +2.16 | TEH | TEC | | | | | 30 | | COLD | 600UL |
| 128 | 58 | 0.48 | 107 | P 2 | TWD 19 | VH3 | +0.81 | TEH | TEC | | | | | 30 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|-----|----------|-------|-----|------|---|------|---|-----|---|------|-------|
| | | 0.23 | 21 | P 2 | TWD | 9 | VH3 | +0.26 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 134 | 58 | 0.33 | 65 | P 2 | TWD | 13 | VC1 | -0.96 | TEC | TEH | | | | 45 | | HOT | 600UL |
| | | 0.27 | 129 | P 2 | TWD | 11 | VC2 | -0.77 | TEC | TEH | | | | 45 | | HOT | 600UL |
| 69 | 59 | 0.18 | 57 | P 3 | TWD | 9 | DBC | +1.75 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 79 | 59 | 0.35 | 143 | P 3 | TWD | 13 | DBH | +2.16 | TEH | TEC | | | | 35 | | COLD | 600UL |
| 81 | 59 | 0.26 | 167 | P 3 | TWD | 11 | DBH | +1.66 | TEH | TEC | | | | 29 | | COLD | 600UL |
| | | 0.68 | 125 | P 2 | TWD | 25 | VC3 | -0.77 | TEH | TEC | | | | 29 | | COLD | 600UL |
| | | 0.64 | 56 | P 2 | TWD | 23 | VC3 | -0.06 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 89 | 59 | 0.30 | 35 | P 2 | TWD | 13 | 01H | +0.77 | TEH | TEC | | | | 29 | | COLD | 600UL |
| | | 0.48 | 114 | P 2 | TWD | 19 | 09H | +0.87 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 121 | 59 | 0.12 | 11 | P 3 | TWD | 5 | DBC | -1.54 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 123 | 59 | 0.26 | 59 | P 2 | TWD | 10 | VH1 | +0.73 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 137 | 59 | 0.45 | 37 | P 3 | TWD | 17 | DBC | +1.63 | TEC | TEH | | | | 45 | | HOT | 600UL |
| 8 | 60 | 0.26 | 135 | P 3 | TWD | 10 | DBH | -0.69 | TEC | TEH | | | | 38 | | HOT | 600UL |
| 84 | 60 | 0.40 | 116 | P 2 | TWD | 16 | 09H | -1.08 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 86 | 60 | 0.27 | 153 | P 2 | TWD | 11 | 08H | -0.80 | TEH | TEC | | | | 30 | | COLD | 600UL |
| | | 0.25 | 104 | P 2 | TWD | 10 | 09H | -0.89 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 96 | 60 | 0.34 | 77 | P 2 | TWD | 15 | 09H | -0.28 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 100 | 60 | 0.74 | 75 | P 2 | TWD | 26 | VH2 | -0.73 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 126 | 60 | 0.59 | 122 | P 2 | TWD | 22 | VH1 | -0.97 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 134 | 60 | 0.44 | 71 | P 3 | TWD | 17 | DBH | +1.66 | TEC | TEH | | | | 45 | | HOT | 600UL |
| 136 | 60 | 0.53 | 97 | P 3 | TWD | 21 | DBH | +1.45 | TEC | TEH | | | | 44 | | HOT | 600UL |
| | | 0.40 | 143 | P 2 | TWD | 18 | VC3 | -0.80 | TEC | TEH | | | | 44 | | HOT | 600UL |
| | | 0.17 | 172 | P 3 | TWD | 8 | DBC | +2.11 | TEC | TEH | | | | 44 | | HOT | 600UL |
| 73 | 61 | 0.44 | 103 | P 2 | TWD | 18 | VSM | +0.83 | TEH | TEC | | | | 36 | | COLD | 600UL |
| 85 | 61 | 0.52 | 78 | P 2 | TWD | 20 | 08H | +0.55 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 87 | 61 | 0.53 | 34 | P 2 | TWD | 20 | 08H | +0.75 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 89 | 61 | 0.51 | 132 | P 2 | TWD | 20 | 09H | +0.85 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 93 | 61 | 0.71 | 84 | P 2 | TWD | 25 | 09H | +0.75 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 97 | 61 | 0.21 | 142 | P 2 | TWD | 9 | 04C | -0.97 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 133 | 61 | 0.10 | 95 | P 3 | TWD | 6 | DBC | -1.75 | TEC | TEH | | | | 44 | | HOT | 600UL |
| 40 | 62 | 0.43 | 77 | P 2 | TWD | 17 | VSM | +0.85 | TEH | TEC | | | | 34 | | COLD | 600UL |
| 46 | 62 | 0.35 | 87 | P 3 | TWD | 14 | DBH | +2.24 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 74 | 62 | 0.16 | 14 | P 3 | TWD | 7 | DBH | +1.93 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 76 | 62 | 0.29 | 105 | P 2 | TWD | 12 | 04C | +0.93 | TEH | TEC | | | | 34 | | COLD | 600UL |
| 82 | 62 | 0.39 | 62 | P 2 | TWD | 16 | VH3 | +0.85 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 86 | 62 | 0.45 | 146 | P 2 | TWD | 18 | VH2 | -0.75 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 90 | 62 | 0.51 | 76 | P 2 | TWD | 20 | VH2 | -0.77 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 94 | 62 | 0.33 | 80 | P 2 | TWD | 14 | 09H | +0.00 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 110 | 62 | 0.33 | 67 | P 2 | TWD | 14 | VH2 | -0.91 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 126 | 62 | 0.33 | 123 | P 2 | TWD | 14 | VH1 | -1.19 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.20 | 104 | P 2 | TWD | 9 | VH1 | +0.04 | TEH | TEC | | | | 32 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|-------|---|-----|---|------|-------|
| 37 | 63 | 0.37 | 93 | P 2 | TWD 15 | VSM | +0.75 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 61 | 63 | 0.49 | 126 | P 2 | TWD 19 | 08H | -0.99 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 81 | 63 | 0.38 | 133 | P 2 | TWD 16 | VSM | -0.83 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 93 | 63 | 0.35 | 59 | P 2 | TWD 15 | 09H | +1.00 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 95 | 63 | 0.53 | 104 | P 2 | TWD 21 | 09H | +0.28 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 141 | 63 | 0.21 | 145 | P 2 | TWD 9 | 08H | +0.70 | TEC | TEH | | | | | 45 | | HOT | 600UL |
| | | 0.39 | 64 | P 3 | TWD 15 | DBH | -1.12 | TEC | TEH | | | | | 45 | | HOT | 600UL |
| 90 | 64 | 0.43 | 86 | P 2 | TWD 17 | VH2 | -0.79 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 94 | 64 | 0.30 | 128 | P 2 | TWD 13 | 08H | -0.45 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.30 | 129 | P 2 | TWD 13 | 09H | +0.26 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 106 | 64 | 0.34 | 136 | P 2 | TWD 14 | VC2 | -0.83 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 108 | 64 | 0.25 | 33 | P 3 | TWD 10 | DBH | +1.88 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 116 | 64 | 0.22 | 151 | P 3 | TWD 8 | DBH | +1.80 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 134 | 64 | 0.44 | 148 | P 2 | TWD 19 | VH2 | -0.96 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 138 | 64 | 0.32 | 125 | P 2 | TWD 15 | VH2 | -0.88 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 140 | 64 | 0.33 | 132 | P 2 | TWD 15 | VH2 | -0.84 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 9 | 65 | 0.18 | 129 | P 3 | TWD 8 | DBH | +0.65 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 39 | 65 | 0.47 | 115 | P 2 | TWD 19 | VSM | +0.79 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 45 | 65 | 0.32 | 145 | P 2 | TWD 13 | 02H | -1.19 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 73 | 65 | 0.27 | 126 | P 2 | TWD 11 | VH3 | +0.91 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| | | 0.41 | 104 | P 2 | TWD 16 | VH3 | -0.81 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 81 | 65 | 0.70 | 135 | P 2 | TWD 25 | VSM | +0.98 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 95 | 65 | 0.79 | 84 | P 2 | TWD 26 | 09H | -0.16 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.36 | 80 | P 2 | TWD 15 | 08H | +0.32 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.20 | 145 | P 2 | TWD 9 | 09H | +0.89 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 97 | 65 | 0.27 | 118 | P 2 | TWD 12 | 09H | -0.71 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 99 | 65 | 0.42 | 122 | P 2 | TWD 17 | 08H | +0.61 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 121 | 65 | 0.37 | 59 | P 2 | TWD 15 | VH1 | +0.79 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 50 | 66 | 0.33 | 27 | P 2 | TWD 14 | 08H | -1.16 | TEH | TEC | | | LOCOK | | 34 | | COLD | 600UL |
| 92 | 66 | 0.35 | 144 | P 2 | TWD 15 | 09H | -0.08 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.28 | 25 | P 2 | TWD 12 | 09H | +1.01 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 94 | 66 | 0.22 | 126 | P 2 | TWD 10 | 09H | +0.61 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 96 | 66 | 0.31 | 42 | P 2 | TWD 13 | 08H | -0.10 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 98 | 66 | 0.33 | 35 | P 2 | TWD 14 | 09H | +0.81 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 102 | 66 | 0.27 | 107 | P 2 | TWD 12 | 09H | +0.87 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 110 | 66 | 0.25 | 49 | P 2 | TWD 11 | VH2 | -0.97 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 126 | 66 | 0.50 | 108 | P 2 | TWD 19 | VH1 | -0.70 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.25 | 39 | P 2 | TWD 10 | VH1 | +0.92 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 134 | 66 | 0.32 | 138 | P 2 | TWD 15 | VH1 | -0.88 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| | | 0.42 | 140 | P 2 | TWD 18 | VH2 | -0.94 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 17 | 67 | 0.26 | 61 | P 3 | TWD 11 | DBH | +1.89 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 27 | 67 | 0.44 | 124 | P 2 | TWD 17 | VSM | +1.19 | TEH | TEC | | | | | 34 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|------|-------|
| 39 | 67 | 0.49 | 106 | P 2 | TWD 20 | VSM | -0.75 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| | | 0.40 | 140 | P 2 | TWD 17 | VSM | +0.63 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 53 | 67 | 0.58 | 114 | P 2 | TWD 22 | 08H | -0.98 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 57 | 67 | 0.30 | 17 | P 1 | SCI | TSH | -10.41 | TSH | TSH | 0.15 | 18.31 | 140 | | | | HOT | 580PP |
| 95 | 67 | 0.44 | 106 | P 2 | TWD 18 | 09H | +0.61 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 101 | 67 | 0.58 | 61 | P 2 | TWD 22 | 09H | +0.83 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 125 | 67 | 0.34 | 37 | P 2 | TWD 14 | VH1 | +0.89 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 141 | 67 | 0.28 | 55 | P 3 | TWD 14 | DBH | +1.54 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 40 | 68 | 0.35 | 92 | P 2 | TWD 16 | VSM | -1.00 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| | | 0.96 | 116 | P 2 | TWD 30 | VSM | +0.81 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 48 | 68 | 0.44 | 104 | P 2 | TWD 18 | VSM | +0.95 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 76 | 68 | 0.48 | 67 | P 2 | TWD 20 | 07H | +0.99 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 82 | 68 | 0.30 | 149 | P 2 | TWD 13 | VH3 | -0.79 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.35 | 128 | P 2 | TWD 15 | VSM | -0.28 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 88 | 68 | 0.35 | 71 | P 2 | TWD 15 | 08H | -1.02 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 92 | 68 | 0.79 | 130 | P 2 | TWD 26 | 09H | -0.14 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 94 | 68 | 0.39 | 138 | P 2 | TWD 16 | VH2 | +0.77 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 96 | 68 | 0.30 | 63 | P 2 | TWD 13 | 09H | +0.77 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 98 | 68 | 0.34 | 26 | P 3 | TWD 15 | DBH | +2.24 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 112 | 68 | 0.32 | 91 | P 2 | TWD 13 | VH2 | -0.93 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 132 | 68 | 0.29 | 95 | P 2 | TWD 15 | VH2 | -0.84 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 138 | 68 | 0.19 | 60 | P 3 | TWD 10 | DBH | +1.98 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 31 | 69 | 0.64 | 104 | P 2 | TWD 23 | 07H | -1.04 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 37 | 69 | 0.38 | 154 | P 2 | TWD 17 | VSM | +0.97 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 81 | 69 | 0.27 | 63 | P 2 | TWD 12 | VSM | -0.61 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.53 | 62 | P 2 | TWD 20 | VC3 | +0.85 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.26 | 122 | P 2 | TWD 12 | VC3 | -0.99 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.13 | 114 | P 3 | TWD 6 | DBH | +0.95 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.17 | 89 | P 3 | TWD 7 | DBH | +1.20 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.33 | 23 | P 2 | TWD 14 | VH3 | -0.02 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 91 | 69 | 0.47 | 114 | P 2 | TWD 18 | 08H | +0.77 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.41 | 107 | P 2 | TWD 17 | 09H | -0.20 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 93 | 69 | 0.32 | 126 | P 2 | TWD 14 | 09H | +0.73 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 95 | 69 | 0.29 | 136 | P 2 | TWD 12 | 08H | +0.26 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 97 | 69 | 0.25 | 43 | P 2 | TWD 11 | 07H | +0.88 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 125 | 69 | 0.26 | 40 | P 2 | TWD 11 | 10H | +0.04 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 137 | 69 | 0.29 | 99 | P 2 | TWD 13 | VH1 | -1.01 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| | | 0.21 | 137 | P 2 | TWD 10 | VH1 | +0.88 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 139 | 69 | 0.28 | 140 | P 2 | TWD 15 | VH1 | +0.75 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| | | 1.00 | 106 | P 2 | TWD 33 | VC1 | -0.88 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 141 | 69 | 0.20 | 37 | P 3 | TWD 9 | DBC | +2.03 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| | | 0.21 | 62 | P 3 | TWD 9 | DBH | +1.69 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 88 | 70 | 0.58 | 101 | P 2 | TWD 22 | VH2 | -0.79 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 96 | 70 | 0.81 | 123 | P 2 | TWD 27 | 07H | +0.79 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.17 | 148 | P 2 | TWD 8 | 09H | -0.10 | TEH | TEC | | | | | 31 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-------|-----|------|---|------|---|-----|---|------|-------|
| 132 | 70 | 0.63 | 108 | P 2 | TWD 26 | | VH1 | +0.63 | TEC | TEH | | | | 47 | | HOT | 600UL |
| | | 0.20 | 75 | P 2 | TWD 11 | | VH1 | +0.12 | TEC | TEH | | | | 47 | | HOT | 600UL |
| 136 | 70 | 0.54 | 36 | P 2 | TWD 23 | | VH1 | +0.85 | TEC | TEH | | | | 47 | | HOT | 600UL |
| 138 | 70 | 0.19 | 105 | P 3 | TWD 10 | | DBH | +1.59 | TEC | TEH | | | | 49 | | HOT | 600UL |
| 95 | 71 | 0.26 | 132 | P 2 | TWD 12 | | 07H | -0.87 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 101 | 71 | 0.30 | 154 | P 2 | TWD 13 | | 09H | +0.75 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.24 | 107 | P 3 | TWD 11 | | DBH | -1.75 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 103 | 71 | 0.35 | 30 | P 2 | TWD 15 | | 09H | +0.87 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 141 | 71 | 0.20 | 56 | P 3 | TWD 11 | | DBH | +1.61 | TEC | TEH | | | | 47 | | HOT | 600UL |
| 143 | 71 | 0.52 | 136 | P 3 | TWD 20 | | DBH | +1.86 | TEC | TEH | | | | 49 | | HOT | 600UL |
| | | 0.41 | 40 | P 3 | TWD 17 | | DBH | -1.64 | TEC | TEH | | | | 49 | | HOT | 600UL |
| 76 | 72 | 0.27 | 88 | P 2 | TWD 12 | | VH3 | -0.61 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 92 | 72 | 0.42 | 84 | P 2 | TWD 17 | | 05H | +0.85 | TEH | TEC | | | | 31 | | COLD | 600UL |
| | | 0.47 | 128 | P 2 | TWD 19 | | 09H | -0.04 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 94 | 72 | 0.28 | 148 | P 2 | TWD 12 | | 07H | +0.31 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 96 | 72 | 0.29 | 42 | P 2 | TWD 13 | | 09H | +0.28 | TEH | TEC | | | | 31 | | COLD | 600UL |
| | | 0.15 | 73 | P 2 | TWD 6 | | 09H | -0.97 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 98 | 72 | 0.66 | 72 | P 2 | TWD 23 | | 07H | +0.79 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 106 | 72 | 0.38 | 146 | P 2 | TWD 16 | | VC2 | -0.85 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 110 | 72 | 0.46 | 100 | P 2 | TWD 18 | | VH2 | -0.99 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 112 | 72 | 0.49 | 104 | P 2 | TWD 19 | | VH2 | -0.86 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 130 | 72 | 0.26 | 106 | P 2 | TWD 11 | | VH1 | -0.87 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 140 | 72 | 0.36 | 19 | P 3 | TWD 17 | | DBH | +1.98 | TEC | TEH | | | | 47 | | HOT | 600UL |
| 142 | 72 | 0.36 | 107 | P 3 | TWD 15 | | DBH | +1.49 | TEC | TEH | | | | 49 | | HOT | 600UL |
| | | 0.41 | 133 | P 2 | TWD 17 | | VH1 | +0.90 | TEC | TEH | | | | 49 | | HOT | 600UL |
| 41 | 73 | 0.29 | 123 | P 3 | TWD 13 | | DBH | -1.54 | TEH | TEC | | | | 34 | | COLD | 600UL |
| 43 | 73 | 0.39 | 89 | P 2 | TWD 17 | | VSM | -0.85 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 47 | 73 | 0.57 | 87 | P 3 | TWD 20 | | DBC | -1.86 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 77 | 73 | 0.34 | 83 | P 2 | TWD 14 | | VH3 | +0.91 | TEH | TEC | | | | 34 | | COLD | 600UL |
| 91 | 73 | 0.38 | 141 | P 2 | TWD 16 | | 08H | +0.83 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.79 | 144 | P 2 | TWD 26 | | 09H | -0.30 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 93 | 73 | 0.40 | 149 | P 2 | TWD 17 | | 09H | +0.85 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 95 | 73 | 0.61 | 73 | P 2 | TWD 22 | | 09H | +0.55 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.28 | 68 | P 2 | TWD 12 | | VH3 | +0.85 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.39 | 148 | P 2 | TWD 16 | | VSM | +0.75 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.34 | 137 | P 2 | TWD 14 | | VH3 | +0.04 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.46 | 33 | P 2 | TWD 18 | | VC2 | +0.06 | TEH | TEC | | | | 32 | | COLD | 600UL |
| | | 0.15 | 130 | P 2 | TWD 7 | | 07H | -0.94 | TEH | TEC | | | | 32 | | COLD | 600UL |
| 97 | 73 | 0.29 | 118 | P 2 | TWD 13 | | 08H | -0.61 | TEH | TEC | | | | 31 | | COLD | 600UL |
| | | 0.38 | 114 | P 2 | TWD 16 | | 08H | +0.73 | TEH | TEC | | | | 31 | | COLD | 600UL |
| | | 0.58 | 112 | P 2 | TWD 22 | | 09H | +0.65 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 42 | 74 | 0.57 | 96 | P 3 | TWD 22 | | DBH | -1.76 | TEH | TEC | | | | 34 | | COLD | 600UL |
| 44 | 74 | 0.34 | 96 | P 3 | TWD 13 | | DBH | -1.95 | TEH | TEC | | | | 33 | | COLD | 600UL |
| | | 0.41 | 145 | P 3 | TWD 16 | | DBC | +1.92 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 66 | 74 | 0.42 | 144 | P 3 | TWD 18 | | DBH | +1.71 | TEH | TEC | | | | 34 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|------|-------|
| 82 | 74 | 0.56 | 23 | P 3 | TWD 22 | DBH | +1.92 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 92 | 74 | 0.56 | 105 | P 2 | TWD 21 | 07H | +0.82 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.26 | 19 | P 2 | TWD 12 | 09H | +0.87 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 94 | 74 | 0.28 | 61 | P 2 | TWD 12 | 09H | -0.40 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 100 | 74 | 0.34 | 152 | P 2 | TWD 14 | 09H | +0.95 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.30 | 54 | P 2 | TWD 13 | 09H | -0.06 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 102 | 74 | 0.20 | 156 | P 2 | TWD 9 | 09H | +0.71 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 130 | 74 | 0.53 | 119 | P 2 | TWD 20 | VH1 | -0.93 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 134 | 74 | 0.36 | 94 | P 2 | TWD 18 | VH1 | -0.89 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 138 | 74 | 0.73 | 112 | P 2 | TWD 28 | VH1 | -0.95 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| | | 0.37 | 114 | P 2 | TWD 18 | VH2 | -1.01 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 142 | 74 | 0.22 | 44 | P 3 | TWD 12 | DBH | +1.85 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 45 | 75 | 0.33 | 130 | P 3 | TWD 14 | DBC | -1.79 | TEH | TEC | | | | | 34 | | COLD | 600UL |
| 47 | 75 | 0.36 | 91 | P 3 | TWD 14 | DBC | -1.75 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 75 | 75 | 0.52 | 125 | P 2 | TWD 21 | VSM | -0.87 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| | | 0.36 | 123 | P 2 | TWD 16 | VSM | +1.05 | TEH | TEC | | | | | 33 | | COLD | 600UL |
| 93 | 75 | 0.71 | 77 | P 2 | TWD 25 | 09H | -0.26 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 103 | 75 | 0.37 | 48 | P 2 | TWD 15 | VH2 | +0.80 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.22 | 113 | P 2 | TWD 10 | 09H | +0.46 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.35 | 82 | P 2 | TWD 15 | 09H | +1.01 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.51 | 122 | P 2 | TWD 20 | 09H | -0.85 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| | | 0.29 | 116 | P 2 | TWD 13 | 09H | +0.72 | TEH | TEC | | | | | 32 | | COLD | 600UL |
| 129 | 75 | 0.33 | 71 | P 2 | TWD 14 | VH1 | +0.84 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 133 | 75 | 0.39 | 46 | P 2 | TWD 18 | 10H | +0.81 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 143 | 75 | 0.33 | 64 | P 3 | TWD 14 | DBH | +1.67 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 46 | 76 | 0.23 | 102 | P 3 | TWD 15 | DBH | -2.03 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 92 | 76 | 0.32 | 46 | P 2 | TWD 13 | 09H | -0.25 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 112 | 76 | 0.41 | 142 | P 2 | TWD 16 | VH2 | -1.00 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| 120 | 76 | 0.39 | 144 | P 2 | TWD 15 | VH1 | -0.86 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| | | 0.35 | 154 | P 2 | TWD 13 | VH2 | -0.96 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| | | 0.32 | 66 | P 2 | TWD 12 | VH2 | +0.86 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| 124 | 76 | 0.25 | 114 | P 3 | TWD 10 | DBH | +1.87 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| | | 0.48 | 121 | P 2 | TWD 18 | VH2 | -0.85 | TEH | TEC | | | | | 24 | | COLD | 600UL |
| 130 | 76 | 0.70 | 90 | P 2 | TWD 24 | VH1 | +0.76 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 136 | 76 | 0.39 | 140 | P 2 | TWD 19 | VH1 | +0.61 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 138 | 76 | 0.46 | 125 | P 2 | TWD 18 | VH2 | -0.94 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| | | 0.37 | 106 | P 2 | TWD 16 | VH1 | -0.26 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 140 | 76 | 0.52 | 125 | P 2 | TWD 20 | VH1 | -0.93 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 47 | 77 | 0.37 | 120 | P 3 | TWD 17 | DBC | -1.93 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 49 | 77 | 0.26 | 65 | P 2 | TWD 14 | 06H | -0.91 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 93 | 77 | 0.46 | 68 | P 2 | TWD 18 | 09H | -0.22 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 95 | 77 | 0.30 | 101 | P 2 | TWD 13 | 08H | +0.48 | TEH | TEC | | | | | 45 | | COLD | 600UL |
| 101 | 77 | 0.27 | 136 | P 2 | TWD 11 | 09H | -0.69 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| | | 0.78 | 102 | P 2 | TWD 26 | 09H | +0.65 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 121 | 77 | 0.12 | 130 | P 3 | TWD 4 | DBC | -0.82 | TEH | TEC | | | | | 23 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-------|------|-------|
| 46 | 78 | 0.93 | 14 | P 3 | TWD 35 | DBH | +1.58 | TEC | TEH | | | | | 6 | HOT | 600UL |
| | | 0.23 | 136 | P 3 | TWD 14 | DBH | -1.62 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 66 | 78 | 0.27 | 110 | P 2 | TWD 15 | 02H | -0.28 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 90 | 78 | 0.37 | 93 | P 2 | TWD 16 | 09H | -0.06 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.26 | 146 | P 2 | TWD 12 | 09H | +0.69 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 94 | 78 | 0.41 | 116 | P 2 | TWD 16 | 09H | -0.12 | TEH | TEC | | | | | 24 | COLD | 600UL |
| | | 0.41 | 145 | P 2 | TWD 15 | 09H | +0.38 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 102 | 78 | 0.57 | 118 | P 2 | TWD 20 | 09H | +0.95 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 104 | 78 | 0.18 | 152 | P 2 | TWD 7 | 09H | +0.39 | TEH | TEC | | | | | 23 | COLD | 600UL |
| 118 | 78 | 0.34 | 148 | P 2 | TWD 13 | VH1 | -0.77 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 128 | 78 | 0.50 | 130 | P 2 | TWD 19 | VH1 | -0.94 | TEH | TEC | | | | | 23 | COLD | 600UL |
| 130 | 78 | 0.36 | 111 | P 2 | TWD 15 | VH1 | -0.90 | TEH | TEC | | | | | 23 | COLD | 600UL |
| 136 | 78 | 0.42 | 121 | P 2 | TWD 20 | VH1 | -0.91 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 140 | 78 | 0.20 | 148 | P 2 | TWD 11 | VH1 | -0.97 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 142 | 78 | 0.38 | 19 | P 3 | TWD 16 | DBH | +1.50 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.79 | 124 | P 2 | TWD 26 | VH1 | -0.90 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 57 | 79 | 0.27 | 119 | P 3 | TWD 17 | DBC | -1.82 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 61 | 79 | 0.53 | 79 | P 2 | TWD 24 | VSM | +0.85 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 91 | 79 | 0.23 | 79 | P 2 | TWD 10 | 07H | +0.33 | TEH | TEC | | | | | 46 | COLD | 600UL |
| | | 0.37 | 125 | P 2 | TWD 15 | 09H | +0.43 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 93 | 79 | 0.27 | 112 | P 2 | TWD 12 | 09H | -0.26 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 99 | 79 | 0.39 | 103 | P 2 | TWD 16 | 07H | +0.78 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 101 | 79 | 0.63 | 75 | P 2 | TWD 24 | 09H | +0.91 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 103 | 79 | 0.31 | 133 | P 2 | TWD 13 | 09H | -0.91 | TEH | TEC | | | | | 46 | COLD | 600UL |
| | | 0.33 | 105 | P 2 | TWD 14 | 09H | +0.18 | TEH | TEC | | | | | 46 | COLD | 600UL |
| | | 0.36 | 122 | P 2 | TWD 15 | 09H | +0.67 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 119 | 79 | 0.20 | 148 | P 3 | TWD 8 | DBH | +0.16 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 143 | 79 | 0.56 | 96 | P 3 | TWD 21 | DBH | +1.83 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 48 | 80 | 0.84 | 94 | P 3 | TWD 29 | DBH | -1.30 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.16 | 144 | P 3 | TWD 8 | DBC | -1.47 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 80 | 80 | 0.47 | 80 | P 2 | TWD 23 | VSM | +0.88 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 126 | 80 | 0.39 | 130 | P 2 | TWD 16 | VH1 | -0.75 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 140 | 80 | 0.35 | 37 | P 3 | TWD 15 | DBH | -1.88 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.72 | 103 | P 2 | TWD 25 | VH1 | -0.80 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 144 | 80 | 0.41 | 155 | P 3 | TWD 17 | DBC | +2.07 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.18 | 12 | P 3 | TWD 9 | DBH | +1.91 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 61 | 81 | 0.22 | 10 | P 3 | TWD 11 | DBH | +1.54 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 81 | 81 | 0.34 | 142 | P 2 | TWD 15 | VH3 | -0.83 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.29 | 81 | P 2 | TWD 13 | VC3 | -0.04 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.38 | 148 | P 2 | TWD 16 | VH3 | +0.83 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.32 | 130 | P 2 | TWD 14 | VSM | +0.91 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.62 | 132 | P 2 | TWD 24 | VC3 | -0.97 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.52 | 76 | P 2 | TWD 21 | VC3 | +0.93 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 99 | 81 | 0.51 | 138 | P 2 | TWD 19 | 09H | +0.71 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 101 | 81 | 0.64 | 147 | P 2 | TWD 24 | 09H | -1.01 | TEH | TEC | | | | | 45 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-------|------|-------|
| 103 | 81 | 0.62 | 91 | P 2 | TWD 22 | 09H | +0.93 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 113 | 81 | 0.28 | 87 | P 3 | TWD 11 | DBH | +1.93 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 121 | 81 | 0.38 | 79 | P 2 | TWD 17 | VH1 | +0.55 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 52 | 82 | 0.57 | 73 | P 3 | TWD 23 | DBH | -1.26 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 56 | 82 | 0.59 | 117 | P 3 | TWD 24 | DBH | -1.36 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 62 | 82 | 0.29 | 125 | P 3 | TWD 14 | DBH | -1.82 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 94 | 82 | 0.61 | 147 | P 2 | TWD 22 | 09H | -0.26 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 102 | 82 | 0.37 | 118 | P 2 | TWD 16 | 09H | +0.46 | TEH | TEC | | | | | 45 | COLD | 600UL |
| | | 0.26 | 79 | P 3 | TWD 10 | DBH | +1.86 | TEH | TEC | | | | | 45 | COLD | 600UL |
| 136 | 82 | 0.25 | 160 | P 2 | TWD 13 | VH1 | -0.87 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 142 | 82 | 0.63 | 115 | P 2 | TWD 23 | VH2 | -0.90 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 144 | 82 | 0.16 | 105 | P 3 | TWD 7 | DBC | +1.90 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.24 | 87 | P 3 | TWD 11 | DBH | +1.86 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 51 | 83 | 0.25 | 48 | P 3 | TWD 16 | DBH | -1.55 | TEC | TEH | | | | | 6 | HOT | 600UL |
| | | 0.40 | 65 | P 3 | TWD 22 | DBC | -1.89 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 53 | 83 | 0.66 | 100 | P 3 | TWD 26 | DBC | -2.10 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 57 | 83 | 0.24 | 52 | P 3 | TWD 12 | DBC | -1.74 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.16 | 26 | P 3 | TWD 9 | DBC | +1.70 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 61 | 83 | 0.43 | 112 | P 3 | TWD 23 | DBC | +2.06 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 63 | 83 | 0.33 | 53 | P 3 | TWD 15 | DBC | +1.78 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 85 | 83 | 0.27 | 130 | P 2 | TWD 13 | 06H | +0.81 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 101 | 83 | 0.60 | 129 | P 2 | TWD 22 | 09H | -0.59 | TEH | TEC | | | | | 46 | COLD | 600UL |
| 131 | 83 | 0.32 | 80 | P 2 | TWD 16 | VH1 | -0.99 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 141 | 83 | 0.60 | 112 | P 2 | TWD 22 | VC1 | +0.84 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 143 | 83 | 0.16 | 107 | P 3 | TWD 9 | DBC | +2.07 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 145 | 83 | 0.43 | 124 | P 3 | TWD 18 | DBC | +1.84 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 54 | 84 | 0.20 | 87 | P 3 | TWD 10 | DBC | -1.32 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 58 | 84 | 0.64 | 80 | P 3 | TWD 29 | DBH | +1.21 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 60 | 84 | 0.22 | 10 | P 3 | TWD 12 | DBH | +1.92 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 74 | 84 | 0.34 | 79 | P 3 | TWD 16 | DBC | -1.78 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 94 | 84 | 0.44 | 63 | P 2 | TWD 18 | 08H | -0.35 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 102 | 84 | 0.30 | 96 | P 3 | TWD 14 | DBH | +1.60 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 114 | 84 | 0.31 | 100 | P 3 | TWD 14 | DBH | +1.89 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 120 | 84 | 0.48 | 112 | P 2 | TWD 20 | VH2 | -0.80 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 124 | 84 | 0.34 | 62 | P 2 | TWD 14 | VH1 | -1.10 | TEH | TEC | | | | | 28 | COLD | 600UL |
| | | 0.42 | 132 | P 2 | TWD 17 | VH2 | -1.05 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 128 | 84 | 0.28 | 146 | P 2 | TWD 12 | VH1 | +0.94 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 130 | 84 | 0.56 | 97 | P 2 | TWD 22 | VH1 | -0.77 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 134 | 84 | 0.66 | 146 | P 2 | TWD 23 | VH1 | -0.84 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 136 | 84 | 0.33 | 89 | P 2 | TWD 16 | VH1 | +0.50 | TEC | TEH | | | | | 47 | HOT | 600UL |
| | | 0.29 | 48 | P 2 | TWD 15 | VH1 | -0.91 | TEC | TEH | | | | | 47 | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-------|------|-------|
| 53 | 85 | 0.39 | 70 | P 3 | TWD 18 | DBC | -2.08 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.37 | 135 | P 3 | TWD 17 | DBH | -1.52 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.87 | 52 | P 3 | TWD 30 | DBH | +1.54 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 55 | 85 | 0.52 | 77 | P 3 | TWD 26 | DBH | +1.36 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 57 | 85 | 0.40 | 41 | P 3 | TWD 18 | DBH | +1.78 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 61 | 85 | 0.40 | 18 | P 3 | TWD 18 | DBH | +2.02 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 65 | 85 | 0.24 | 10 | P 3 | TWD 15 | DBH | +1.33 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 73 | 85 | 0.18 | 99 | P 3 | TWD 12 | DBC | +1.81 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 75 | 85 | 0.24 | 45 | P 3 | TWD 12 | DBC | -1.74 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 95 | 85 | 0.42 | 82 | P 2 | TWD 18 | 08H | +0.86 | TEH | TEC | | | | | 27 | COLD | 600UL |
| | | 0.34 | 69 | P 2 | TWD 16 | 09H | +0.84 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 97 | 85 | 0.29 | 122 | P 2 | TWD 13 | 09H | -0.14 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 101 | 85 | 0.45 | 112 | P 2 | TWD 18 | 09H | -0.53 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 103 | 85 | 0.34 | 110 | P 2 | TWD 16 | 09H | +0.25 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 137 | 85 | 0.08 | 152 | P 2 | TWD 4 | 09H | -1.04 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.25 | 121 | P 2 | TWD 11 | 09H | +0.89 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 60 | 86 | 0.60 | 77 | P 3 | TWD 24 | DBH | -1.76 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 106 | 86 | 0.49 | 99 | P 2 | TWD 19 | VH3 | -0.88 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 112 | 86 | 0.21 | 58 | P 2 | TWD 11 | 08H | +0.99 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 122 | 86 | 0.35 | 116 | P 3 | TWD 16 | DBH | +1.91 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 124 | 86 | 0.29 | 165 | P 3 | TWD 12 | DBH | -0.14 | TEH | TEC | | | | | 27 | COLD | 600UL |
| | | 0.14 | 73 | P 3 | TWD 6 | DBH | +1.83 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 128 | 86 | 0.62 | 107 | P 2 | TWD 24 | VH1 | -0.82 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 53 | 87 | 0.25 | 141 | P 3 | TWD 16 | DBH | -1.61 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 55 | 87 | 0.57 | 77 | P 3 | TWD 23 | DBH | -1.52 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 103 | 87 | 0.48 | 102 | P 2 | TWD 19 | 09H | -0.04 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 119 | 87 | 0.14 | 102 | P 3 | TWD 7 | DBH | +0.69 | TEH | TEC | | | | | 28 | COLD | 600UL |
| 133 | 87 | 0.55 | 124 | P 2 | TWD 24 | VH1 | -0.79 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 54 | 88 | 0.39 | 72 | P 3 | TWD 18 | DBH | -1.48 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 58 | 88 | 0.36 | 62 | P 3 | TWD 16 | DBH | -1.74 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 62 | 88 | 0.24 | 150 | P 3 | TWD 12 | DBH | -1.62 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 68 | 88 | 0.23 | 124 | P 3 | TWD 15 | DBH | -1.51 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 94 | 88 | 0.31 | 97 | P 2 | TWD 13 | 09H | -0.80 | TEH | TEC | | | | | 23 | COLD | 600UL |
| 96 | 88 | 0.24 | 88 | P 2 | TWD 9 | 07H | +0.25 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 104 | 88 | 0.38 | 104 | P 2 | TWD 14 | 08H | +0.50 | TEH | TEC | | | | | 24 | COLD | 600UL |
| 118 | 88 | 0.45 | 112 | P 2 | TWD 18 | VH1 | -0.63 | TEH | TEC | | | | | 23 | COLD | 600UL |
| 130 | 88 | 0.33 | 74 | P 2 | TWD 15 | VH1 | +0.24 | TEH | TEC | | | | | 27 | COLD | 600UL |
| | | 0.20 | 156 | P 2 | TWD 10 | VH1 | +0.75 | TEH | TEC | | | | | 27 | COLD | 600UL |
| 134 | 88 | 0.62 | 139 | P 2 | TWD 22 | VH1 | -0.82 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 138 | 88 | 0.29 | 56 | P 2 | TWD 13 | VH1 | +0.71 | TEC | TEH | | | | | 49 | HOT | 600UL |
| | | 0.85 | 124 | P 2 | TWD 27 | VH1 | -0.78 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 63 | 89 | 0.23 | 57 | P 3 | TWD 11 | DBC | +2.14 | TEC | TEH | | | | | 5 | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|------|-------|
| 67 | 89 | 0.72 | 105 | P 3 | TWD 27 | DBC | -1.90 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 69 | 89 | 0.52 | 143 | P 3 | TWD 26 | DBC | -1.45 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 73 | 89 | 0.15 | 148 | P 3 | TWD 9 | DBH | +1.61 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 79 | 89 | 0.45 | 145 | P 2 | TWD 21 | VH3 | +0.72 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| | | 0.22 | 74 | P 3 | TWD 11 | DBH | +1.64 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 95 | 89 | 0.36 | 132 | P 2 | TWD 14 | 09H | +0.57 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 99 | 89 | 0.72 | 110 | P 2 | TWD 25 | 09H | +0.72 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 121 | 89 | 0.15 | 46 | P 3 | TWD 7 | DBH | -1.11 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| | | 0.11 | 156 | P 3 | TWD 6 | DBH | +0.23 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 131 | 89 | 0.20 | 110 | P 2 | TWD 11 | VH1 | -0.93 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 137 | 89 | 0.32 | 123 | P 2 | TWD 16 | VH1 | +0.73 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| | | 0.18 | 135 | P 2 | TWD 10 | VH1 | -0.85 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 143 | 89 | 0.23 | 128 | P 2 | TWD 10 | 08C | +0.91 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 58 | 90 | 0.29 | 67 | P 3 | TWD 18 | DBH | -1.46 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 60 | 90 | 0.88 | 64 | P 3 | TWD 30 | DBH | +1.60 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 72 | 90 | 0.21 | 72 | P 3 | TWD 14 | DBC | +1.97 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 76 | 90 | 0.31 | 59 | P 2 | TWD 16 | 08C | -0.20 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 116 | 90 | 0.23 | 142 | P 3 | TWD 11 | DBH | +1.93 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 134 | 90 | 0.18 | 144 | P 2 | TWD 8 | VH1 | +0.82 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 53 | 91 | 0.95 | 108 | P 3 | TWD 31 | DBH | -1.45 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| | | 0.16 | 66 | P 3 | TWD 9 | DBH | +1.93 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 55 | 91 | 0.59 | 109 | P 3 | TWD 28 | DBH | +1.30 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| | | 1.09 | 78 | P 3 | TWD 37 | DBH | -1.54 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| | | 0.30 | 58 | P 3 | TWD 18 | DBC | +2.02 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 57 | 91 | 0.26 | 27 | P 3 | TWD 13 | DBC | +1.85 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| | | 0.31 | 107 | P 3 | TWD 15 | DBC | -2.09 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 63 | 91 | 0.31 | 145 | P 3 | TWD 15 | DBC | -1.87 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 65 | 91 | 0.19 | 25 | P 3 | TWD 12 | DBC | -1.75 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 69 | 91 | 0.26 | 134 | P 3 | TWD 17 | DBH | -1.48 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| | | 0.55 | 56 | P 3 | TWD 27 | DBH | +1.68 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 119 | 91 | 0.65 | 136 | P 3 | TWD 19 | DBH | +1.98 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 121 | 91 | 0.25 | 107 | P 3 | TWD 12 | DBH | +2.05 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 123 | 91 | 0.32 | 137 | P 3 | TWD 10 | DBH | +1.98 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 133 | 91 | 0.19 | 51 | P 2 | TWD 9 | VH1 | -0.91 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 137 | 91 | 0.12 | 47 | P 3 | TWD 6 | DBC | +1.68 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 143 | 91 | 0.37 | 29 | P 2 | TWD 18 | VC1 | -0.85 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 145 | 91 | 0.15 | 157 | P 3 | TWD 7 | DBH | +1.99 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| | | 0.49 | 90 | P 2 | TWD 19 | VC1 | -0.84 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 147 | 91 | 0.68 | 96 | P 2 | TWD 26 | VC1 | -0.90 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| | | 0.69 | 107 | P 2 | TWD 26 | VC1 | +0.53 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 58 | 92 | 0.30 | 106 | P 3 | TWD 18 | DBH | -1.68 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 60 | 92 | 0.34 | 14 | P 3 | TWD 16 | DBH | +2.05 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 102 | 92 | 0.29 | 139 | P 3 | TWD 9 | DBH | +1.92 | TEH | TEC | | | | | 21 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|------|-------|
| 110 | 92 | 0.35 | 75 | P 2 | TWD 15 | 09H | -1.15 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 114 | 92 | 0.57 | 136 | P 3 | TWD 17 | DBH | +1.89 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 118 | 92 | 0.58 | 92 | P 3 | TWD 17 | DBH | +1.96 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 142 | 92 | 0.30 | 141 | P 2 | TWD 12 | VH1 | -0.91 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 144 | 92 | 0.29 | 29 | P 2 | TWD 15 | 10C | -1.07 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 146 | 92 | 0.38 | 69 | P 2 | TWD 17 | VC1 | +0.99 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| | | 0.41 | 114 | P 2 | TWD 18 | 10C | +0.56 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| | | 0.34 | 21 | P 3 | TWD 13 | DBC | +1.65 | TEH | TEC | | | | | 40 | | COLD | 600UL |
| 57 | 93 | 0.80 | 92 | P 3 | TWD 33 | DBH | -1.27 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 59 | 93 | 0.45 | 79 | P 3 | TWD 20 | DBH | -1.95 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 99 | 93 | 0.45 | 122 | P 2 | TWD 19 | 09H | +0.50 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 125 | 93 | 0.46 | 45 | P 3 | TWD 19 | DBH | +1.80 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 137 | 93 | 0.32 | 89 | P 2 | TWD 14 | VH1 | -0.95 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 139 | 93 | 0.25 | 99 | P 2 | TWD 13 | VC1 | +0.87 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 141 | 93 | 0.38 | 100 | P 2 | TWD 15 | VC1 | +0.84 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 145 | 93 | 0.29 | 98 | P 2 | TWD 16 | VC1 | -0.71 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.42 | 110 | P 3 | TWD 19 | DBC | +1.68 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 147 | 93 | 0.54 | 142 | P 2 | TWD 24 | VH2 | -0.68 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 68 | 94 | 0.50 | 107 | P 3 | TWD 26 | DBH | -1.73 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 74 | 94 | 0.23 | 97 | P 3 | TWD 11 | DBH | -1.93 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 86 | 94 | 0.29 | 99 | P 2 | TWD 8 | 01C | -0.92 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 94 | 94 | 0.22 | 119 | P 2 | TWD 10 | 07H | +0.95 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 106 | 94 | 0.27 | 134 | P 2 | TWD 12 | VH2 | -0.75 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 114 | 94 | 0.28 | 151 | P 3 | TWD 9 | DBH | -0.96 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 134 | 94 | 0.22 | 133 | P 2 | TWD 10 | VH1 | +0.78 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| | | 0.31 | 141 | P 2 | TWD 14 | VH1 | -0.87 | TEC | TEH | | | | | 49 | | HOT | 600UL |
| 138 | 94 | 0.30 | 65 | P 2 | TWD 15 | VH1 | +0.85 | TEC | TEH | | | | | 47 | | HOT | 600UL |
| 142 | 94 | 0.26 | 149 | P 2 | TWD 14 | VH2 | -0.82 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.17 | 35 | P 2 | TWD 9 | VH1 | +0.86 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.19 | 135 | P 2 | TWD 11 | VH1 | -0.78 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 53 | 95 | 0.37 | 55 | P 3 | TWD 21 | DBC | -1.30 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 101 | 95 | 0.47 | 90 | P 2 | TWD 20 | 09H | -0.21 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| | | 0.19 | 93 | P 2 | TWD 9 | 09H | +1.02 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 123 | 95 | 0.77 | 137 | P 2 | TWD 27 | VH1 | +0.87 | TEH | TEC | | | | | 20 | | COLD | 600UL |
| 145 | 95 | 0.09 | 18 | P 3 | TWD 6 | DBC | -1.57 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 56 | 96 | 0.31 | 30 | P 3 | TWD 15 | DBC | +2.17 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 62 | 96 | 0.53 | 107 | P 3 | TWD 26 | DBC | +1.72 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 94 | 96 | 0.12 | 19 | P 2 | TWD 5 | 08H | -0.49 | TEH | TEC | | | | | 19 | | COLD | 600UL |
| | | 0.19 | 159 | P 2 | TWD 9 | 09H | +0.79 | TEH | TEC | | | | | 19 | | COLD | 600UL |
| 114 | 96 | 0.51 | 160 | P 3 | TWD 21 | DBH | +2.20 | TEH | TEC | | | | | 19 | | COLD | 600UL |
| 124 | 96 | 0.21 | 73 | P 3 | TWD 12 | DBH | +0.54 | TEH | TEC | | | | | 20 | | COLD | 600UL |
| | | 0.48 | 47 | P 3 | TWD 22 | DBH | +1.97 | TEH | TEC | | | | | 20 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-------|------|-------|
| 126 | 96 | 0.30 | 134 | P 2 | TWD 14 | VH1 | -0.92 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 128 | 96 | 0.53 | 136 | P 2 | TWD 21 | VH2 | -0.85 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 132 | 96 | 0.14 | 106 | P 2 | TWD 8 | VH1 | +0.55 | TEC | TEH | | | | | 47 | HOT | 600UL |
| | | 0.38 | 109 | P 2 | TWD 18 | VH1 | -0.85 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 134 | 96 | 0.41 | 135 | P 2 | TWD 16 | VH1 | -0.89 | TEC | TEH | | | | | 49 | HOT | 600UL |
| 144 | 96 | 0.70 | 95 | P 2 | TWD 28 | VH1 | +0.78 | TEC | TEH | | | | | 52 | HOT | 600UL |
| | | 0.23 | 23 | P 2 | TWD 13 | VH1 | +0.17 | TEC | TEH | | | | | 52 | HOT | 600UL |
| | | 0.30 | 54 | P 3 | TWD 15 | DBH | +1.80 | TEC | TEH | | | | | 52 | HOT | 600UL |
| 146 | 96 | 0.58 | 39 | P 3 | TWD 27 | DBC | +1.92 | TEC | TEH | | | | | 53 | HOT | 600UL |
| 55 | 97 | 0.67 | 103 | P 3 | TWD 26 | DBH | -1.77 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.60 | 9 | P 3 | TWD 24 | DBH | +1.53 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 85 | 97 | 0.45 | 90 | P 2 | TWD 19 | 09H | -1.23 | TEH | TEC | | | | | 20 | COLD | 600UL |
| | | 0.44 | 35 | P 2 | TWD 18 | 09H | +1.33 | TEH | TEC | | LOCOK | | | 20 | COLD | 600UL |
| 93 | 97 | 0.52 | 110 | P 2 | TWD 21 | 09H | -0.19 | TEH | TEC | | | | | 20 | COLD | 600UL |
| | | 0.20 | 148 | P 2 | TWD 10 | 09H | +0.85 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 95 | 97 | 0.24 | 89 | P 2 | TWD 12 | 09H | -0.21 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 101 | 97 | 0.67 | 119 | P 2 | TWD 24 | 09H | -0.96 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 103 | 97 | 0.19 | 71 | P 2 | TWD 9 | 09H | -0.92 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.19 | 113 | P 2 | TWD 9 | 09H | +0.81 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 123 | 97 | 0.42 | 137 | P 3 | TWD 18 | DBH | +1.38 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 125 | 97 | 0.28 | 41 | P 3 | TWD 15 | DBH | +1.66 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 131 | 97 | 0.23 | 116 | P 2 | TWD 12 | VH1 | +0.83 | TEC | TEH | | | | | 47 | HOT | 600UL |
| | | 0.12 | 18 | P 2 | TWD 7 | VH1 | -0.87 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 135 | 97 | 0.32 | 103 | P 2 | TWD 16 | VH1 | -0.93 | TEC | TEH | | | | | 47 | HOT | 600UL |
| 141 | 97 | 0.31 | 146 | P 2 | TWD 17 | VH2 | +1.05 | TEC | TEH | | | | | 53 | HOT | 600UL |
| 52 | 98 | 0.64 | 100 | P 3 | TWD 29 | DBH | +1.60 | TEC | TEH | | | | | 6 | HOT | 600UL |
| | | 0.45 | 112 | P 3 | TWD 24 | DBH | -1.54 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 54 | 98 | 0.69 | 103 | P 3 | TWD 26 | DBH | -2.05 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 56 | 98 | 0.30 | 154 | P 3 | TWD 18 | DBH | -1.65 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 58 | 98 | 0.27 | 54 | P 3 | TWD 13 | DBH | -1.72 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 60 | 98 | 0.30 | 12 | P 3 | TWD 18 | DBH | +1.95 | TEC | TEH | | | | | 6 | HOT | 600UL |
| 84 | 98 | 0.24 | 103 | P 2 | TWD 12 | 09H | -1.36 | TEH | TEC | | LOCOK | | | 19 | COLD | 600UL |
| 86 | 98 | 0.21 | 63 | P 2 | TWD 10 | 06H | +0.86 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 88 | 98 | 0.25 | 92 | P 2 | TWD 12 | 09H | -1.07 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 92 | 98 | 0.50 | 129 | P 2 | TWD 22 | 08H | -0.57 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 96 | 98 | 0.38 | 119 | P 2 | TWD 18 | 09H | +0.67 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 142 | 98 | 0.33 | 116 | P 2 | TWD 18 | VH1 | +0.76 | TEC | TEH | | | | | 53 | HOT | 600UL |
| 51 | 99 | 0.37 | 54 | P 3 | TWD 17 | DBH | -1.49 | TEC | TEH | | | | | 5 | HOT | 600UL |
| | | 0.40 | 6 | P 3 | TWD 18 | DBH | +1.59 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 55 | 99 | 0.36 | 93 | P 3 | TWD 17 | DBH | -1.67 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 59 | 99 | 0.19 | 112 | P 3 | TWD 9 | DBH | -1.77 | TEC | TEH | | | | | 5 | HOT | 600UL |
| 87 | 99 | 0.31 | 163 | P 2 | TWD 15 | 07H | +0.97 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.15 | 114 | P 2 | TWD 7 | 08H | -0.45 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.22 | 99 | P 2 | TWD 10 | 09H | +0.97 | TEH | TEC | | | | | 19 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|-----|----------|-------|-----|------|---|-------|---|-----|---|------|-------|
| 91 | 99 | 0.27 | 106 | P 2 | TWD | 13 | 08H | +0.90 | TEH | TEC | | | | 19 | | COLD | 600UL |
| | | 0.26 | 48 | P 2 | TWD | 13 | 08H | -0.89 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 99 | 99 | 0.39 | 93 | P 2 | TWD | 18 | 09H | -0.15 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 113 | 99 | 0.22 | 157 | P 3 | TWD | 12 | DBH | +2.14 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 125 | 99 | 0.33 | 37 | P 3 | TWD | 16 | DBH | +0.81 | TEH | TEC | | | | 20 | | COLD | 600UL |
| | | 0.37 | 125 | P 3 | TWD | 18 | DBH | +1.78 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 129 | 99 | 0.55 | 96 | P 2 | TWD | 21 | 10H | -0.25 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 143 | 99 | 0.14 | 63 | P 3 | TWD | 8 | DBC | +1.66 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 145 | 99 | 0.52 | 129 | P 2 | TWD | 24 | VH2 | +0.88 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.25 | 142 | P 2 | TWD | 14 | 08H | +0.77 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.78 | 136 | P 2 | TWD | 30 | VH3 | +0.78 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.27 | 64 | P 2 | TWD | 15 | VH3 | +0.16 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.30 | 20 | P 3 | TWD | 17 | DBC | +1.98 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 44 | 100 | 0.75 | 71 | P 3 | TWD | 32 | DBH | -1.49 | TEC | TEH | | | | 6 | | HOT | 600UL |
| | | 0.26 | 103 | P 3 | TWD | 17 | DBH | +1.59 | TEC | TEH | | | | 6 | | HOT | 600UL |
| 46 | 100 | 0.59 | 24 | P 3 | TWD | 24 | DBH | +1.62 | TEC | TEH | | | | 5 | | HOT | 600UL |
| 50 | 100 | 0.61 | 76 | P 3 | TWD | 29 | DBH | -1.55 | TEC | TEH | | | | 6 | | HOT | 600UL |
| 56 | 100 | 0.20 | 144 | P 2 | TWD | 11 | VSM | -0.85 | TEC | TEH | | | | 5 | | HOT | 600UL |
| 82 | 100 | 0.33 | 101 | P 2 | TWD | 16 | VH3 | -0.84 | TEH | TEC | | | | 19 | | COLD | 600UL |
| | | 0.29 | 45 | P 2 | TWD | 14 | VH3 | +0.73 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 84 | 100 | 0.67 | 119 | P 2 | TWD | 24 | 09H | -1.50 | TEH | TEC | | LOCOK | | 20 | | COLD | 600UL |
| | | 0.36 | 81 | P 2 | TWD | 16 | 09H | +1.52 | TEH | TEC | | LOCOK | | 20 | | COLD | 600UL |
| 100 | 100 | 0.46 | 142 | P 2 | TWD | 19 | 09H | +0.85 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 106 | 100 | 0.35 | 131 | P 2 | TWD | 17 | 09H | -0.88 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 126 | 100 | 0.32 | 88 | P 2 | TWD | 15 | VH1 | -0.94 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 128 | 100 | 0.58 | 133 | P 2 | TWD | 22 | VH1 | -0.89 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 132 | 100 | 0.46 | 133 | P 2 | TWD | 21 | VH1 | -0.87 | TEC | TEH | | | | 47 | | HOT | 600UL |
| 136 | 100 | 0.28 | 123 | P 2 | TWD | 15 | VH1 | -0.88 | TEC | TEH | | | | 52 | | HOT | 600UL |
| | | 0.41 | 93 | P 2 | TWD | 20 | VH2 | -1.10 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 146 | 100 | 0.26 | 52 | P 2 | TWD | 15 | 10C | +0.00 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.23 | 101 | P 2 | TWD | 13 | 08C | -0.23 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.49 | 110 | P 2 | TWD | 23 | 10C | +0.84 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.25 | 84 | P 2 | TWD | 14 | VC2 | -0.90 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 45 | 101 | 0.54 | 16 | P 3 | TWD | 22 | DBH | +1.17 | TEC | TEH | | | | 5 | | HOT | 600UL |
| | | 0.14 | 39 | P 3 | TWD | 7 | DBH | -1.77 | TEC | TEH | | | | 5 | | HOT | 600UL |
| | | 0.34 | 73 | P 3 | TWD | 16 | DBC | -1.85 | TEC | TEH | | | | 5 | | HOT | 600UL |
| 47 | 101 | 0.51 | 85 | P 3 | TWD | 26 | DBH | -1.86 | TEC | TEH | | | | 6 | | HOT | 600UL |
| | | 0.30 | 85 | P 3 | TWD | 18 | DBC | -1.93 | TEC | TEH | | | | 6 | | HOT | 600UL |
| 49 | 101 | 0.36 | 118 | P 3 | TWD | 16 | DBH | -1.51 | TEC | TEH | | | | 5 | | HOT | 600UL |
| 83 | 101 | 0.15 | 109 | P 2 | TWD | 7 | 07H | -0.64 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 87 | 101 | 0.26 | 107 | P 2 | TWD | 13 | 07H | +0.19 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 89 | 101 | 0.41 | 149 | P 2 | TWD | 17 | 07H | +0.95 | TEH | TEC | | | | 20 | | COLD | 600UL |
| 95 | 101 | 0.50 | 92 | P 2 | TWD | 22 | 09H | -0.48 | TEH | TEC | | | | 19 | | COLD | 600UL |
| | | 0.17 | 36 | P 2 | TWD | 8 | 09H | +0.69 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 99 | 101 | 0.32 | 125 | P 2 | TWD | 15 | 08H | -0.32 | TEH | TEC | | | | 19 | | COLD | 600UL |
| | | 0.33 | 122 | P 2 | TWD | 16 | 09H | +0.71 | TEH | TEC | | | | 19 | | COLD | 600UL |
| | | 0.32 | 122 | P 3 | TWD | 14 | DBH | +1.34 | TEH | TEC | | | | 19 | | COLD | 600UL |
| 101 | 101 | 0.37 | 103 | P 2 | TWD | 16 | 09H | -0.21 | TEH | TEC | | | | 20 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|-------|---|-----|---|------|-------|
| 105 | 101 | 0.28 | 131 | P 2 | TWD 13 | VH2 | +0.40 | TEH | TEC | | | | | 20 | | COLD | 600UL |
| 133 | 101 | 0.29 | 151 | P 2 | TWD 16 | VH1 | -0.95 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.55 | 124 | P 2 | TWD 24 | 10H | -1.03 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 143 | 101 | 0.27 | 75 | P 2 | TWD 15 | VC1 | -0.89 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.13 | 151 | P 3 | TWD 7 | DBC | +1.96 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 44 | 102 | 0.32 | 78 | P 3 | TWD 13 | DBC | +1.44 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 48 | 102 | 0.39 | 113 | P 3 | TWD 16 | DBH | -1.71 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| 80 | 102 | 0.74 | 68 | P 2 | TWD 28 | VC3 | -0.86 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 84 | 102 | 0.31 | 29 | P 2 | TWD 14 | 09H | -1.44 | TEH | TEC | | | LOCOK | | 45 | | COLD | 600UL |
| | | 0.40 | 137 | P 2 | TWD 17 | 07H | -0.88 | TEH | TEC | | | | | 45 | | COLD | 600UL |
| 86 | 102 | 0.45 | 160 | P 2 | TWD 18 | 09H | +0.63 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 90 | 102 | 0.46 | 103 | P 2 | TWD 18 | 08H | +0.88 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.24 | 145 | P 2 | TWD 11 | 09H | +0.08 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 92 | 102 | 0.52 | 62 | P 2 | TWD 20 | 09H | +0.97 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 94 | 102 | 0.32 | 94 | P 2 | TWD 14 | 09H | -0.36 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 100 | 102 | 0.39 | 115 | P 2 | TWD 15 | 09H | -0.29 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 134 | 102 | 0.35 | 149 | P 2 | TWD 18 | VH2 | +0.80 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.24 | 99 | P 2 | TWD 13 | VH2 | -0.86 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 144 | 102 | 0.36 | 72 | P 2 | TWD 19 | VC3 | +0.77 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| | | 0.21 | 44 | P 3 | TWD 13 | DBH | +1.88 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 41 | 103 | 0.44 | 95 | P 3 | TWD 18 | DBH | +1.66 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| | | 0.26 | 134 | P 3 | TWD 12 | DBH | -1.65 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| 47 | 103 | 1.18 | 97 | P 2 | TWD 36 | VSM | -0.77 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 91 | 103 | 0.47 | 131 | P 2 | TWD 19 | 08H | +0.84 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 95 | 103 | 0.33 | 57 | P 2 | TWD 14 | 09H | +0.88 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 97 | 103 | 0.66 | 127 | P 2 | TWD 23 | 09H | +0.31 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 99 | 103 | 0.15 | 139 | P 2 | TWD 7 | 09H | +0.27 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.62 | 98 | P 2 | TWD 23 | 09H | +0.92 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 127 | 103 | 0.56 | 149 | P 2 | TWD 21 | VH1 | -0.90 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.78 | 82 | P 2 | TWD 26 | VH1 | +1.02 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 131 | 103 | 1.03 | 69 | P 2 | TWD 34 | VC3 | -0.82 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 137 | 103 | 0.62 | 77 | P 2 | TWD 26 | VH1 | -0.91 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| | | 0.34 | 49 | P 2 | TWD 17 | VH1 | +0.74 | TEC | TEH | | | | | 52 | | HOT | 600UL |
| 38 | 104 | 0.29 | 84 | P 3 | TWD 13 | DBH | -1.55 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| 40 | 104 | 0.78 | 135 | P 2 | TWD 28 | VSM | +0.90 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 48 | 104 | 0.56 | 105 | P 2 | TWD 23 | VSM | +0.88 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 88 | 104 | 0.36 | 132 | P 2 | TWD 14 | VH2 | -0.85 | TEH | TEC | | | | | 46 | | COLD | 600UL |
| 92 | 104 | 0.30 | 50 | P 2 | TWD 13 | 09H | +0.23 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 94 | 104 | 0.26 | 95 | P 3 | TWD 13 | DBH | +1.25 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 126 | 104 | 0.51 | 154 | P 2 | TWD 20 | VH1 | -0.92 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 142 | 104 | 0.30 | 134 | P 3 | TWD 17 | DBH | +2.01 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 37 | 105 | 0.46 | 42 | P 3 | TWD 18 | DBH | +1.92 | TEH | TEC | | | | | 11 | | COLD | 600UL |
| 87 | 105 | 0.22 | 63 | P 3 | TWD 8 | DBH | -2.01 | TEH | TEC | | | | | 45 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TWD | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|------|----------|-------|-----|------|---|-------|----|-----|------|-------|-------|
| 91 | 105 | 0.62 | 134 | P 2 | TWD | 23 | 09H | -0.17 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 93 | 105 | 0.35 | 125 | P 2 | TWD | 14 | 08H | -0.50 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 95 | 105 | 0.70 | 134 | P 2 | TWD | 25 | 09H | +0.82 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.22 | 38 | P 3 | TWD | 9 | DBH | +0.79 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 105 | 105 | 0.32 | 111 | P 2 | TWD | 13 | VH2 | -0.52 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 143 | 105 | 0.33 | 64 | P 3 | TWD | 18 | DBH | -1.69 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.39 | 132 | P 3 | TWD | 21 | DBC | +1.61 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.29 | 15 | P 3 | TWD | 16 | DBH | +1.78 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 32 | 106 | 0.32 | 92 | P 2 | TWD | 16 | 04C | +0.86 | TEH | TEC | | | | 11 | | COLD | 600UL |
| 38 | 106 | 0.19 | 63 | P 2 | TWD | 8 | VSM | +0.19 | TEH | TEC | | | | 12 | | COLD | 600UL |
| | | 0.32 | 109 | P 2 | TWD | 13 | VSM | +1.03 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 48 | 106 | 0.55 | 78 | P 2 | TWD | 23 | VSM | +0.84 | TEH | TEC | | | | 11 | | COLD | 600UL |
| | | 0.39 | 65 | P 2 | TWD | 18 | VSM | -0.73 | TEH | TEC | | | | 11 | | COLD | 600UL |
| | | 0.62 | 85 | P 2 | TWD | 25 | VSM | -0.11 | TEH | TEC | | | | 11 | | COLD | 600UL |
| 84 | 106 | 0.39 | 95 | P 2 | TWD | 15 | 09H | -1.46 | TEH | TEC | | LOCOK | 46 | | COLD | 600UL | |
| | | 0.70 | 117 | P 2 | TWD | 24 | 09H | +1.56 | TEH | TEC | | LOCOK | 46 | | COLD | 600UL | |
| 98 | 106 | 0.38 | 144 | P 2 | TWD | 16 | 09H | +0.99 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.28 | 46 | P 2 | TWD | 13 | 09H | -0.10 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 102 | 106 | 0.26 | 98 | P 2 | TWD | 12 | 04C | +0.88 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 126 | 106 | 0.51 | 120 | P 2 | TWD | 20 | VH1 | -0.48 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 128 | 106 | 0.52 | 137 | P 2 | TWD | 20 | VH1 | -0.92 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 130 | 106 | 0.44 | 135 | P 2 | TWD | 18 | VH1 | -0.83 | TEH | TEC | | | | 18 | | COLD | 600UL |
| | | 0.29 | 108 | P 2 | TWD | 13 | VH1 | -0.14 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 136 | 106 | 0.51 | 26 | P 2 | TWD | 23 | VH2 | -1.20 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 140 | 106 | 0.16 | 91 | P 3 | TWD | 10 | DBH | +1.36 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 29 | 107 | 0.31 | 58 | P 3 | TWD | 12 | DBH | -1.70 | TEH | TEC | | | | 11 | | COLD | 600UL |
| 35 | 107 | 0.41 | 141 | P 2 | TWD | 16 | VSM | -0.86 | TEH | TEC | | | | 12 | | COLD | 600UL |
| | | 0.35 | 145 | P 2 | TWD | 14 | VSM | +0.00 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 73 | 107 | 0.29 | 124 | P 2 | TWD | 12 | VH3 | -0.79 | TEH | TEC | | | | 12 | | COLD | 600UL |
| | | 0.69 | 119 | P 2 | TWD | 24 | VH3 | +0.88 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 81 | 107 | 0.34 | 69 | P 3 | TWD | 14 | DBH | -1.93 | TEH | TEC | | | | 46 | | COLD | 600UL |
| 97 | 107 | 0.59 | 101 | P 2 | TWD | 22 | 09H | +0.02 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.64 | 67 | P 2 | TWD | 23 | 09H | -0.63 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 111 | 107 | 0.67 | 100 | P 2 | TWD | 24 | VH2 | -0.80 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 115 | 107 | 0.12 | 10 | P 3 | TWD | 5 | DBH | +2.24 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 24 | 108 | 0.66 | 119 | P 2 | TWD | 23 | VSM | -0.51 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 36 | 108 | 0.51 | 104 | P 2 | TWD | 19 | VSM | -0.91 | TEH | TEC | | | | 12 | | COLD | 600UL |
| | | 0.51 | 122 | P 2 | TWD | 19 | VSM | -0.09 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 44 | 108 | 0.77 | 120 | P 2 | TWD | 25 | VSM | -0.54 | TEH | TEC | | | | 12 | | COLD | 600UL |
| | | 0.68 | 118 | P 2 | TWD | 23 | VSM | +0.11 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 48 | 108 | 0.39 | 133 | P 2 | TWD | 15 | VSM | -0.58 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 84 | 108 | 0.42 | 143 | P 2 | TWD | 17 | 09H | -1.72 | TEH | TEC | | LOCOK | 18 | | COLD | 600UL | |
| | | 0.41 | 123 | P 2 | TWD | 17 | 09H | +1.51 | TEH | TEC | | LOCOK | 18 | | COLD | 600UL | |
| 86 | 108 | 0.66 | 75 | P 2 | TWD | 24 | VH2 | -0.32 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 102 | 108 | 0.45 | 66 | P 2 | TWD | 18 | VH2 | -0.78 | TEH | TEC | | | | 17 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|--------|----------|-------|-----|------|------|-------|---|-----|---|------|-------|
| 126 | 108 | 0.30 | | 109 | P 2 | TWD 13 | VH1 | +0.27 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.57 | | 136 | P 2 | TWD 22 | VH1 | -0.97 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 136 | 108 | 0.34 | | 91 | P 2 | TWD 18 | VH1 | +0.70 | TEC | TEH | | | | 52 | | HOT | 600UL |
| | | 0.44 | | 135 | P 2 | TWD 21 | VH1 | -0.93 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 142 | 108 | 0.28 | | 136 | P 2 | TWD 16 | VH3 | +0.82 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.30 | | 137 | P 2 | TWD 16 | VH2 | -1.07 | TEC | TEH | | | | 53 | | HOT | 600UL |
| | | 0.23 | | 133 | P 2 | TWD 13 | VH1 | -0.92 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 17 | 109 | 0.29 | | 69 | P 3 | TWD 13 | DBC | -2.00 | TEH | TEC | | | | 12 | | COLD | 600UL |
| 47 | 109 | 0.33 | | 69 | P 2 | TWD 16 | VSM | -0.13 | TEH | TEC | | | | 11 | | COLD | 600UL |
| 89 | 109 | 0.33 | | 67 | P 2 | TWD 14 | 08H | -0.34 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.24 | | 127 | P 2 | TWD 11 | 09H | +0.61 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 95 | 109 | 0.25 | | 52 | P 2 | TWD 11 | 09H | +0.82 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 99 | 109 | 0.22 | | 144 | P 2 | TWD 10 | 09H | +0.78 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 117 | 109 | 0.35 | | 125 | P 2 | TWD 14 | VH2 | -0.81 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 121 | 109 | 0.26 | | 77 | P 2 | TWD 11 | 10H | -1.12 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 44 | 110 | 0.50 | | 83 | P 2 | TWD 22 | VSM | +0.82 | TEH | TEC | | | | 11 | | COLD | 600UL |
| 82 | 110 | 0.41 | | 40 | P 2 | TWD 17 | VH3 | +0.83 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 84 | 110 | 0.20 | | 52 | P 2 | TWD 9 | 08H | +0.11 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.72 | | 135 | P 2 | TWD 25 | 09H | -1.72 | TEH | TEC | | LOCOK | | 17 | | COLD | 600UL |
| | | 0.78 | | 117 | P 2 | TWD 26 | 09H | +1.49 | TEH | TEC | | LOCOK | | 17 | | COLD | 600UL |
| 96 | 110 | 0.26 | | 100 | P 2 | TWD 10 | 09H | +0.19 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 122 | 110 | 0.36 | | 146 | P 2 | TWD 15 | VH1 | -0.76 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 124 | 110 | 0.58 | | 111 | P 2 | TWD 21 | VH1 | -0.19 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 134 | 110 | 0.51 | | 139 | P 2 | TWD 23 | VH1 | -0.86 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 142 | 110 | 0.17 | | 57 | P 3 | TWD 11 | DBH | +2.12 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 73 | 111 | 0.29 | | 110 | P 2 | TWD 13 | VSM | -0.69 | TEH | TEC | | | | 10 | | COLD | 600UL |
| | | 0.44 | | 146 | P 2 | TWD 18 | VSM | +0.79 | TEH | TEC | | | | 10 | | COLD | 600UL |
| 81 | 111 | 0.41 | | 119 | P 2 | TWD 17 | VH3 | +0.90 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.95 | | 124 | P 2 | TWD 30 | VC3 | -0.73 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.49 | | 108 | P 2 | TWD 19 | VC3 | +0.90 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 87 | 111 | 0.25 | | 104 | P 2 | TWD 11 | 08H | -0.38 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 91 | 111 | 0.43 | | 55 | P 2 | TWD 17 | 09H | +0.65 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 93 | 111 | 0.45 | | 122 | P 2 | TWD 18 | 08H | +0.31 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 95 | 111 | 0.38 | | 78 | P 2 | TWD 16 | 09H | +0.86 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 101 | 111 | 0.37 | | 45 | P 2 | TWD 16 | VH2 | +0.80 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 127 | 111 | 0.38 | | 112 | P 2 | TWD 16 | VH1 | -0.85 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 139 | 111 | 0.26 | | 67 | P 3 | TWD 13 | DBH | +1.80 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 18 | 112 | 0.44 | | 12 | 2 | SAI | TSH | -1.28 | TSH | TSH | 0.14 | 19.00 | | 89 | | HOT | 580PP |
| | | 0.36 | | 11 | 2 | SAI | TSH | -1.56 | TSH | TSH | 0.12 | 19.00 | | 89 | | HOT | 580PP |
| 34 | 112 | 0.33 | | 32 | P 2 | TWD 15 | VSM | +0.65 | TEH | TEC | | | | 9 | | COLD | 600UL |
| 36 | 112 | 0.34 | | 93 | P 2 | TWD 14 | VSM | -0.75 | TEH | TEC | | | | 10 | | COLD | 600UL |
| | | 0.74 | | 132 | P 2 | TWD 25 | VSM | +0.73 | TEH | TEC | | | | 10 | | COLD | 600UL |
| 48 | 112 | 0.59 | | 91 | P 2 | TWD 22 | VSM | -0.02 | TEH | TEC | | | | 10 | | COLD | 600UL |
| | | 1.21 | | 91 | P 2 | TWD 33 | VSM | +0.83 | TEH | TEC | | | | 10 | | COLD | 600UL |
| 86 | 112 | 0.39 | | 40 | P 2 | TWD 15 | 08H | -0.21 | TEH | TEC | | | | 18 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|------|-------|
| 92 | 112 | 0.70 | 101 | P 2 | TWD 25 | 09H | +0.23 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.28 | 100 | P 2 | TWD 13 | 09H | +0.82 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 112 | 112 | 0.54 | 124 | P 2 | TWD 21 | VH2 | -0.75 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 118 | 112 | 0.37 | 108 | P 2 | TWD 15 | VH2 | -0.85 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 122 | 112 | 0.37 | 112 | P 2 | TWD 15 | VH1 | -1.04 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.49 | 73 | P 2 | TWD 19 | VH2 | -0.91 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 124 | 112 | 0.79 | 111 | P 2 | TWD 26 | VH1 | +0.75 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 136 | 112 | 0.47 | 79 | P 2 | TWD 22 | VH2 | -1.24 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 1 | 113 | 0.40 | 125 | P 2 | TWD 20 | 04H | +0.77 | 07H | TEH | LAR | | | | 40 | | HOT | 600UL |
| 47 | 113 | 0.48 | 77 | P 2 | TWD 20 | VSM | -0.90 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.60 | 103 | P 2 | TWD 24 | VSM | -0.02 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.93 | 112 | P 2 | TWD 31 | VSM | +0.82 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.17 | 154 | P 3 | TWD 8 | DBC | -1.68 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| 73 | 113 | 0.43 | 73 | P 2 | TWD 17 | 02H | -1.24 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| 77 | 113 | 0.28 | 93 | P 2 | TWD 12 | VSM | +0.89 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| | | 0.17 | 109 | P 3 | TWD 8 | DBC | +1.87 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| | | 0.45 | 111 | P 2 | TWD 18 | VH3 | +0.87 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| | | 0.25 | 107 | P 2 | TWD 11 | VSM | -0.02 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| 81 | 113 | 0.55 | 91 | P 2 | TWD 21 | 08H | -0.26 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 1.02 | 113 | P 2 | TWD 31 | VSM | -0.61 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.29 | 121 | P 2 | TWD 13 | VC3 | +0.84 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 89 | 113 | 0.49 | 123 | P 2 | TWD 19 | 09H | +0.53 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 91 | 113 | 0.29 | 105 | P 2 | TWD 12 | 09H | -0.39 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.54 | 96 | P 2 | TWD 20 | 09H | +0.50 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 93 | 113 | 0.37 | 72 | P 2 | TWD 16 | 09H | +0.61 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 105 | 113 | 0.39 | 108 | P 2 | TWD 16 | VH2 | -0.73 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 141 | 113 | 0.28 | 158 | P 2 | TWD 15 | 09C | +0.88 | TEC | TEH | | | | | 53 | | HOT | 600UL |
| 10 | 114 | 1.22 | 34 | P 1 | MCI | TSH | -17.95 | TSH | TSH | 0.57 | 19.64 | 60 | | | | HOT | 580PP |
| | | 0.43 | 22 | P 1 | SCI | TSH | -12.25 | TSH | TSH | 0.14 | 19.64 | 60 | | | | HOT | 580PP |
| 70 | 114 | 0.30 | 110 | P 2 | TWD 13 | 07H | -0.76 | TEH | TEC | | | | | 8 | | COLD | 600UL |
| 76 | 114 | 0.55 | 97 | P 2 | TWD 22 | VH3 | +0.63 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.39 | 136 | P 2 | TWD 18 | VC3 | +0.84 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.31 | 107 | P 2 | TWD 15 | VSM | -0.71 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| 84 | 114 | 0.38 | 122 | P 2 | TWD 15 | 09H | +1.89 | TEH | TEC | | LOCOK | 15 | | | | COLD | 600UL |
| | | 0.51 | 131 | P 2 | TWD 20 | 09H | -1.41 | TEH | TEC | | LOCOK | 15 | | | | COLD | 600UL |
| 86 | 114 | 0.39 | 74 | P 2 | TWD 16 | VH2 | -0.67 | TEH | TEC | | | | | 16 | | COLD | 600UL |
| 120 | 114 | 0.31 | 100 | P 3 | TWD 14 | DBH | +0.42 | TEH | TEC | | | | | 16 | | COLD | 600UL |
| 122 | 114 | 0.24 | 81 | P 2 | TWD 9 | VH1 | +0.55 | TEH | TEC | | | | | 15 | | COLD | 600UL |
| 126 | 114 | 0.36 | 122 | P 2 | TWD 14 | VH1 | +0.80 | TEH | TEC | | | | | 15 | | COLD | 600UL |
| 43 | 115 | 0.58 | 139 | P 2 | TWD 23 | VSM | +0.76 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| 79 | 115 | 0.46 | 149 | P 2 | TWD 20 | VH3 | +0.86 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| | | 0.46 | 71 | P 2 | TWD 19 | VC3 | -0.86 | TEH | TEC | | | | | 7 | | COLD | 600UL |
| 91 | 115 | 0.28 | 124 | P 2 | TWD 12 | 09H | +0.29 | TEH | TEC | | | | | 16 | | COLD | 600UL |
| 125 | 115 | 0.41 | 144 | P 2 | TWD 16 | VH1 | +0.63 | TEH | TEC | | | | | 15 | | COLD | 600UL |
| 127 | 115 | 0.42 | 110 | P 2 | TWD 17 | VH1 | +0.83 | TEH | TEC | | | | | 16 | | COLD | 600UL |
| 78 | 116 | 0.48 | 99 | P 2 | TWD 19 | 02H | -0.45 | TEH | TEC | | | | | 8 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|--------|----------|-------|-----|------|---|------|-------|-----|---|------|-------|
| 84 | 116 | 0.47 | | 101 | P 2 | TWD 19 | 09H | -1.54 | TEH | TEC | | | LOCOK | 15 | | COLD | 600UL |
| | | 0.56 | | 141 | P 2 | TWD 21 | 09H | +1.35 | TEH | TEC | | | LOCOK | 15 | | COLD | 600UL |
| 86 | 116 | 0.40 | | 96 | P 2 | TWD 16 | 09H | -1.10 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 102 | 116 | 0.46 | | 128 | P 2 | TWD 18 | VH2 | -0.91 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 124 | 116 | 0.65 | | 139 | P 2 | TWD 24 | VH1 | -0.77 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 79 | 117 | 0.29 | | 137 | P 2 | TWD 14 | 07H | -0.77 | TEH | TEC | | | | 7 | | COLD | 600UL |
| | | 0.73 | | 110 | P 2 | TWD 27 | VC3 | -0.92 | TEH | TEC | | | | 7 | | COLD | 600UL |
| | | 0.81 | | 121 | P 2 | TWD 28 | VC3 | +0.80 | TEH | TEC | | | | 7 | | COLD | 600UL |
| 83 | 117 | 0.33 | | 80 | P 2 | TWD 14 | 01H | +0.90 | TEH | TEC | | | | 16 | | COLD | 600UL |
| | | 0.30 | | 146 | P 2 | TWD 12 | 05C | +0.50 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 87 | 117 | 0.39 | | 124 | P 2 | TWD 16 | 09H | +0.31 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 113 | 117 | 0.19 | | 36 | P 3 | TWD 8 | DBH | +1.89 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 46 | 118 | 0.19 | | 89 | P 2 | TWD 10 | 07H | +0.39 | TEH | TEC | | | | 7 | | COLD | 600UL |
| 74 | 118 | 0.51 | | 97 | P 2 | TWD 21 | 08H | +0.95 | TEH | TEC | | | | 7 | | COLD | 600UL |
| 84 | 118 | 0.46 | | 130 | P 2 | TWD 19 | 09H | -1.20 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 96 | 118 | 0.40 | | 108 | P 2 | TWD 16 | VH2 | -0.93 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 116 | 118 | 0.33 | | 106 | P 2 | TWD 14 | VH1 | -0.85 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 122 | 118 | 0.43 | | 59 | P 2 | TWD 17 | VH2 | -0.86 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 126 | 118 | 0.40 | | 153 | P 2 | TWD 16 | VH1 | +0.78 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 130 | 118 | 0.44 | | 120 | P 2 | TWD 18 | VH2 | -0.88 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 132 | 118 | 0.09 | | 107 | P 3 | TWD 4 | DBH | +1.77 | TEC | TEH | | | | 52 | | HOT | 600UL |
| 136 | 118 | 0.12 | | 14 | P 3 | TWD 8 | DBH | +1.49 | TEC | TEH | | | | 53 | | HOT | 600UL |
| 127 | 119 | 0.35 | | 139 | P 2 | TWD 14 | VH1 | -1.00 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 86 | 120 | 0.42 | | 66 | P 2 | TWD 17 | VH2 | -0.65 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 106 | 120 | 0.19 | | 76 | P 3 | TWD 9 | DBC | +1.56 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 120 | 120 | 0.36 | | 108 | P 2 | TWD 14 | 10H | -1.65 | TEH | TEC | | | LOCOK | 15 | | COLD | 600UL |
| 124 | 120 | 0.52 | | 107 | P 2 | TWD 20 | VH2 | -0.76 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 35 | 121 | 0.39 | | 119 | P 2 | TWD 17 | 05H | +0.81 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 75 | 121 | 0.22 | | 109 | P 2 | TWD 11 | VH3 | -0.79 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 81 | 121 | 0.45 | | 154 | P 2 | TWD 18 | VH3 | +0.83 | TEH | TEC | | | | 16 | | COLD | 600UL |
| | | 0.69 | | 105 | P 2 | TWD 24 | VH3 | -0.81 | TEH | TEC | | | | 16 | | COLD | 600UL |
| 40 | 122 | 0.27 | | 88 | P 2 | TWD 12 | 07H | -0.45 | TEH | TEC | | | | 6 | | COLD | 600UL |
| 58 | 122 | 0.31 | | 36 | P 2 | TWD 14 | 02H | -1.19 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 84 | 122 | 0.43 | | 127 | P 2 | TWD 18 | 09H | -1.55 | TEH | TEC | | | LOCOK | 16 | | COLD | 600UL |
| 112 | 122 | 0.56 | | 71 | P 2 | TWD 21 | 04C | -0.91 | TEH | TEC | | | | 15 | | COLD | 600UL |
| 23 | 123 | 0.36 | | 123 | P 2 | TWD 16 | 07H | +0.35 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 29 | 123 | 0.28 | | 114 | P 2 | TWD 12 | 07H | +0.63 | TEH | TEC | | | | 6 | | COLD | 600UL |
| 43 | 123 | 0.39 | | 88 | P 2 | TWD 17 | 07H | -0.42 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 59 | 123 | 0.25 | | 79 | P 2 | TWD 12 | 07H | -0.29 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 20 | 124 | 0.52 | | 105 | P 2 | TWD 19 | 07H | -0.21 | TEH | TEC | | | | 6 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|--------|----------|--------|-----|------|------|-------|-------|-----|---|------|-------|
| 32 | 124 | 0.59 | | 126 | P 2 | TWD 23 | VSM | -0.70 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 78 | 124 | 0.49 | | 114 | P 2 | TWD 19 | VH3 | +0.00 | TEH | TEC | | | | 6 | | COLD | 600UL |
| | | 0.68 | | 80 | P 2 | TWD 24 | VH3 | +0.98 | TEH | TEC | | | | 6 | | COLD | 600UL |
| | | 0.43 | | 75 | P 2 | TWD 16 | VC3 | -0.73 | TEH | TEC | | | | 6 | | COLD | 600UL |
| | | 0.66 | | 95 | P 2 | TWD 23 | VC3 | +0.90 | TEH | TEC | | | | 6 | | COLD | 600UL |
| 120 | 124 | 0.46 | | 107 | P 2 | TWD 19 | 10H | +1.50 | TEH | TEC | | | LOCOK | 15 | | COLD | 600UL |
| 11 | 125 | 0.50 | | 20 | P 1 | SCI | TSH | -15.44 | TSH | TSH | 0.18 | 18.51 | | 118 | | HOT | 580PP |
| | | 0.28 | | 20 | P 1 | SCI | TSH | -13.80 | TSH | TSH | 0.16 | 18.51 | | 118 | | HOT | 580PP |
| 35 | 125 | 0.40 | | 108 | P 2 | TWD 18 | VSM | +0.80 | TEH | TEC | | | | 5 | | COLD | 600UL |
| | | 0.30 | | 148 | P 2 | TWD 13 | VSM | -0.76 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 49 | 125 | 0.33 | | 118 | P 2 | TWD 14 | 08H | -1.28 | TEH | TEC | | | LOCOK | 6 | | COLD | 600UL |
| | | 0.46 | | 74 | P 2 | TWD 18 | 08H | +1.67 | TEH | TEC | | | LOCOK | 6 | | COLD | 600UL |
| | | 0.29 | | 55 | P 2 | TWD 12 | 08C | -1.34 | TEH | TEC | | | LOCOK | 6 | | COLD | 600UL |
| 79 | 125 | 0.42 | | 106 | P 2 | TWD 18 | VC3 | +0.84 | TEH | TEC | | | | 5 | | COLD | 600UL |
| | | 0.35 | | 123 | P 2 | TWD 15 | VC3 | -0.86 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 24 | 126 | 0.38 | | 108 | P 2 | TWD 15 | 07H | +0.74 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 46 | 126 | 0.39 | | 94 | P 2 | TWD 17 | 01H | +0.90 | TEH | TEC | | | | 5 | | COLD | 600UL |
| 48 | 126 | 0.55 | | 143 | P 2 | TWD 21 | VSM | +0.82 | TEH | TEC | | | | 6 | | COLD | 600UL |
| 114 | 126 | 0.43 | | 145 | P 2 | TWD 17 | VH2 | -0.89 | TEH | TEC | | | | 46 | | COLD | 600UL |
| | | 0.33 | | 101 | P 2 | TWD 14 | VC2 | -0.91 | TEH | TEC | | | | 46 | | COLD | 600UL |
| 11 | 127 | 0.54 | | 29 | P 1 | SCI | TSH | -0.04 | TSH | TSH | 0.15 | 18.82 | | 89 | | HOT | 580PP |
| 23 | 127 | 0.35 | | 112 | P 2 | TWD 16 | 06H | +0.40 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 37 | 127 | 0.37 | | 77 | P 2 | TWD 14 | VSM | -0.84 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 49 | 127 | 0.41 | | 65 | P 2 | TWD 16 | 08H | -1.22 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 85 | 127 | 0.39 | | 60 | P 2 | TWD 16 | VH2 | +0.80 | TEH | TEC | | | | 46 | | COLD | 600UL |
| 34 | 128 | 0.21 | | 111 | P 2 | TWD 11 | VSM | +0.76 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 48 | 128 | 1.24 | | 110 | P 2 | TWD 34 | VSM | +0.02 | TEH | TEC | | | | 4 | | COLD | 600UL |
| | | 0.74 | | 127 | P 2 | TWD 25 | VSM | -0.63 | TEH | TEC | | | | 4 | | COLD | 600UL |
| | | 0.45 | | 110 | P 2 | TWD 17 | VSM | +0.73 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 60 | 128 | 0.36 | | 37 | P 2 | TWD 14 | 08H | +0.27 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 64 | 128 | 0.32 | | 118 | P 2 | TWD 13 | 08H | +0.38 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 41 | 129 | 0.46 | | 19 | P 3 | TWD 19 | DBH | +1.70 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 61 | 129 | 0.54 | | 101 | P 2 | TWD 20 | 08H | +0.48 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 81 | 129 | 0.83 | | 113 | P 2 | TWD 29 | VC3 | +0.83 | TEH | TEC | | | | 45 | | COLD | 600UL |
| | | 0.35 | | 63 | P 2 | TWD 15 | VH3 | +0.93 | TEH | TEC | | | | 45 | | COLD | 600UL |
| 129 | 129 | 0.38 | | 138 | P 3 | TWD 16 | DBH | +1.92 | TEH | TEC | | | | 46 | | COLD | 600UL |
| 82 | 130 | 0.34 | | 110 | P 2 | TWD 17 | VC3 | -0.80 | TEC | TEH | | | | 9 | | HOT | 600UL |
| | | 0.65 | | 142 | P 2 | TWD 26 | VH3 | -0.88 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 128 | 130 | 0.27 | | 90 | P 2 | TWD 14 | 08C | -0.98 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 49 | 131 | 0.24 | | 65 | P 3 | TWD 15 | DBH | -1.02 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 77 | 131 | 0.25 | | 106 | P 2 | TWD 14 | VH3 | -0.90 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 79 | 131 | 0.30 | | 117 | P 2 | TWD 15 | VSM | -0.55 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 8 | 132 | 0.27 | | 16 | P 1 | SCI | TSH | -6.02 | TSH | TSH | 0.14 | 19.54 | | 60 | | HOT | 580PP |
| 76 | 132 | 0.30 | | 148 | P 2 | TWD 16 | VH3 | +0.75 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 80 | 132 | 0.10 | | 136 | P 3 | TWD 5 | DBC | +1.99 | TEC | TEH | | | | 17 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|--------|-----|------|------|-------|---|-----|---|-----|-------|
| 82 | 132 | 0.47 | 124 | P 2 | TWD 21 | | VH3 | +0.81 | TEC | TEH | | | | 9 | | HOT | 600UL |
| | | 0.30 | 146 | P 2 | TWD 15 | | VH3 | -0.91 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 112 | 132 | 0.42 | 40 | P 2 | TWD 20 | | VC3 | +0.62 | TEC | TEH | | | | 10 | | HOT | 600UL |
| | | 0.31 | 81 | P 2 | TWD 16 | | VC2 | -0.90 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 114 | 132 | 0.32 | 130 | P 2 | TWD 16 | | VH2 | -0.84 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 113 | 133 | 0.33 | 109 | P 2 | TWD 17 | | VH2 | -0.70 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 115 | 133 | 0.41 | 71 | P 2 | TWD 20 | | VH1 | +0.88 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 8 | 134 | 0.24 | 57 | P 3 | TWD 15 | | DBC | -0.87 | TEC | TEH | | | | 46 | | HOT | 600UL |
| 94 | 134 | 0.42 | 56 | P 2 | TWD 20 | | VH2 | -1.06 | TEC | TEH | | | | 9 | | HOT | 600UL |
| | | 0.15 | 28 | P 3 | TWD 8 | | DBC | +2.06 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 100 | 134 | 0.18 | 114 | P 3 | TWD 11 | | DBC | +2.16 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 106 | 134 | 0.67 | 111 | P 2 | TWD 27 | | VH2 | -0.90 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 110 | 134 | 0.38 | 139 | P 2 | TWD 19 | | VH2 | -0.71 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 124 | 134 | 0.10 | 56 | P 3 | TWD 6 | | DBH | +1.83 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 76 | 136 | 0.32 | 128 | P 2 | TWD 17 | | VSM | -0.77 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.50 | 101 | P 2 | TWD 23 | | VH3 | +0.94 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 70 | 138 | 0.41 | 107 | P 2 | TWD 19 | | VC3 | -0.92 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 114 | 138 | 0.37 | 84 | P 2 | TWD 18 | | VH2 | -0.87 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 11 | 139 | 0.29 | 18 | P 1 | SCI | | TSH | -14.57 | TSH | TSH | 0.12 | 18.39 | | 155 | | HOT | 580PP |
| 83 | 139 | 0.27 | 148 | P 2 | TWD 14 | | VH2 | +0.79 | TEC | TEH | | | | 10 | | HOT | 600UL |
| 80 | 140 | 0.48 | 139 | P 2 | TWD 21 | | VC3 | +0.75 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.84 | 112 | P 2 | TWD 30 | | VC3 | -0.91 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.34 | 152 | P 2 | TWD 16 | | VH3 | +0.83 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.46 | 111 | P 2 | TWD 21 | | VH3 | -0.89 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 110 | 140 | 0.29 | 103 | P 2 | TWD 15 | | VH2 | +0.60 | TEC | TEH | | | | 9 | | HOT | 600UL |
| 61 | 141 | 0.30 | 135 | P 2 | TWD 16 | | VSM | -0.83 | TEC | TEH | | | | 22 | | HOT | 600UL |
| 81 | 141 | 0.32 | 145 | P 2 | TWD 17 | | VH3 | +0.93 | TEC | TEH | | | | 13 | | HOT | 600UL |
| | | 0.38 | 156 | P 2 | TWD 19 | | VH3 | -0.73 | TEC | TEH | | | | 13 | | HOT | 600UL |
| 60 | 142 | 0.28 | 57 | P 2 | TWD 15 | | VH3 | -0.92 | TEC | TEH | | | | 22 | | HOT | 600UL |
| 80 | 142 | 0.62 | 127 | P 2 | TWD 25 | | VC3 | +0.79 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.48 | 147 | P 2 | TWD 21 | | VC3 | -0.87 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.24 | 99 | P 2 | TWD 12 | | VSM | +0.91 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.44 | 144 | P 2 | TWD 20 | | VSM | -0.81 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.46 | 138 | P 2 | TWD 21 | | VH3 | +0.77 | TEC | TEH | | | | 21 | | HOT | 600UL |
| | | 0.56 | 136 | P 2 | TWD 24 | | VH3 | -0.89 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 98 | 142 | 0.36 | 143 | P 2 | TWD 17 | | VH2 | -0.99 | TEC | TEH | | | | 13 | | HOT | 600UL |
| 108 | 142 | 0.48 | 108 | P 2 | TWD 23 | | VH2 | -0.83 | TEC | TEH | | | | 14 | | HOT | 600UL |
| 110 | 142 | 0.38 | 76 | P 2 | TWD 18 | | VC2 | -1.03 | TEC | TEH | | | | 13 | | HOT | 600UL |
| 37 | 143 | 0.44 | 72 | P 2 | TWD 20 | | 01H | +0.71 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 57 | 143 | 0.42 | 98 | P 2 | TWD 19 | | 05H | -0.24 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 67 | 143 | 0.48 | 108 | P 2 | TWD 21 | | VH3 | +0.89 | TEC | TEH | | | | 21 | | HOT | 600UL |
| 105 | 143 | 0.41 | 57 | P 2 | TWD 19 | | VH2 | -0.89 | TEC | TEH | | | | 13 | | HOT | 600UL |
| 107 | 143 | 0.41 | 130 | P 2 | TWD 20 | | VH2 | -0.77 | TEC | TEH | | | | 14 | | HOT | 600UL |
| 94 | 144 | 0.29 | 116 | P 2 | TWD 15 | | VH2 | -1.13 | TEC | TEH | | | | 13 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|-----|-------|
| 23 | 145 | 0.29 | 113 | P 2 | TWD 17 | VSM | -1.04 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 59 | 145 | 0.51 | 85 | P 2 | TWD 22 | VH3 | +0.95 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| | | 0.37 | 133 | P 2 | TWD 18 | VH3 | -0.85 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 56 | 146 | 0.48 | 124 | P 2 | TWD 24 | VH3 | -0.83 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 70 | 146 | 0.22 | 85 | P 2 | TWD 14 | 01H | +0.80 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 94 | 146 | 0.28 | 85 | P 2 | TWD 15 | VH2 | -0.89 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| | | 0.30 | 122 | P 2 | TWD 16 | VH2 | +0.95 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| | | 0.69 | 108 | P 2 | TWD 28 | VH3 | -0.91 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 37 | 147 | 0.24 | 142 | P 2 | TWD 14 | VSM | +0.78 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 72 | 148 | 0.24 | 135 | P 2 | TWD 14 | VC3 | +0.94 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 94 | 148 | 0.32 | 65 | P 2 | TWD 16 | VC3 | +0.91 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 100 | 148 | 0.35 | 113 | P 2 | TWD 18 | VH2 | -0.87 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 11 | 149 | 0.30 | 12 | P 1 | SCI | TSH | -17.38 | TSH | TSH | 0.19 | 18.49 | | | 146 | | HOT | 580PP |
| | | 0.93 | 27 | P 1 | SCI | TEH | +0.96 | TEH | TEH | 0.21 | | | | 190 | | HOT | 580PP |
| 43 | 149 | 0.40 | 68 | P 2 | TWD 21 | VSM | +0.90 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 61 | 149 | 0.34 | 139 | P 2 | TWD 19 | VH3 | -0.90 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 93 | 149 | 0.22 | 31 | P 3 | TWD 15 | DBC | -1.68 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 60 | 150 | 0.35 | 149 | P 2 | TWD 19 | VH3 | -0.94 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 64 | 150 | 0.33 | 148 | P 2 | TWD 19 | VH3 | +0.77 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 51 | 151 | 0.29 | 51 | P 2 | TWD 16 | 03H | -1.18 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 89 | 151 | 0.24 | 113 | P 2 | TWD 13 | VC3 | -0.89 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 48 | 152 | 0.56 | 101 | P 2 | TWD 27 | VSM | -0.65 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 82 | 152 | 0.38 | 112 | P 2 | TWD 18 | 08C | -0.20 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 96 | 152 | 0.31 | 94 | P 2 | TWD 17 | 02C | +0.79 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 23 | 153 | 0.37 | 86 | P 2 | TWD 20 | VSM | -0.93 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 67 | 153 | 0.41 | 132 | P 2 | TWD 21 | VH3 | -0.89 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 71 | 153 | 0.44 | 127 | P 2 | TWD 22 | VH3 | +0.00 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 81 | 153 | 0.21 | 165 | P 3 | TWD 9 | DBC | +1.80 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 83 | 153 | 0.40 | 108 | P 2 | TWD 19 | VH2 | +0.85 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 44 | 154 | 0.36 | 104 | P 2 | TWD 20 | VSM | +0.68 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 48 | 154 | 0.27 | 154 | P 2 | TWD 16 | VSM | +0.77 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 54 | 156 | 0.80 | 90 | P 2 | TWD 32 | VH3 | +0.73 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 83 | 157 | 0.33 | 103 | P 2 | TWD 16 | VH2 | +0.85 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 85 | 157 | 0.27 | 34 | P 3 | TWD 17 | DBH | +2.25 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 74 | 160 | 0.41 | 73 | P 2 | TWD 21 | 08C | -0.14 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 31 | 161 | 0.17 | 164 | P 3 | TWD 9 | DBH | +1.44 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 77 | 161 | 0.22 | 35 | P 2 | TWD 13 | 07C | -0.96 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| | | 0.23 | 107 | P 2 | TWD 13 | 08C | -0.96 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| | | 0.15 | 143 | P 3 | TWD 11 | DBH | +1.67 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| 79 | 161 | 0.35 | 86 | P 3 | TWD 15 | DBH | +1.74 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| | | 0.28 | 105 | P 2 | TWD 16 | 08H | +0.69 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 36 | 162 | 0.28 | 145 | P 2 | TWD 15 | VSM | +0.86 | TEC | TEH | | | | | 30 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-------|------|-------|
| 70 | 162 | 0.30 | 154 | P 2 | TWD 17 | 08H | +0.81 | TEC | TEH | | | | | 29 | HOT | 600UL |
| 65 | 163 | 0.31 | 129 | P 2 | TWD 17 | VH3 | -0.74 | TEC | TEH | | | | | 30 | HOT | 600UL |
| 70 | 164 | 0.41 | 46 | P 2 | TWD 21 | 08H | +0.99 | TEC | TEH | | | | | 29 | HOT | 600UL |
| 65 | 165 | 0.36 | 124 | P 2 | TWD 19 | 01C | -0.96 | TEC | TEH | | | | | 30 | HOT | 600UL |
| 56 | 166 | 0.64 | 76 | P 2 | TWD 24 | 01C | -0.90 | TEH | TEC | | | | | 47 | COLD | 600UL |
| 62 | 166 | 0.29 | 57 | P 2 | TWD 14 | 01H | +0.08 | TEC | TEH | | | | | 35 | HOT | 600UL |
| 31 | 167 | 0.26 | 128 | P 3 | TWD 16 | DBH | +0.66 | TEC | TEH | | | | | 40 | HOT | 600UL |
| 57 | 167 | 0.33 | 128 | P 2 | TWD 15 | 01H | +0.10 | TEC | TEH | | | | | 35 | HOT | 600UL |
| 32 | 168 | 0.11 | 112 | P 3 | TWD 8 | DBH | +0.00 | TEC | TEH | | | | | 40 | HOT | 600UL |
| 52 | 168 | 0.41 | 120 | P 2 | TWD 20 | 01C | -0.15 | TEC | TEH | | | | | 39 | HOT | 600UL |
| | | 0.34 | 101 | P 2 | TWD 18 | 01H | +0.06 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 49 | 169 | 0.39 | 84 | P 2 | TWD 19 | 01C | -0.94 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 38 | 170 | 0.20 | 68 | P 2 | TWD 11 | 01H | -0.10 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 28 | 172 | 0.49 | 61 | P 2 | TWD 23 | 01C | -0.06 | TEC | TEH | | | | | 40 | HOT | 600UL |
| 30 | 172 | 0.32 | 38 | P 2 | TWD 17 | 06H | +0.88 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 34 | 172 | 0.51 | 77 | P 2 | TWD 23 | VSM | +0.87 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 17 | 173 | 0.46 | 129 | P 2 | TWD 22 | 01C | -0.84 | TEC | TEH | | | | | 40 | HOT | 600UL |
| 14 | 174 | 0.84 | 108 | P 2 | TWD 31 | 01C | -0.10 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 7 | 175 | 0.29 | 141 | P 2 | TWD 15 | 01C | -0.98 | TEC | TEH | | | | | 50 | HOT | 600UL |

Total Tubes : 853
 Total Records: 1161

Appendix 4
Inspection Summary
Steam Generator E-089

Query Name : rpc_icode_and_0-100%twd.gry

Query Title: MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

| | | |
|--------------------------|-------------|--------------------------|
| Selected Outages/Scopes: | 10/04 RFO13 | Out of Scope |
| | 10/04 RFO13 | BOBBIN |
| | 10/04 RFO13 | RPC TSH |
| | 10/04 RFO13 | RPC TSC +1/-1 |
| | 10/04 RFO13 | RPC TSC +3/-1 |
| | 10/04 RFO13 | RPC UBENDS R1-3 |
| | 10/04 RFO13 | RPC UBENDS R4-10 |
| | 10/04 RFO13 | RPC 20% H/L SCALLOP BARS |
| | 10/04 RFO13 | H/L SPECIAL INTEREST |
| | 10/04 RFO13 | C/L SPECIAL INTEREST |
| | 10/04 RFO13 | UBEND SPECIAL INTEREST |
| | 10/04 RFO13 | Special Retest with RPC |

Input Selected : All Tubes
Output File Selected :
Selected Indications : MAI, MCI, MMI, MVI, SAI, SCI, SVI, TWD,
Selected Probes : ALL
Selected Channels : ALL
Selected Cals : ALL
Selected Extent1 : ALL
Selected Extent2 : ALL
Selected Util 1 :
Selected Util 2 :
Selected Tube Heat :
TWD Range :
Volts Range :
Degrees Range :
Radius from Center Range :
Location Range :
Inspection Leg Queried : BOTH
Include In-Service or Out-Service Tubes : In-Service only
Advanced User Query :

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|-----|----------|--------|-----|------|---|------|---|-----|---|-----|-------|
| 27 | 3 | 0.37 | 115 | 2 | SVI | | TSH | +10.63 | TSH | TSH | | | | 179 | | HOT | 580PP |
| 29 | 3 | 0.14 | 100 | 2 | SVI | | TSH | +10.20 | TSH | 01H | | | | 216 | | HOT | 580PP |
| | | 0.08 | 105 | 2 | SVI | | TSH | +10.41 | TSH | 01H | | | | 216 | | HOT | 580PP |
| | | 0.08 | 96 | 2 | SVI | | TSH | +10.61 | TSH | 01H | | | | 216 | | HOT | 580PP |
| 38 | 4 | 0.24 | 31 | P 3 | TWD | 11 | DBH | +1.32 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 44 | 6 | 0.38 | 142 | P 2 | TWD | 16 | VSM | +0.74 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 41 | 7 | 0.30 | 114 | P 2 | TWD | 17 | VSM | -0.77 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.42 | 89 | P 2 | TWD | 20 | VSM | +0.83 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 18 | 8 | 0.27 | 110 | P 2 | TWD | 12 | 02H | -0.92 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 54 | 8 | 0.45 | 103 | P 2 | TWD | 18 | 02C | -0.95 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 55 | 9 | 0.29 | 114 | P 2 | TWD | 13 | 02C | +0.12 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 68 | 12 | 0.54 | 123 | P 2 | TWD | 23 | 02C | +0.00 | TEC | TEH | | | | 20 | | HOT | 600UL |
| 72 | 14 | 0.39 | 149 | P 2 | TWD | 16 | VH3 | -0.82 | TEC | TEH | | | | 19 | | HOT | 600UL |
| 48 | 16 | 0.27 | 19 | P 2 | TWD | 14 | 03H | -1.09 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 72 | 16 | 0.35 | 76 | P 2 | TWD | 17 | VH3 | +0.71 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.40 | 108 | P 2 | TWD | 19 | VH3 | -1.24 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 76 | 16 | 0.36 | 50 | P 2 | TWD | 18 | 08C | +0.00 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 78 | 16 | 0.41 | 73 | P 2 | TWD | 16 | 05C | +0.80 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 83 | 17 | 0.46 | 103 | P 2 | TWD | 24 | 08H | +0.73 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.21 | 117 | P 2 | TWD | 13 | 08H | +0.22 | TEC | TEH | | | | 16 | | HOT | 600UL |
| | | 0.39 | 62 | P 2 | TWD | 21 | 02C | +0.86 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 50 | 18 | 0.20 | 140 | P 2 | TWD | 10 | VSM | +0.69 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.49 | 61 | P 2 | TWD | 22 | VSM | -0.84 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 78 | 18 | 0.33 | 140 | P 2 | TWD | 16 | VH3 | -0.88 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 82 | 18 | 0.47 | 115 | P 2 | TWD | 19 | 08C | +0.97 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 75 | 19 | 0.70 | 133 | P 2 | TWD | 28 | VC3 | +0.86 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.27 | 57 | P 2 | TWD | 14 | VSM | -0.56 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 50 | 20 | 0.47 | 114 | P 2 | TWD | 21 | VSM | +0.60 | TEC | TEH | | | | 24 | | HOT | 600UL |
| | | 0.60 | 77 | P 2 | TWD | 25 | VSM | +0.19 | TEC | TEH | | | | 24 | | HOT | 600UL |
| 24 | 22 | 0.26 | 134 | P 2 | TWD | 14 | VSM | -0.89 | TEC | TEH | | | | 20 | | HOT | 600UL |
| 68 | 22 | 0.44 | 148 | P 2 | TWD | 18 | VH3 | -0.95 | TEC | TEH | | | | 19 | | HOT | 600UL |
| 72 | 22 | 0.34 | 117 | P 2 | TWD | 15 | VH3 | -0.99 | TEC | TEH | | | | 19 | | HOT | 600UL |
| 63 | 23 | 0.33 | 89 | P 2 | TWD | 16 | 01H | +0.76 | TEC | TEH | | | | 20 | | HOT | 600UL |
| 78 | 24 | 0.58 | 106 | P 2 | TWD | 23 | VC3 | -0.91 | TEC | TEH | | | | 61 | | HOT | 600UL |
| 84 | 24 | 0.27 | 17 | P 3 | TWD | 12 | DBC | +1.33 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 96 | 24 | 0.60 | 89 | P 2 | TWD | 27 | 09C | +0.71 | TEC | TEH | | | | 16 | | HOT | 600UL |
| 98 | 24 | 0.45 | 152 | P 2 | TWD | 18 | 04H | -1.00 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 79 | 25 | 0.47 | 44 | P 2 | TWD | 17 | 08C | -1.07 | TEC | TEH | | | | 23 | | HOT | 600UL |
| 99 | 25 | 0.26 | 126 | P 2 | TWD | 11 | VH2 | -0.97 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 101 | 25 | 0.29 | 123 | P 2 | TWD | 13 | VH2 | -0.93 | TEC | TEH | | | | 15 | | HOT | 600UL |
| 65 | 27 | 0.79 | 57 | P 2 | TWD | 24 | VC3 | -0.99 | TEC | TEH | | | | 29 | | HOT | 600UL |
| | | 1.12 | 136 | P 2 | TWD | 30 | VSM | -0.87 | TEC | TEH | | | | 29 | | HOT | 600UL |
| | | 0.34 | 99 | P 2 | TWD | 13 | VH3 | +0.62 | TEC | TEH | | | | 29 | | HOT | 600UL |
| 81 | 27 | 0.22 | 63 | P 3 | TWD | 13 | DBH | -1.58 | TEC | TEH | | | | 12 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|-----|-------|
| 97 | 27 | 0.12 | 134 | P 3 | TWD 8 | DBC | -1.81 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 38 | 28 | 0.39 | 62 | P 2 | TWD 18 | VSM | +0.83 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| | | 0.30 | 80 | P 2 | TWD 15 | VSM | -0.80 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| 66 | 28 | 0.30 | 107 | P 2 | TWD 15 | VH3 | -0.81 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| 106 | 28 | 0.36 | 142 | P 3 | TWD 15 | DBH | +1.80 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| | | 0.36 | 137 | P 2 | TWD 15 | VH2 | -0.87 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 77 | 29 | 0.78 | 122 | P 2 | TWD 24 | VC3 | +0.80 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 79 | 29 | 0.50 | 65 | P 2 | TWD 18 | VC3 | +0.78 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| | | 0.31 | 117 | P 2 | TWD 12 | VSM | -0.85 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 81 | 29 | 0.44 | 139 | P 2 | TWD 21 | VH3 | +0.77 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 36 | 30 | 0.50 | 100 | P 2 | TWD 18 | VSM | +0.88 | TEC | TEH | | | | | 29 | | HOT | 600UL |
| 46 | 30 | 0.25 | 44 | P 2 | TWD 13 | VSM | +0.14 | TEC | TEH | | | | | 30 | | HOT | 600UL |
| 106 | 30 | 0.32 | 126 | P 2 | TWD 17 | 09H | +0.72 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 85 | 31 | 0.21 | 32 | P 3 | TWD 13 | DBH | -1.57 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 97 | 31 | 0.32 | 121 | P 2 | TWD 16 | VH2 | -0.89 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 105 | 31 | 0.29 | 156 | P 2 | TWD 15 | VH2 | -0.85 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 107 | 31 | 0.37 | 112 | P 3 | TWD 15 | DBH | -1.58 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 84 | 32 | 0.16 | 18 | P 3 | TWD 10 | DBH | -1.78 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 110 | 32 | 0.17 | 163 | P 3 | TWD 8 | DBH | +1.39 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 59 | 33 | 0.32 | 162 | P 2 | TWD 12 | VH3 | -0.97 | TEC | TEH | | | | | 32 | | HOT | 600UL |
| 110 | 34 | 0.29 | 56 | P 2 | TWD 13 | 07H | +0.27 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 46 | 36 | 1.07 | 107 | P 2 | TWD 34 | VSM | -0.84 | TEC | TEH | | | | | 33 | | HOT | 600UL |
| | | 0.67 | 112 | P 2 | TWD 26 | VSM | +0.92 | TEC | TEH | | | | | 33 | | HOT | 600UL |
| | | 0.31 | 28 | P 2 | TWD 13 | VSM | +0.27 | TEC | TEH | | | | | 33 | | HOT | 600UL |
| 102 | 36 | 0.36 | 76 | P 2 | TWD 18 | VH2 | -0.78 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 111 | 37 | 0.38 | 17 | P 3 | TWD 16 | DBC | +2.17 | TEC | TEH | | | | | 11 | | HOT | 600UL |
| 26 | 38 | 0.30 | 117 | P 2 | TWD 15 | 03H | -0.21 | TEC | TEH | | | | | 39 | | HOT | 600UL |
| 38 | 38 | 0.48 | 104 | P 2 | TWD 20 | VSM | +0.06 | TEC | TEH | | | | | 33 | | HOT | 600UL |
| 112 | 38 | 0.32 | 16 | P 3 | TWD 18 | DBH | +1.05 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 41 | 39 | 0.17 | 47 | P 3 | TWD 8 | DBC | +1.87 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 69 | 39 | 0.38 | 87 | P 2 | TWD 16 | VH3 | -0.89 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 77 | 39 | 0.38 | 135 | P 2 | TWD 16 | VC3 | +0.85 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 79 | 39 | 0.53 | 83 | P 3 | TWD 20 | DBC | +1.77 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 109 | 39 | 0.17 | 63 | P 3 | TWD 10 | DBC | -1.35 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 38 | 40 | 0.19 | 95 | P 2 | TWD 10 | VSM | -0.11 | TEC | TEH | | | | | 39 | | HOT | 600UL |
| | | 1.02 | 94 | P 2 | TWD 33 | VSM | -0.73 | TEC | TEH | | | | | 39 | | HOT | 600UL |
| 78 | 40 | 0.18 | 152 | P 3 | TWD 11 | DBC | -1.75 | TEC | TEH | | | | | 39 | | HOT | 600UL |
| 112 | 40 | 0.33 | 27 | P 3 | TWD 18 | DBH | +1.47 | TEC | TEH | | | | | 12 | | HOT | 600UL |
| 39 | 41 | 0.31 | 93 | P 3 | TWD 13 | DBH | -1.90 | TEC | TEH | | | | | 38 | | HOT | 600UL |
| 115 | 41 | 0.31 | 131 | P 2 | TWD 14 | VH1 | +0.84 | TEC | TEH | | | | | 7 | | HOT | 600UL |
| 74 | 42 | 0.41 | 75 | P 2 | TWD 19 | VH3 | +0.77 | TEC | TEH | | | | | 39 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.gry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-------|------|-------|
| 88 | 42 | 0.27 | 84 | P 2 | TWD 12 | VC3 | +0.86 | TEC | TEH | | | | | 7 | HOT | 600UL |
| 100 | 42 | 0.33 | 48 | P 2 | TWD 15 | VH2 | -0.89 | TEC | TEH | | | | | 7 | HOT | 600UL |
| 110 | 42 | 0.32 | 83 | P 2 | TWD 16 | VH2 | -0.98 | TEC | TEH | | | | | 8 | HOT | 600UL |
| 23 | 43 | 0.37 | 119 | P 2 | TWD 18 | 01H | +0.86 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 39 | 43 | 0.50 | 107 | P 2 | TWD 22 | VSM | +0.91 | TEC | TEH | | | | | 39 | HOT | 600UL |
| 75 | 43 | 0.83 | 110 | P 2 | TWD 27 | VC3 | +0.74 | TEC | TEH | | | | | 38 | HOT | 600UL |
| 92 | 44 | 0.31 | 118 | P 2 | TWD 16 | VH2 | -0.86 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 102 | 44 | 0.22 | 34 | P 3 | TWD 9 | DBH | +1.88 | TEC | TEH | | | | | 61 | HOT | 600UL |
| 110 | 44 | 0.28 | 98 | P 2 | TWD 13 | VH2 | -0.65 | TEC | TEH | | | | | 61 | HOT | 600UL |
| 124 | 44 | 0.37 | 121 | P 2 | TWD 19 | VH2 | -0.82 | TEC | TEH | | | | | 2 | HOT | 600UL |
| | | 0.25 | 148 | P 2 | TWD 14 | VH1 | -0.90 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 43 | 45 | 0.46 | 37 | P 3 | TWD 16 | DBH | +1.68 | TEC | TEH | | | | | 42 | HOT | 600UL |
| 75 | 45 | 0.30 | 158 | P 2 | TWD 11 | VH3 | -0.89 | TEC | TEH | | | | | 42 | HOT | 600UL |
| 107 | 45 | 0.66 | 95 | P 2 | TWD 25 | VH2 | -0.71 | TEC | TEH | | | | | 61 | HOT | 600UL |
| | | 0.82 | 39 | P 2 | TWD 28 | VH2 | +0.71 | TEC | TEH | | | | | 61 | HOT | 600UL |
| 115 | 45 | 0.80 | 136 | P 2 | TWD 28 | VH1 | -1.06 | TEC | TEH | | | | | 61 | HOT | 600UL |
| 88 | 46 | 0.36 | 123 | P 3 | TWD 14 | DBC | -1.89 | TEC | TEH | | | | | 61 | HOT | 600UL |
| 90 | 46 | 0.33 | 36 | P 2 | TWD 17 | VH2 | -1.18 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 106 | 46 | 0.24 | 86 | P 2 | TWD 14 | VH3 | -0.93 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 118 | 46 | 0.37 | 119 | P 2 | TWD 19 | VH1 | -0.99 | TEC | TEH | | | | | 2 | HOT | 600UL |
| | | 0.15 | 151 | P 2 | TWD 9 | VH1 | +0.86 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 122 | 46 | 0.21 | 62 | P 2 | TWD 12 | VH2 | -0.81 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 124 | 46 | 0.20 | 113 | P 2 | TWD 12 | VH2 | -0.91 | TEC | TEH | | | | | 2 | HOT | 600UL |
| 27 | 47 | 0.24 | 25 | P 1 | SCI | TSH | -5.70 | TSH | TSH | 0.19 | | | | 139 | HOT | 580PP |
| | | 0.26 | 28 | P 1 | SCI | TSH | -0.10 | TSH | TSH | 0.15 | | | | 139 | HOT | 580PP |
| | | 0.79 | 31 | P 1 | MCI | TSH | -12.57 | TSH | TSH | 0.66 | 19.10 | | | 139 | HOT | 580PP |
| 41 | 47 | 0.32 | 63 | P 2 | TWD 18 | VSM | -0.08 | TEH | TEC | | | | | 6 | COLD | 600UL |
| | | 0.29 | 107 | P 2 | TWD 16 | VSM | +0.80 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 49 | 47 | 0.17 | 20 | P 3 | TWD 11 | DBH | +1.00 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 53 | 47 | 0.22 | 155 | P 2 | TWD 13 | 03C | +0.86 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 57 | 47 | 0.37 | 118 | P 2 | TWD 20 | 08H | +0.52 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 103 | 47 | 0.36 | 127 | P 2 | TWD 17 | VH2 | -0.90 | TEH | TEC | | | | | 12 | COLD | 600UL |
| 111 | 47 | 0.27 | 128 | P 2 | TWD 14 | 08C | +0.88 | TEH | TEC | | | | | 12 | COLD | 600UL |
| 26 | 48 | 0.49 | 26 | P 2 | TWD 21 | VSM | -1.23 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 60 | 48 | 0.58 | 115 | P 2 | TWD 27 | 08H | -0.88 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 88 | 48 | 0.38 | 120 | P 2 | TWD 18 | VH2 | -0.83 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 49 | 49 | 0.55 | 130 | P 2 | TWD 26 | 08H | +1.61 | TEH | TEC | | LOCOK | | | 6 | COLD | 600UL |
| 65 | 49 | 0.49 | 153 | P 2 | TWD 24 | VH3 | -0.74 | TEH | TEC | | | | | 6 | COLD | 600UL |
| | | 0.19 | 164 | P 2 | TWD 12 | VH3 | +0.78 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 131 | 49 | 0.22 | 19 | P 3 | TWD 10 | DBH | +1.60 | TEC | TEH | | | | | 57 | HOT | 600UL |
| 36 | 50 | 0.20 | 159 | P 3 | TWD 12 | DBH | +2.23 | TEH | TEC | | | | | 6 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-------|------|-------|
| 60 | 50 | 0.38 | 133 | P 2 | TWD 20 | 08H | -0.41 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 62 | 50 | 0.60 | 99 | P 2 | TWD 24 | 08H | -0.15 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 102 | 50 | 0.39 | 96 | P 2 | TWD 19 | VH2 | -0.81 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 108 | 50 | 0.48 | 138 | P 2 | TWD 22 | VH2 | +0.99 | TEH | TEC | | | | | 12 | COLD | 600UL |
| 122 | 50 | 0.22 | 98 | P 2 | TWD 12 | 08C | +0.87 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 31 | 51 | 0.29 | 103 | P 2 | TWD 14 | 06H | +0.81 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 43 | 51 | 0.28 | 99 | P 2 | TWD 13 | 02H | +0.77 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 57 | 51 | 0.19 | 99 | P 2 | TWD 12 | 08H | +0.36 | TEH | TEC | | | | | 6 | COLD | 600UL |
| | | 0.30 | 84 | P 2 | TWD 17 | 08H | +0.93 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 81 | 51 | 0.19 | 155 | P 3 | TWD 10 | DBH | +1.52 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 127 | 51 | 0.34 | 34 | P 3 | TWD 16 | DBH | -1.52 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 82 | 52 | 0.12 | 10 | P 3 | TWD 6 | DBC | +1.68 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 102 | 52 | 0.14 | 62 | P 3 | TWD 8 | DBC | +1.04 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 37 | 53 | 0.45 | 144 | P 2 | TWD 23 | VSM | +0.00 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 63 | 53 | 0.46 | 106 | P 2 | TWD 20 | 08H | +0.38 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 65 | 53 | 0.31 | 101 | P 2 | TWD 18 | 08H | -0.64 | TEH | TEC | | | | | 6 | COLD | 600UL |
| | | 0.31 | 67 | P 2 | TWD 18 | 08H | -0.20 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 71 | 53 | 0.30 | 19 | P 2 | TWD 14 | 08H | +0.52 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 133 | 53 | 0.61 | 123 | P 3 | TWD 22 | DBH | +1.91 | TEC | TEH | | | | | 57 | HOT | 600UL |
| | | 0.41 | 78 | P 2 | TWD 17 | 07H | +0.02 | TEC | 07H | | | | | 57 | HOT | 600UL |
| 46 | 54 | 0.22 | 83 | P 3 | TWD 11 | DBH | +1.84 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 68 | 54 | 0.37 | 146 | P 2 | TWD 20 | 08H | +0.32 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 76 | 54 | 0.18 | 154 | P 3 | TWD 11 | DBH | +0.98 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 130 | 54 | 0.21 | 28 | P 3 | TWD 11 | DBH | +1.58 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 132 | 54 | 0.25 | 40 | P 3 | TWD 11 | DBH | +1.45 | TEC | TEH | | | | | 57 | HOT | 600UL |
| 33 | 55 | 0.33 | 42 | P 2 | TWD 18 | VSM | -0.85 | TEH | TEC | | | | | 6 | COLD | 600UL |
| | | 0.95 | 95 | P 2 | TWD 34 | VSM | +0.85 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 41 | 55 | 0.30 | 123 | P 2 | TWD 17 | VSM | -0.85 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 67 | 55 | 0.29 | 127 | P 2 | TWD 14 | 08H | +0.63 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 69 | 55 | 0.38 | 151 | P 2 | TWD 20 | 08H | +0.74 | TEH | TEC | | | | | 6 | COLD | 600UL |
| 107 | 55 | 0.42 | 37 | P 2 | TWD 19 | 08C | +0.94 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 38 | 56 | 0.20 | 47 | P 2 | TWD 10 | 06H | +0.50 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 70 | 56 | 0.26 | 125 | P 2 | TWD 13 | 08H | +0.65 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 112 | 56 | 0.33 | 111 | P 2 | TWD 17 | VH2 | -0.86 | TEH | TEC | | | | | 12 | COLD | 600UL |
| | | 0.27 | 143 | P 2 | TWD 13 | VH2 | +0.86 | TEH | TEC | | | | | 12 | COLD | 600UL |
| 126 | 56 | 0.28 | 136 | P 2 | TWD 14 | VH1 | +0.90 | TEH | TEC | | | | | 11 | COLD | 600UL |
| 125 | 57 | 0.69 | 121 | P 2 | TWD 28 | VH1 | -0.86 | TEH | TEC | | | | | 12 | COLD | 600UL |
| | | 0.48 | 118 | P 2 | TWD 22 | VH1 | +0.80 | TEH | TEC | | | | | 12 | COLD | 600UL |
| 135 | 57 | 0.41 | 128 | P 2 | TWD 17 | 10H | +1.21 | TEC | TEH | | | | | 57 | HOT | 600UL |
| 22 | 58 | 0.36 | 106 | P 2 | TWD 17 | 03H | +0.84 | TEH | TEC | | | | | 5 | COLD | 600UL |
| 108 | 58 | 0.42 | 103 | P 2 | TWD 20 | VC3 | +0.87 | TEH | TEC | | | | | 12 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|------|-------|
| 124 | 58 | 0.20 | 34 | P 3 | TWD 11 | DBH | -1.59 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| | | 0.42 | 120 | P 2 | TWD 20 | VH1 | -0.85 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| | | 0.37 | 64 | P 2 | TWD 18 | VH1 | +0.79 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| | | 0.37 | 97 | P 2 | TWD 18 | VH2 | -0.81 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| 134 | 58 | 0.48 | 91 | P 2 | TWD 19 | VC3 | +0.61 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| 136 | 58 | 0.26 | 23 | P 3 | TWD 11 | DBH | -1.38 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| 41 | 59 | 0.53 | 100 | P 2 | TWD 25 | VSM | -0.81 | TEH | TEC | | | | | 6 | | COLD | 600UL |
| | | 0.58 | 101 | P 2 | TWD 27 | VSM | +0.00 | TEH | TEC | | | | | 6 | | COLD | 600UL |
| 65 | 59 | 0.69 | 125 | P 2 | TWD 29 | VSM | -0.85 | TEH | TEC | | | | | 6 | | COLD | 600UL |
| | | 0.27 | 159 | P 2 | TWD 16 | VSM | +0.72 | TEH | TEC | | | | | 6 | | COLD | 600UL |
| 83 | 59 | 0.42 | 32 | P 3 | TWD 20 | DBH | +1.47 | TEH | TEC | | | | | 12 | | COLD | 600UL |
| 137 | 59 | 0.14 | 19 | P 3 | TWD 6 | DBC | +1.76 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| 66 | 60 | 0.50 | 55 | P 2 | TWD 21 | 01H | +1.02 | TEH | TEC | | | | | 5 | | COLD | 600UL |
| | | 0.45 | 134 | P 2 | TWD 20 | VSM | -0.82 | TEH | TEC | | | | | 5 | | COLD | 600UL |
| | | 1.05 | 117 | P 2 | TWD 34 | VSM | +0.75 | TEH | TEC | | | | | 5 | | COLD | 600UL |
| 78 | 60 | 0.51 | 116 | P 1 | SVI | DBH | +2.76 | DBH | DBH | | | | | 175 | | HOT | 560P2 |
| 84 | 60 | 0.21 | 53 | P 3 | TWD 11 | DBH | +1.24 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 132 | 60 | 0.71 | 36 | P 2 | TWD 25 | VH2 | -0.84 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| | | 0.59 | 42 | P 2 | TWD 22 | VH1 | -0.88 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| 27 | 61 | 0.35 | 22 | P 1 | SCI | TSH | -10.06 | TSH | TSH | 0.18 | 18.44 | 147 | | 147 | | HOT | 580PP |
| | | 0.35 | 14 | 2 | SAI | TSH | -1.78 | TSH | TSH | 0.14 | 18.44 | 147 | | 147 | | HOT | 580PP |
| | | 0.36 | 15 | 2 | SAI | TSH | -1.27 | TSH | TSH | 0.17 | 18.44 | 147 | | 147 | | HOT | 580PP |
| 33 | 61 | 0.37 | 139 | P 2 | TWD 17 | VSM | +0.76 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 49 | 61 | 0.22 | 107 | P 2 | TWD 12 | 08C | +1.61 | TEH | TEC | | LOCOK | | | 4 | | COLD | 600UL |
| 77 | 61 | 0.59 | 114 | P 2 | TWD 24 | VH3 | -0.83 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| | | 0.63 | 148 | P 2 | TWD 25 | VSM | +0.73 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 79 | 61 | 0.34 | 0 | P 2 | TWD 16 | VH3 | -0.78 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 81 | 61 | 0.23 | 118 | P 2 | TWD 12 | VH3 | -0.76 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 89 | 61 | 0.42 | 48 | P 2 | TWD 19 | VH2 | -0.68 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 127 | 61 | 0.46 | 107 | P 2 | TWD 21 | 10H | +0.41 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 129 | 61 | 0.24 | 87 | P 2 | TWD 12 | VH1 | -0.66 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 42 | 62 | 0.34 | 71 | P 2 | TWD 16 | VSM | +0.21 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 50 | 62 | 0.43 | 0 | P 2 | TWD 19 | 08H | -1.24 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 78 | 62 | 0.47 | 105 | P 2 | TWD 20 | VC3 | -0.71 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 88 | 62 | 0.52 | 113 | P 2 | TWD 22 | VH2 | -0.74 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 126 | 62 | 0.36 | 58 | P 2 | TWD 18 | VH1 | -0.92 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 130 | 62 | 0.65 | 109 | P 2 | TWD 26 | VH1 | +0.90 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 31 | 63 | 0.39 | 26 | P 1 | SCI | TSH | -9.85 | TSH | TSH | 0.21 | 18.43 | 147 | | 147 | | HOT | 580PP |
| 41 | 63 | 0.52 | 67 | P 2 | TWD 22 | VSM | -0.83 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| | | 0.62 | 66 | P 2 | TWD 25 | VSM | +0.04 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 127 | 63 | 0.33 | 108 | P 2 | TWD 16 | VH1 | +1.05 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| | | 0.22 | 114 | P 2 | TWD 12 | VH1 | -0.72 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 129 | 63 | 0.37 | 121 | P 2 | TWD 18 | 10H | +0.42 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| | | 0.50 | 74 | P 2 | TWD 22 | VH1 | +0.91 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 80 | 64 | 0.22 | 0 | P 3 | TWD 10 | DBH | +1.02 | TEH | TEC | | | | | 3 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|------|-------|
| 82 | 64 | 0.49 | 87 | P 2 | TWD 22 | VH3 | +0.82 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 88 | 64 | 0.41 | 63 | P 2 | TWD 19 | VH2 | -0.70 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 96 | 64 | 0.52 | 35 | P 2 | TWD 22 | VH2 | -0.62 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 140 | 64 | 0.68 | 71 | P 3 | TWD 24 | DBH | -1.91 | TEC | TEH | | | | | 57 | | HOT | 600UL |
| 25 | 65 | 0.32 | 131 | P 2 | TWD 15 | VSM | +0.96 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 31 | 65 | 0.18 | 17 | 2 | SAI | TSH | -4.15 | TSH | TSH | 0.14 | 18.40 | 146 | | 146 | | HOT | 580PP |
| | | 0.38 | 20 | 2 | SAI | TSH | -3.81 | TSH | TSH | 0.14 | 18.40 | 146 | | 146 | | HOT | 580PP |
| | | 0.41 | 19 | 2 | SAI | TSH | -3.71 | TSH | TSH | 0.14 | 18.40 | 146 | | 146 | | HOT | 580PP |
| 43 | 65 | 0.25 | 48 | P 2 | TWD 12 | VSM | +0.19 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 69 | 65 | 0.55 | 111 | P 2 | TWD 23 | VC3 | -0.72 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| | | 0.38 | 72 | P 2 | TWD 18 | VC3 | +0.10 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 71 | 65 | 0.28 | 150 | P 2 | TWD 14 | VH3 | +0.78 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 125 | 65 | 0.29 | 147 | P 2 | TWD 15 | VH1 | +0.58 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 127 | 65 | 0.29 | 144 | P 2 | TWD 15 | VH1 | +0.64 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 133 | 65 | 0.19 | 53 | P 3 | TWD 9 | DBH | +1.89 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| 40 | 66 | 0.19 | 0 | P 3 | TWD 9 | DBC | +1.24 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 44 | 66 | 0.12 | 0 | P 3 | TWD 6 | DBC | +1.15 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 50 | 66 | 0.51 | 47 | P 2 | TWD 22 | 08H | +1.25 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 86 | 66 | 0.43 | 121 | P 2 | TWD 20 | 09H | +0.21 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 88 | 66 | 0.28 | 76 | P 2 | TWD 14 | 09H | +0.89 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 124 | 66 | 0.41 | 149 | P 2 | TWD 19 | VH1 | -0.66 | TEH | TEC | | | | | 10 | | COLD | 600UL |
| 130 | 66 | 0.36 | 133 | P 2 | TWD 17 | VH1 | +0.86 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| | | 0.23 | 70 | P 2 | TWD 12 | 08C | +0.87 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 21 | 67 | 0.50 | 77 | P 2 | TWD 21 | VSM | -1.03 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 25 | 67 | 0.29 | 98 | P 2 | TWD 14 | VSM | -0.94 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 31 | 67 | 0.54 | 15 | 2 | SAI | TSH | -4.53 | TSH | TSH | 0.28 | 18.52 | 146 | | 146 | | HOT | 580PP |
| 91 | 67 | 0.33 | 143 | P 2 | TWD 16 | VH3 | -0.86 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 99 | 67 | 0.19 | 154 | P 3 | TWD 9 | DBH | +1.92 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 111 | 67 | 0.70 | 26 | P 1 | SCI | TSH | -22.67 | TSH | TSH | .23 | 22.75 | 117 | | 117 | | HOT | 580PP |
| 127 | 67 | 0.33 | 124 | P 2 | TWD 16 | VH1 | +0.04 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 141 | 67 | 0.35 | 154 | P 2 | TWD 16 | VH1 | -0.77 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| | | 0.23 | 71 | P 3 | TWD 11 | DBC | -1.77 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| 24 | 68 | 0.34 | 120 | P 3 | TWD 14 | DBH | +1.70 | TEH | TEC | | | | | 41 | | COLD | 600UL |
| 40 | 68 | 0.44 | 25 | P 2 | TWD 18 | VSM | -0.86 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 130 | 68 | 0.53 | 138 | P 2 | TWD 23 | VH1 | +1.03 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| | | 0.18 | 132 | P 3 | TWD 9 | DBH | +0.00 | TEH | TEC | | | | | 39 | | COLD | 600UL |
| 134 | 68 | 0.55 | 144 | P 2 | TWD 22 | 10H | -0.79 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| | | 0.26 | 100 | P 2 | TWD 13 | 10H | +0.79 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| 39 | 69 | 0.47 | 145 | P 2 | TWD 21 | VSM | +0.79 | TEH | TEC | | | | | 4 | | COLD | 600UL |
| 41 | 69 | 0.46 | 99 | P 2 | TWD 20 | VSM | +0.84 | TEH | TEC | | | | | 3 | | COLD | 600UL |
| 144 | 70 | 0.65 | 94 | P 2 | TWD 25 | VC1 | +0.34 | TEC | TEH | | | | | 59 | | HOT | 600UL |
| 33 | 71 | 0.77 | 118 | P 3 | TWD 28 | DBC | +1.55 | TEH | TEC | | | | | 4 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-------|-----|------|---|------|---|-----|---|------|-------|
| 35 | 71 | 0.92 | 108 | P 2 | TWD 31 | | VSM | -0.85 | TEH | TEC | | | | 3 | | COLD | 600UL |
| | | 0.19 | 125 | P 2 | TWD 7 | | VSM | -0.08 | TEH | TEC | | | | 3 | | COLD | 600UL |
| | | 0.26 | 0 | P 3 | TWD 12 | | DBC | +1.51 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 89 | 71 | 0.27 | 136 | P 2 | TWD 14 | | 09H | +0.41 | TEH | TEC | | | | 38 | | COLD | 600UL |
| 97 | 71 | 0.15 | 111 | P 3 | TWD 7 | | DBH | +1.86 | TEH | TEC | | | | 38 | | COLD | 600UL |
| 36 | 72 | 0.36 | 64 | P 3 | TWD 16 | | DBH | -1.10 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 44 | 72 | 0.60 | 145 | P 3 | TWD 24 | | DBC | +1.49 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 46 | 72 | 0.36 | 86 | P 2 | TWD 17 | | VSM | +0.82 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 130 | 72 | 0.54 | 138 | P 2 | TWD 23 | | VH1 | +0.76 | TEH | TEC | | | | 39 | | COLD | 600UL |
| 132 | 72 | 0.49 | 142 | P 2 | TWD 20 | | VH1 | +0.92 | TEC | TEH | | | | 59 | | HOT | 600UL |
| | | 0.54 | 42 | P 2 | TWD 22 | | 10H | +0.88 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 39 | 73 | 0.69 | 52 | P 3 | TWD 27 | | DBH | +1.62 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 47 | 73 | 0.73 | 67 | P 3 | TWD 27 | | DBH | +2.12 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 83 | 73 | 0.23 | 174 | P 3 | TWD 16 | | DBH | +1.74 | TEH | TEC | | | | 8 | | COLD | 600UL |
| 89 | 73 | 0.09 | 134 | P 3 | TWD 4 | | DBH | -0.71 | TEH | TEC | | | | 7 | | COLD | 600UL |
| 145 | 73 | 0.37 | 102 | P 3 | TWD 15 | | DBH | +1.17 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 44 | 74 | 0.31 | 77 | P 3 | TWD 15 | | DBH | -1.36 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 50 | 74 | 0.15 | 0 | P 3 | TWD 7 | | DBH | -1.05 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 80 | 74 | 0.11 | 0 | P 3 | TWD 5 | | DBH | +0.58 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 122 | 74 | 0.33 | 98 | P 2 | TWD 18 | | VH2 | -0.92 | TEH | TEC | | | | 8 | | COLD | 600UL |
| 132 | 74 | 0.31 | 146 | P 2 | TWD 14 | | VH2 | -0.82 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 134 | 74 | 0.63 | 150 | P 2 | TWD 24 | | VH2 | -0.84 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 136 | 74 | 0.45 | 123 | P 2 | TWD 19 | | VH1 | +0.88 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 71 | 75 | 0.26 | 62 | P 2 | TWD 13 | | VH3 | +0.87 | TEH | TEC | | | | 3 | | COLD | 600UL |
| 77 | 75 | 0.42 | 47 | P 2 | TWD 19 | | VH3 | -0.99 | TEH | TEC | | | | 4 | | COLD | 600UL |
| | | 0.25 | 129 | P 3 | TWD 13 | | DBC | +1.90 | TEH | TEC | | | | 4 | | COLD | 600UL |
| 52 | 76 | 0.36 | 156 | P 3 | TWD 17 | | DBC | -1.84 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 56 | 76 | 0.45 | 105 | P 2 | TWD 21 | | VSM | +0.64 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 86 | 76 | 0.24 | 99 | P 2 | TWD 14 | | 07H | +0.20 | TEH | TEC | | | | 26 | | COLD | 600UL |
| 128 | 76 | 0.41 | 143 | P 2 | TWD 18 | | VH1 | +0.72 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 138 | 76 | 0.50 | 146 | P 2 | TWD 20 | | 10H | +0.67 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 144 | 76 | 0.24 | 110 | P 3 | TWD 11 | | DBH | -1.95 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 49 | 77 | 1.22 | 140 | P 3 | TWD 34 | | DBH | -1.88 | TEC | TEH | | | | 25 | | HOT | 600UL |
| | | 0.52 | 112 | P 3 | TWD 22 | | DBH | +1.76 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 135 | 77 | 0.47 | 90 | P 2 | TWD 20 | | VH1 | +0.94 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 50 | 78 | 0.40 | 104 | P 3 | TWD 19 | | DBH | -1.72 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 52 | 78 | 0.40 | 84 | P 3 | TWD 24 | | DBH | +1.38 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 54 | 78 | 0.41 | 66 | P 3 | TWD 19 | | DBH | -1.82 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 62 | 78 | 0.44 | 97 | P 3 | TWD 20 | | DBH | +1.84 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 122 | 78 | 0.39 | 129 | P 2 | TWD 18 | | VH1 | -0.82 | TEH | TEC | | | | 27 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|--------|----------|-------|-----|------|-----|-------|---|-----|---|------|-------|
| 124 | 78 | 0.41 | | 149 | P 2 | TWD 21 | VH1 | -0.97 | TEH | TEC | | | | 26 | | COLD | 600UL |
| 130 | 78 | 0.56 | | 123 | P 2 | TWD 24 | VH1 | +0.83 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 144 | 78 | 0.48 | | 104 | P 3 | TWD 19 | DBH | -2.12 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 57 | 79 | 0.38 | | 59 | P 3 | TWD 24 | DBH | +1.24 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 61 | 79 | 0.32 | | 79 | P 3 | TWD 21 | DBH | +1.99 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 75 | 79 | 0.87 | | 141 | P 2 | TWD 26 | VSM | +0.81 | TEC | TEH | | | | 25 | | HOT | 600UL |
| | | 0.30 | | 148 | P 2 | TWD 12 | VSM | -0.97 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 127 | 79 | 0.66 | | 111 | P 2 | TWD 26 | VH1 | +0.71 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 129 | 79 | 0.34 | | 127 | P 2 | TWD 17 | VH1 | +0.77 | TEH | TEC | | | | 26 | | COLD | 600UL |
| 131 | 79 | 0.32 | | 106 | P 2 | TWD 14 | VH1 | +0.71 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 137 | 79 | 0.40 | | 81 | P 2 | TWD 18 | 09H | -0.82 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 145 | 79 | 0.25 | | 106 | P 3 | TWD 11 | DBH | -1.77 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 52 | 80 | 0.53 | | 111 | P 3 | TWD 23 | DBH | -2.19 | TEC | TEH | | | | 25 | | HOT | 600UL |
| | | 0.30 | | 137 | P 3 | TWD 15 | DBC | -1.60 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 56 | 80 | 0.59 | | 140 | P 3 | TWD 31 | DBH | -1.85 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 70 | 80 | 0.32 | | 55 | P 2 | TWD 12 | VH3 | -0.89 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 86 | 80 | 0.32 | | 44 | P 2 | TWD 16 | 09H | +0.33 | TEH | TEC | | | | 25 | | COLD | 600UL |
| 120 | 80 | 0.20 | | 41 | P 3 | TWD 10 | DBH | +1.89 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 128 | 80 | 0.90 | | 108 | P 2 | TWD 31 | VH1 | -0.76 | TEH | TEC | | | | 27 | | COLD | 600UL |
| | | 0.51 | | 81 | P 2 | TWD 22 | VH1 | +0.82 | TEH | TEC | | | | 27 | | COLD | 600UL |
| 134 | 80 | 0.30 | | 139 | P 2 | TWD 14 | VH1 | +0.67 | TEC | TEH | | | | 59 | | HOT | 600UL |
| | | 0.53 | | 145 | P 2 | TWD 22 | VH1 | -0.88 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 144 | 80 | 0.24 | | 173 | P 3 | TWD 11 | DBH | +1.79 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 53 | 81 | 0.71 | | 73 | P 3 | TWD 27 | DBC | -1.44 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 59 | 81 | 0.70 | | 62 | P 3 | TWD 34 | DBH | +1.58 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 63 | 81 | 0.49 | | 131 | P 3 | TWD 28 | DBH | +1.42 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 137 | 81 | 0.38 | | 33 | P 2 | TWD 16 | 08H | +0.84 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 56 | 82 | 0.94 | | 113 | P 3 | TWD 31 | DBH | -1.85 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 64 | 82 | 0.42 | | 135 | P 3 | TWD 25 | DBH | -1.50 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 66 | 82 | 0.33 | | 114 | P 2 | TWD 13 | VH3 | +0.91 | TEC | TEH | | | | 25 | | HOT | 600UL |
| | | 0.39 | | 123 | P 3 | TWD 18 | DBH | -1.50 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 108 | 82 | 0.22 | | 142 | P 2 | TWD 9 | 03C | -1.09 | TEH | TEC | | | | 24 | | COLD | 600UL |
| 132 | 82 | 0.61 | | 103 | P 2 | TWD 24 | VH1 | +0.00 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 142 | 82 | 0.61 | | 20 | P 3 | TWD 23 | DBC | +1.90 | TEC | TEH | | | | 59 | | HOT | 600UL |
| 57 | 83 | 0.48 | | 36 | P 3 | TWD 21 | DBH | -1.95 | TEC | TEH | | | | 25 | | HOT | 600UL |
| | | 0.32 | | 166 | P 3 | TWD 16 | DBH | +1.62 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 63 | 83 | 0.94 | | 94 | P 3 | TWD 38 | DBC | +1.52 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 101 | 83 | 0.41 | | 19 | P 1 | SCI | TSH | -0.09 | TSH | TSH | .20 | 20.73 | | 77 | | HOT | 580PP |
| 137 | 83 | 0.57 | | 32 | P 2 | TWD 24 | 09H | +0.93 | TEC | TEH | | | | 31 | | HOT | 600UL |
| 72 | 84 | 0.29 | | 154 | P 2 | TWD 16 | VC3 | -0.04 | TEC | TEH | | | | 26 | | HOT | 600UL |
| | | 0.42 | | 134 | P 2 | TWD 21 | VSM | -0.66 | TEC | TEH | | | | 26 | | HOT | 600UL |
| | | 0.44 | | 122 | P 2 | TWD 22 | VC3 | +0.64 | TEC | TEH | | | | 26 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|------|-------|
| 126 | 84 | 0.29 | 150 | P 2 | TWD 14 | VH1 | +0.92 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 134 | 84 | 0.36 | 138 | P 2 | TWD 17 | VH1 | -0.95 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 144 | 84 | 0.61 | 55 | P 2 | TWD 24 | VH3 | +0.75 | TEC | TEH | | | | | 61 | | HOT | 600UL |
| 55 | 85 | 0.68 | 158 | P 3 | TWD 26 | DBH | +1.68 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 61 | 85 | 1.16 | 93 | P 3 | TWD 34 | DBC | -1.93 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 63 | 85 | 0.33 | 160 | P 3 | TWD 21 | DBH | +1.31 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 127 | 85 | 0.71 | 98 | P 2 | TWD 27 | VH1 | -0.85 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 139 | 85 | 0.27 | 70 | P 2 | TWD 14 | VH3 | +0.94 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 58 | 86 | 0.87 | 126 | P 3 | TWD 30 | DBH | -2.03 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 70 | 86 | 0.29 | 128 | P 3 | TWD 15 | DBC | +1.56 | TEC | TEH | | | | | 25 | | HOT | 600UL |
| 122 | 86 | 0.15 | 148 | P 3 | TWD 7 | DBH | +0.48 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 126 | 86 | 0.34 | 102 | P 2 | TWD 16 | VH1 | -1.00 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| | | 0.32 | 66 | P 2 | TWD 15 | VH1 | +0.97 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 132 | 86 | 0.75 | 40 | P 2 | TWD 29 | VH2 | -0.82 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| | | 0.34 | 77 | P 2 | TWD 17 | VH1 | -0.83 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| 134 | 86 | 0.25 | 63 | P 2 | TWD 13 | 10H | +0.24 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 55 | 87 | 0.38 | 14 | P 3 | TWD 23 | DBH | +1.65 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 57 | 87 | 0.43 | 63 | P 3 | TWD 13 | DBC | -1.75 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 65 | 87 | 0.59 | 155 | P 3 | TWD 17 | DBH | +1.71 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 67 | 87 | 0.19 | 69 | P 3 | TWD 14 | DBC | -1.91 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| | | 0.24 | 169 | P 3 | TWD 17 | DBH | +1.60 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 93 | 87 | 0.31 | 28 | P 2 | TWD 15 | 07H | +0.88 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| | | 0.40 | 145 | P 2 | TWD 18 | 08H | +0.77 | TEH | TEC | | | | | 23 | | COLD | 600UL |
| 143 | 87 | 0.28 | 96 | P 2 | TWD 14 | VH2 | -0.79 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| 60 | 88 | 0.82 | 73 | P 3 | TWD 21 | DBH | -1.28 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 62 | 88 | 0.74 | 121 | P 3 | TWD 34 | DBH | -1.97 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 68 | 88 | 0.39 | 112 | P 3 | TWD 11 | DBH | -1.51 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 132 | 88 | 0.42 | 126 | P 2 | TWD 20 | VH2 | -0.85 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| | | 0.47 | 57 | P 2 | TWD 22 | VH1 | +0.86 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| | | 0.44 | 63 | P 2 | TWD 21 | VH1 | -0.81 | TEC | TEH | | | | | 35 | | HOT | 600UL |
| 146 | 88 | 0.27 | 89 | P 2 | TWD 18 | VH2 | -1.10 | TEC | TEH | | | | | 34 | | HOT | 600UL |
| 55 | 89 | 0.57 | 125 | P 3 | TWD 30 | DBH | -1.99 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 57 | 89 | 0.20 | 149 | P 3 | TWD 6 | DBH | -2.24 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 97 | 89 | 0.27 | 154 | P 3 | TWD 12 | DBH | +0.00 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 135 | 89 | 0.39 | 68 | P 2 | TWD 18 | VH3 | -0.93 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 139 | 89 | 0.27 | 104 | P 2 | TWD 13 | 09H | +0.89 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| | | 0.11 | 130 | P 2 | TWD 6 | 09H | -0.89 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 58 | 90 | 0.42 | 88 | P 3 | TWD 25 | DBC | +1.56 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| | | 0.16 | 146 | P 3 | TWD 11 | DBH | -1.61 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 100 | 90 | 0.24 | 55 | P 3 | TWD 11 | DBH | -1.75 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 114 | 90 | 0.34 | 79 | P 3 | TWD 14 | DBH | +1.75 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 136 | 90 | 0.25 | 58 | P 2 | TWD 20 | VH1 | +0.70 | TEC | TEH | | | | | 28 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|------|-------|
| 146 | 90 | 0.30 | 110 | P 2 | TWD 15 | VH3 | -0.85 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| | | 0.33 | 66 | P 3 | TWD 13 | DBC | +2.01 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 53 | 91 | 0.44 | 152 | P 3 | TWD 13 | DBH | -2.02 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| | | 0.49 | 165 | P 3 | TWD 14 | DBH | +1.94 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 61 | 91 | 0.23 | 91 | P 2 | TWD 19 | 03H | +0.06 | TEC | TEH | LAR | | | | 22 | | HOT | 600UL |
| 65 | 91 | 0.57 | 21 | P 3 | TWD 30 | DBH | +1.99 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 137 | 91 | 0.31 | 134 | P 2 | TWD 24 | VH1 | +0.80 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| | | 0.39 | 96 | P 2 | TWD 28 | 09H | +0.80 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 145 | 91 | 0.50 | 144 | P 3 | TWD 26 | DBH | -1.36 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 60 | 92 | 0.69 | 139 | P 3 | TWD 19 | DBH | -1.57 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 68 | 92 | 0.34 | 138 | P 3 | TWD 10 | DBH | -1.80 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 70 | 92 | 0.15 | 40 | P 3 | TWD 11 | DBH | -1.75 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 100 | 92 | 0.45 | 52 | P 2 | TWD 18 | 02H | -1.24 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 118 | 92 | 0.23 | 73 | P 2 | TWD 12 | VH1 | +0.85 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 120 | 92 | 0.42 | 56 | P 2 | TWD 18 | VH1 | +0.81 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 130 | 92 | 0.73 | 89 | P 2 | TWD 27 | VH1 | -0.81 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 146 | 92 | 0.52 | 55 | P 3 | TWD 19 | DBH | +1.82 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 51 | 93 | 0.60 | 19 | P 3 | TWD 31 | DBH | +1.75 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 53 | 93 | 0.48 | 138 | P 3 | TWD 14 | DBH | -1.70 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 55 | 93 | 0.19 | 103 | P 3 | TWD 13 | DBH | +1.72 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 63 | 93 | 0.21 | 103 | P 2 | TWD 18 | 08H | -1.09 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 133 | 93 | 0.13 | 127 | P 2 | TWD 11 | VH1 | -0.94 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 52 | 94 | 0.30 | 64 | P 3 | TWD 9 | DBC | -1.16 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| | | 0.42 | 25 | P 3 | TWD 13 | DBH | +1.80 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 60 | 94 | 0.16 | 76 | P 3 | TWD 4 | DBH | -2.02 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| | | 0.22 | 7 | P 3 | TWD 6 | DBH | +1.47 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 78 | 94 | 0.35 | 75 | P 3 | TWD 22 | DBH | +1.81 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 82 | 94 | 0.35 | 142 | P 2 | TWD 17 | VH3 | -0.04 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 130 | 94 | 0.47 | 126 | P 2 | TWD 21 | VH2 | -0.95 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| | | 0.65 | 115 | P 2 | TWD 23 | VH1 | +0.70 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 136 | 94 | 0.40 | 106 | P 2 | TWD 18 | VH1 | -0.95 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 144 | 94 | 0.24 | 71 | P 3 | TWD 10 | DBH | +1.77 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 146 | 94 | 0.46 | 26 | P 3 | TWD 29 | DBC | +1.48 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 53 | 95 | 0.37 | 115 | P 3 | TWD 23 | DBC | -1.70 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| | | 0.25 | 49 | P 3 | TWD 17 | DBH | +2.00 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 55 | 95 | 0.32 | 99 | P 3 | TWD 12 | DBH | -1.86 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 61 | 95 | 0.68 | 22 | P 3 | TWD 33 | DBC | +2.06 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 75 | 95 | 0.71 | 66 | P 2 | TWD 23 | VC3 | -0.90 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 133 | 95 | 0.31 | 118 | P 2 | TWD 15 | VH1 | +0.91 | TEC | TEH | | | | | 31 | | HOT | 600UL |
| 135 | 95 | 0.16 | 62 | P 2 | TWD 15 | VH1 | -1.02 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 139 | 95 | 0.16 | 56 | P 2 | TWD 14 | VH1 | -1.03 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 143 | 95 | 0.19 | 25 | P 3 | TWD 13 | DBH | -1.60 | TEC | TEH | | | | | 28 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|------|-------|
| 56 | 96 | 0.91 | 141 | P 3 | TWD 23 | DBC | +1.87 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| | | 0.22 | 72 | P 3 | TWD 7 | DBH | -1.85 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 64 | 96 | 0.39 | 72 | P 3 | TWD 12 | DBC | +1.83 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 49 | 97 | 0.23 | 62 | P 3 | TWD 16 | DBH | +1.75 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 53 | 97 | 0.30 | 42 | P 3 | TWD 19 | DBH | -1.76 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 59 | 97 | 0.16 | 145 | P 3 | TWD 5 | DBC | -1.46 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 65 | 97 | 0.24 | 96 | P 3 | TWD 7 | DBC | -1.85 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 105 | 97 | 0.18 | 89 | P 3 | TWD 8 | DBH | -1.80 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 141 | 97 | 0.14 | 64 | P 3 | TWD 10 | DBC | -1.75 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 145 | 97 | 0.16 | 119 | P 3 | TWD 13 | DBC | -1.42 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 50 | 98 | 0.23 | 57 | P 3 | TWD 16 | DBC | -1.74 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| | | 0.38 | 76 | P 3 | TWD 23 | DBH | -1.95 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 124 | 98 | 0.26 | 102 | P 2 | TWD 13 | VH1 | +0.95 | TEH | TEC | | | | | 21 | | COLD | 600UL |
| 51 | 99 | 0.40 | 158 | P 3 | TWD 24 | DBH | -1.97 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 55 | 99 | 0.26 | 42 | P 3 | TWD 18 | DBH | -1.79 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 61 | 99 | 0.34 | 140 | P 2 | TWD 14 | VSM | +0.79 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 97 | 99 | 0.16 | 144 | P 3 | TWD 8 | DBH | +0.00 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 139 | 99 | 0.27 | 131 | P 2 | TWD 13 | VH2 | -0.98 | TEC | TEH | | | | | 61 | | HOT | 600UL |
| 141 | 99 | 0.23 | 106 | P 2 | TWD 18 | VH1 | +0.90 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| | | 0.10 | 13 | P 3 | TWD 7 | DBH | +1.85 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 44 | 100 | 0.47 | 101 | P 3 | TWD 14 | DBH | -1.75 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 52 | 100 | 0.47 | 174 | P 3 | TWD 14 | DBC | -1.85 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 100 | 100 | 0.16 | 33 | P 3 | TWD 8 | DBH | +1.44 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 102 | 100 | 0.21 | 59 | P 3 | TWD 10 | DBH | -1.80 | TEH | TEC | | | | | 38 | | COLD | 600UL |
| 132 | 100 | 0.74 | 65 | P 2 | TWD 27 | VH1 | -1.19 | TEC | TEH | | | | | 61 | | HOT | 600UL |
| 39 | 101 | 0.35 | 57 | P 3 | TWD 13 | DBH | -1.75 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 47 | 101 | 0.36 | 20 | P 3 | TWD 22 | DBC | +1.89 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 49 | 101 | 0.37 | 61 | P 3 | TWD 14 | DBH | -1.70 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 51 | 101 | 0.46 | 159 | P 3 | TWD 26 | DBH | -2.20 | TEC | TEH | | | | | 22 | | HOT | 600UL |
| 53 | 101 | 0.38 | 114 | P 3 | TWD 14 | DBH | -1.65 | TEC | TEH | | | | | 21 | | HOT | 600UL |
| 83 | 101 | 0.29 | 98 | P 2 | TWD 13 | VSM | +1.36 | TEH | TEC | | LOCOK | | | 22 | | COLD | 600UL |
| 127 | 101 | 0.48 | 137 | P 2 | TWD 19 | VH1 | -0.75 | TEH | TEC | | | | | 22 | | COLD | 600UL |
| 131 | 101 | 0.32 | 94 | P 2 | TWD 15 | VH1 | -0.96 | TEC | TEH | | | | | 61 | | HOT | 600UL |
| 133 | 101 | 0.15 | 151 | P 2 | TWD 15 | VH1 | +0.66 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 145 | 101 | 0.36 | 36 | P 3 | TWD 25 | DBC | +1.53 | TEC | TEH | | | | | 28 | | HOT | 600UL |
| 54 | 102 | 0.36 | 138 | P 3 | TWD 18 | DBC | +1.82 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| | | 0.34 | 148 | P 3 | TWD 17 | DBC | -1.90 | TEH | TEC | | | | | 31 | | COLD | 600UL |
| 144 | 102 | 0.49 | 130 | P 2 | TWD 22 | VH2 | -0.91 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| | | 0.30 | 92 | P 2 | TWD 15 | 09H | -1.13 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 41 | 103 | 0.48 | 75 | P 3 | TWD 21 | DBC | +1.82 | TEH | TEC | | | | | 30 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|-------|---|-------|------|-------|
| 47 | 103 | 0.09 | 19 | P 3 | TWD 5 | DBH | +1.96 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.30 | 32 | P 3 | TWD 15 | DBH | -1.56 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.47 | 31 | P 3 | TWD 21 | DBC | +1.69 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 55 | 103 | 0.50 | 81 | P 2 | TWD 21 | VC3 | +1.20 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 83 | 103 | 0.59 | 102 | P 2 | TWD 24 | 09H | +1.81 | TEH | TEC | | LOCOK | | | 19 | COLD | 600UL |
| 87 | 103 | 0.37 | 76 | P 2 | TWD 18 | 08H | +0.73 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.44 | 134 | P 2 | TWD 20 | 09H | +0.73 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 133 | 103 | 0.20 | 103 | P 2 | TWD 10 | VH1 | -0.94 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.28 | 112 | P 2 | TWD 14 | 08H | +0.88 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 36 | 104 | 0.12 | 37 | P 3 | TWD 7 | DBH | +1.51 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.20 | 57 | P 3 | TWD 11 | DBC | +1.22 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 46 | 104 | 0.67 | 88 | P 2 | TWD 25 | VSM | -0.90 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 74 | 104 | 0.14 | 13 | P 3 | TWD 8 | DBC | +0.58 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 88 | 104 | 0.27 | 75 | P 2 | TWD 13 | 08H | -0.24 | TEH | TEC | | | | | 20 | COLD | 600UL |
| | | 0.12 | 151 | P 2 | TWD 7 | 08H | -0.83 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 110 | 104 | 0.45 | 101 | P 2 | TWD 19 | VH2 | -0.85 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 114 | 104 | 0.56 | 82 | P 2 | TWD 24 | VH2 | -0.85 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 138 | 104 | 0.43 | 138 | P 2 | TWD 20 | VH1 | -0.88 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.13 | 72 | P 2 | TWD 8 | VH1 | -0.19 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 129 | 105 | 0.55 | 96 | P 2 | TWD 23 | VH1 | +0.80 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 114 | 106 | 0.31 | 29 | P 3 | TWD 15 | DBH | +2.00 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 144 | 106 | 0.56 | 135 | P 3 | TWD 30 | DBH | -1.98 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.23 | 31 | P 3 | TWD 16 | DBC | -1.60 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 29 | 107 | 0.29 | 114 | P 3 | TWD 15 | DBC | -1.81 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 31 | 107 | 0.48 | 49 | P 3 | TWD 21 | DBH | -1.78 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.42 | 23 | P 2 | SAI | TSH | -6.37 | TSH | TSH | 0.10 | | 18.21 | | 92 | HOT | 580PP |
| 37 | 107 | 0.86 | 105 | P 2 | TWD 29 | VSM | -0.80 | TEH | TEC | | | | | 31 | COLD | 600UL |
| | | 1.22 | 119 | P 2 | TWD 35 | VSM | +0.72 | TEH | TEC | | | | | 31 | COLD | 600UL |
| | | 0.44 | 83 | P 2 | TWD 19 | VSM | -0.16 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 41 | 107 | 0.34 | 26 | P 2 | TWD 15 | VSM | -0.84 | TEH | TEC | | | | | 31 | COLD | 600UL |
| | | 0.30 | 114 | P 2 | TWD 14 | VSM | +0.94 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 43 | 107 | 0.21 | 67 | P 2 | TWD 12 | VSM | +0.25 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.31 | 138 | P 2 | TWD 16 | VSM | +0.81 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.26 | 130 | P 3 | TWD 13 | DBC | +1.59 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 83 | 107 | 0.24 | 123 | P 2 | TWD 13 | 09H | -1.15 | TEH | TEC | | LOCOK | | | 19 | COLD | 600UL |
| 121 | 107 | 0.34 | 142 | P 3 | TWD 17 | DBH | +2.24 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 133 | 107 | 0.13 | 132 | P 2 | TWD 8 | 09H | -0.82 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.24 | 159 | P 2 | TWD 12 | 09H | +0.78 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 126 | 108 | 0.51 | 74 | P 2 | TWD 22 | 10H | +0.18 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 134 | 108 | 0.20 | 98 | P 2 | TWD 11 | 10H | +0.88 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 138 | 108 | 0.29 | 143 | P 2 | TWD 14 | VH2 | -1.01 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 14 | 110 | 0.15 | 37 | P 3 | TWD 8 | DBH | -1.27 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 40 | 110 | 0.82 | 126 | P 2 | TWD 30 | VSM | -0.76 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.39 | 53 | P 2 | TWD 18 | VSM | -0.21 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.26 | 17 | P 3 | TWD 13 | DBC | +1.44 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 74 | 110 | 0.45 | 47 | P 2 | TWD 19 | 03H | -0.16 | TEH | TEC | | | | | 31 | COLD | 600UL |
| 128 | 110 | 0.25 | 103 | P 2 | TWD 12 | 10H | -0.94 | TEH | TEC | | | | | 20 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-------|------|-------|
| | | 0.36 | 130 | P 2 | TWD 17 | 10H | +0.96 | TEH | TEC | | | | | 20 | COLD | 600UL |
| | | 0.24 | 155 | P 2 | TWD 12 | 08H | -0.81 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 132 | 110 | 0.31 | 55 | P 2 | TWD 12 | 08H | +0.93 | TEC | TEH | | | | | 25 | HOT | 600UL |
| | | 0.36 | 112 | P 2 | TWD 14 | 07H | +0.49 | TEC | TEH | | | | | 25 | HOT | 600UL |
| 134 | 110 | 0.37 | 129 | P 2 | TWD 18 | VH2 | -0.86 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 47 | 111 | 0.37 | 59 | P 2 | TWD 18 | VSM | +0.33 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.97 | 103 | P 2 | TWD 33 | VSM | +0.91 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 127 | 111 | 0.43 | 60 | P 2 | TWD 19 | 09H | -0.25 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.40 | 72 | P 2 | TWD 19 | 10H | +0.35 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 129 | 111 | 0.44 | 126 | P 2 | TWD 20 | 09H | -0.86 | TEH | TEC | | | | | 20 | COLD | 600UL |
| | | 0.32 | 118 | P 2 | TWD 15 | 09H | +0.46 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 44 | 112 | 0.29 | 110 | P 2 | TWD 15 | VSM | -0.82 | TEH | TEC | | | | | 30 | COLD | 600UL |
| | | 0.16 | 101 | P 2 | TWD 9 | VSM | +0.19 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 80 | 112 | 0.24 | 18 | P 3 | TWD 13 | DBH | +1.75 | TEH | TEC | | | | | 30 | COLD | 600UL |
| 106 | 112 | 0.19 | 146 | P 2 | TWD 11 | VH2 | -0.98 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.28 | 126 | P 2 | TWD 14 | VH2 | +0.90 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 120 | 112 | 0.45 | 122 | P 2 | TWD 20 | 10H | +1.30 | TEH | TEC | | LOCOK | | | 20 | COLD | 600UL |
| | | 0.30 | 115 | P 3 | TWD 16 | DBH | +0.14 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 122 | 112 | 0.43 | 62 | P 2 | TWD 19 | 10H | +0.77 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 140 | 112 | 0.39 | 114 | P 2 | TWD 19 | VH1 | -0.91 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.42 | 24 | P 2 | TWD 20 | 04H | +0.93 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.36 | 65 | P 3 | TWD 23 | DBC | -1.75 | TEC | TEH | | | | | 26 | HOT | 600UL |
| | | 0.34 | 29 | P 3 | TWD 22 | DBC | +1.61 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 35 | 113 | 0.21 | 22 | P 2 | TWD 11 | VSM | -0.21 | TEH | TEC | | | | | 32 | COLD | 600UL |
| | | 0.46 | 86 | P 2 | TWD 22 | VSM | -0.89 | TEH | TEC | | | | | 32 | COLD | 600UL |
| 41 | 113 | 0.55 | 114 | P 2 | TWD 20 | VSM | -0.86 | TEH | TEC | | | | | 33 | COLD | 600UL |
| | | 0.19 | 130 | P 2 | TWD 7 | VSM | -0.12 | TEH | TEC | | | | | 33 | COLD | 600UL |
| 111 | 113 | 0.36 | 132 | P 2 | TWD 17 | VH2 | -0.88 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.38 | 120 | P 2 | TWD 18 | VH2 | +0.79 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 121 | 113 | 0.36 | 102 | P 2 | TWD 17 | VH1 | -0.78 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 127 | 113 | 0.30 | 79 | P 2 | TWD 15 | 08H | +0.87 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.29 | 65 | P 2 | TWD 15 | 09H | -0.81 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 44 | 114 | 0.40 | 98 | P 2 | TWD 20 | VSM | -0.88 | TEH | TEC | | | | | 32 | COLD | 600UL |
| | | 0.48 | 92 | P 2 | TWD 23 | VSM | +0.87 | TEH | TEC | | | | | 32 | COLD | 600UL |
| 50 | 114 | 1.08 | 93 | P 2 | TWD 31 | VSM | -0.76 | TEH | TEC | | | | | 33 | COLD | 600UL |
| | | 0.88 | 100 | P 2 | TWD 27 | VSM | +0.92 | TEH | TEC | | | | | 33 | COLD | 600UL |
| 114 | 114 | 0.55 | 53 | P 2 | TWD 23 | VH2 | -0.88 | TEH | TEC | | | | | 19 | COLD | 600UL |
| | | 0.27 | 113 | P 2 | TWD 14 | VH2 | +0.94 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 124 | 114 | 0.19 | 117 | P 2 | TWD 10 | 05H | +0.82 | TEH | TEC | | | | | 20 | COLD | 600UL |
| 126 | 114 | 0.35 | 112 | P 2 | TWD 17 | 08H | +0.92 | TEH | TEC | | | | | 19 | COLD | 600UL |
| 136 | 114 | 0.28 | 26 | P 3 | TWD 19 | DBC | +1.16 | TEC | TEH | | | | | 26 | HOT | 600UL |
| 25 | 115 | 0.59 | 112 | P 2 | TWD 26 | VSM | +0.92 | TEH | TEC | | | | | 32 | COLD | 600UL |
| 27 | 115 | 0.51 | 24 | 2 | SAI | TSH | -1.70 | TSH | TSH | 0.18 | 17.83 | | | 92 | HOT | 580PP |
| 83 | 115 | 0.48 | 120 | P 2 | TWD 24 | VSM | +1.25 | TEH | TEC | | | | | 17 | COLD | 600UL |
| | | 0.65 | 116 | P 2 | TWD 29 | 09H | +2.15 | TEH | TEC | | LOCOK | | | 17 | COLD | 600UL |
| 123 | 115 | 0.29 | 67 | P 2 | TWD 16 | 09H | +0.42 | TEH | TEC | | | | | 17 | COLD | 600UL |
| 127 | 115 | 0.27 | 43 | P 2 | TWD 15 | 08H | -0.48 | TEH | TEC | | | | | 17 | COLD | 600UL |
| | | 0.29 | 119 | P 2 | TWD 17 | 08H | +0.77 | TEH | TEC | | | | | 17 | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|--------|-----|------|------|-------|---|-----|---|------|-------|
| 137 | 115 | 0.26 | 65 | P 2 | TWD 14 | | VH2 | -0.99 | TEC | TEH | | | | 26 | | HOT | 600UL |
| 78 | 116 | 0.14 | 174 | P 3 | TWD 8 | | DBH | +1.70 | TEH | TEC | | | | 33 | | COLD | 600UL |
| 84 | 116 | 0.25 | 68 | P 2 | TWD 15 | | 09H | +1.04 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 88 | 116 | 0.45 | 124 | P 2 | TWD 23 | | VH2 | -0.67 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 124 | 116 | 0.47 | 101 | P 2 | TWD 19 | | 08H | +0.85 | TEH | TEC | | | | 18 | | COLD | 600UL |
| | | 0.32 | 80 | P 2 | TWD 15 | | 09H | +0.11 | TEH | TEC | | | | 18 | | COLD | 600UL |
| | | 0.18 | 42 | P 2 | TWD 9 | | 10H | -1.23 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 128 | 116 | 0.34 | 101 | P 2 | TWD 15 | | VH1 | +0.74 | TEH | TEC | | | | 18 | | COLD | 600UL |
| | | 0.28 | 55 | P 2 | TWD 13 | | 09C | +0.95 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 39 | 117 | 0.42 | 135 | P 2 | TWD 18 | | VSM | -0.76 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 105 | 117 | 0.25 | 73 | P 3 | TWD 12 | | DBH | +1.42 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 123 | 117 | 0.52 | 139 | P 2 | TWD 25 | | 09H | -0.62 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 125 | 117 | 0.46 | 133 | P 2 | TWD 19 | | 08H | +0.76 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 135 | 117 | 0.46 | 160 | P 3 | TWD 21 | | DBC | +0.46 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 32 | 118 | 0.36 | 101 | P 2 | TWD 17 | | VSM | -0.86 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 46 | 118 | 0.20 | 155 | P 2 | TWD 10 | | VSM | -0.86 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 74 | 118 | 0.34 | 97 | P 2 | TWD 15 | | VSM | -0.77 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 102 | 118 | 0.51 | 20 | 2 | SAI | | TSH | -16.92 | TSH | TSH | 0.17 | 18.08 | | 144 | | HOT | 580PP |
| 43 | 119 | 0.25 | 111 | P 2 | TWD 13 | | VSM | -0.84 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 45 | 119 | 0.42 | 89 | P 2 | TWD 18 | | VSM | -0.86 | TEH | TEC | | | | 31 | | COLD | 600UL |
| | | 0.31 | 64 | P 2 | TWD 15 | | VSM | +0.72 | TEH | TEC | | | | 31 | | COLD | 600UL |
| 47 | 119 | 0.32 | 32 | P 2 | TWD 16 | | VSM | -0.76 | TEH | TEC | | | | 30 | | COLD | 600UL |
| 123 | 119 | 0.24 | 126 | P 2 | TWD 14 | | 09H | -0.13 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.46 | 114 | P 2 | TWD 23 | | 09H | +0.49 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 48 | 120 | 0.25 | 54 | P 2 | TWD 12 | | VSM | -0.84 | TEH | TEC | | | | 28 | | COLD | 600UL |
| | | 0.34 | 69 | P 2 | TWD 16 | | VSM | +0.77 | TEH | TEC | | | | 28 | | COLD | 600UL |
| 122 | 120 | 0.24 | 103 | P 2 | TWD 14 | | 08H | +0.45 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.31 | 134 | P 2 | TWD 17 | | 08H | -0.84 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 47 | 121 | 0.44 | 54 | P 2 | TWD 20 | | 02H | +0.81 | TEH | TEC | | | | 28 | | COLD | 600UL |
| 99 | 121 | 0.36 | 108 | P 2 | TWD 20 | | VH2 | -0.98 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 107 | 121 | 0.43 | 20 | P 2 | TWD 22 | | VH2 | -1.04 | TEH | TEC | | | | 17 | | COLD | 600UL |
| | | 0.67 | 154 | P 2 | TWD 29 | | VH2 | +0.92 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 121 | 121 | 0.46 | 116 | P 2 | TWD 19 | | 09H | +0.43 | TEH | TEC | | | | 18 | | COLD | 600UL |
| | | 0.47 | 106 | P 2 | TWD 20 | | 10H | -0.19 | TEH | TEC | | | | 18 | | COLD | 600UL |
| 30 | 122 | 0.29 | 96 | P 2 | TWD 17 | | 05H | +0.49 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 60 | 122 | 0.21 | 120 | P 1 | SCI | | TSH | -0.03 | TSH | TSH | 0.39 | 18.32 | | 87 | | HOT | 580PP |
| 122 | 122 | 0.47 | 119 | P 2 | TWD 24 | | 10C | +0.85 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 126 | 122 | 0.34 | 98 | P 2 | TWD 19 | | VH2 | -1.02 | TEH | TEC | | | | 17 | | COLD | 600UL |
| 132 | 122 | 0.58 | 33 | P 2 | TWD 20 | | VH2 | -0.83 | TEC | TEH | | | | 25 | | HOT | 600UL |
| 41 | 123 | 0.54 | 96 | P 2 | TWD 26 | | VSM | +0.90 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 49 | 123 | 0.48 | 151 | P 2 | TWD 24 | | 08H | +1.56 | TEH | TEC | | LOCOK | | 29 | | COLD | 600UL |
| 57 | 123 | 0.74 | 77 | P 2 | TWD 31 | | VH3 | -0.86 | TEH | TEC | | | | 29 | | COLD | 600UL |
| 107 | 123 | 0.12 | 95 | P 3 | TWD 7 | | DBH | -0.42 | TEH | TEC | | | | 17 | | COLD | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|-------|---|-----|---|------|-------|
| 117 | 123 | 0.68 | 137 | P 2 | TWD 25 | 08H | +0.90 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.51 | 101 | P 2 | TWD 21 | 06H | +0.87 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 119 | 123 | 0.48 | 66 | P 2 | TWD 24 | 09H | +0.76 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 125 | 123 | 0.36 | 65 | P 2 | TWD 16 | 05C | +0.75 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 102 | 124 | 0.42 | 114 | P 2 | TWD 22 | VH2 | -0.73 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 110 | 124 | 0.69 | 91 | P 2 | TWD 30 | VC2 | -0.95 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.51 | 118 | P 2 | TWD 25 | VC2 | +0.93 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 112 | 124 | 0.74 | 110 | P 2 | TWD 26 | VH2 | -0.98 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 116 | 124 | 0.32 | 80 | P 2 | TWD 15 | 09H | +0.76 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.27 | 128 | P 2 | TWD 13 | 08H | +0.38 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.42 | 116 | P 2 | TWD 18 | 08H | +0.83 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 79 | 125 | 0.30 | 137 | P 2 | TWD 15 | VH3 | +0.89 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| | | 0.94 | 123 | P 2 | TWD 33 | VSM | +0.89 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| 107 | 125 | 0.34 | 70 | P 2 | TWD 19 | VH2 | +0.84 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 117 | 125 | 0.36 | 78 | P 2 | TWD 16 | 09H | +0.56 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.21 | 39 | P 2 | TWD 10 | 09H | -0.92 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 119 | 125 | 0.34 | 126 | P 2 | TWD 19 | 09H | -0.98 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.23 | 51 | P 2 | TWD 14 | 09H | +0.17 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 133 | 125 | 0.33 | 134 | P 3 | TWD 22 | DBH | +0.65 | TEC | TEH | | | | | 26 | | HOT | 600UL |
| 116 | 126 | 0.28 | 74 | P 2 | TWD 13 | 08H | +0.93 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 124 | 126 | 0.49 | 92 | P 2 | TWD 24 | VH2 | -0.98 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 69 | 127 | 0.26 | 111 | P 2 | TWD 15 | VSM | +0.81 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| | | 0.43 | 142 | P 2 | TWD 22 | VC3 | -0.76 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 109 | 127 | 0.13 | 130 | P 3 | TWD 7 | DBC | -1.62 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 115 | 127 | 0.28 | 125 | P 2 | TWD 16 | 09H | +0.64 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 16 | 128 | 0.15 | 28 | P 3 | TWD 6 | DBH | -0.47 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| 38 | 128 | 0.22 | 148 | P 2 | TWD 13 | VSM | +0.70 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 44 | 128 | 0.39 | 153 | P 2 | TWD 18 | VSM | -0.78 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| | | 0.52 | 117 | P 2 | TWD 23 | VSM | +0.81 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| 116 | 128 | 0.29 | 103 | P 2 | TWD 14 | 09H | -0.80 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.55 | 108 | P 2 | TWD 22 | 09H | +0.60 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| | | 0.45 | 148 | P 2 | TWD 19 | 08H | +0.92 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 49 | 129 | 0.34 | 86 | P 2 | TWD 19 | 08H | -1.55 | TEH | TEC | | | LOCOK | | 29 | | COLD | 600UL |
| 51 | 129 | 0.36 | 65 | P 2 | TWD 18 | 08H | +0.73 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| | | 0.14 | 128 | P 1 | SCI | TSC | +0.06 | TSC | TSC | .24 | | | | 61 | | COLD | 580PP |
| 57 | 129 | 0.27 | 150 | P 3 | TWD 15 | DBH | +0.00 | TEH | TEC | | | | | 29 | | COLD | 600UL |
| 79 | 129 | 0.52 | 146 | P 2 | TWD 23 | VSM | +0.83 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| | | 0.83 | 116 | P 2 | TWD 30 | VH3 | +0.85 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| | | 0.43 | 147 | P 2 | TWD 20 | VSM | -0.93 | TEH | TEC | | | | | 28 | | COLD | 600UL |
| 85 | 129 | 0.38 | 34 | P 2 | TWD 20 | VH2 | +0.85 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 113 | 129 | 0.40 | 44 | P 2 | TWD 21 | 09H | +0.86 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.38 | 122 | P 2 | TWD 20 | VH2 | +0.88 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| | | 0.31 | 76 | P 3 | TWD 17 | DBH | +1.96 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 115 | 129 | 0.38 | 80 | P 2 | TWD 17 | 09H | -0.89 | TEH | TEC | | | | | 18 | | COLD | 600UL |
| 117 | 129 | 0.21 | 96 | P 2 | TWD 12 | 08H | +0.97 | TEH | TEC | | | | | 17 | | COLD | 600UL |
| 52 | 130 | 0.42 | 47 | P 2 | TWD 19 | 01H | +0.87 | TEC | TEH | | | | | 17 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|-----|--------|----------|-------|-----|------|---|------|---|-----|---|-----|-------|
| 100 | 130 | 0.40 | | 124 | P 2 | TWD 19 | VH2 | -0.84 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 114 | 130 | 0.23 | | 95 | P 2 | TWD 16 | 09H | -0.89 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 41 | 131 | 0.39 | | 131 | P 2 | TWD 26 | VSM | -0.76 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.42 | | 123 | P 2 | TWD 27 | VSM | +0.70 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 43 | 131 | 0.44 | | 81 | P 2 | TWD 20 | VSM | +0.85 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 45 | 131 | 0.49 | | 129 | P 2 | TWD 30 | VSM | +0.70 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.26 | | 150 | P 2 | TWD 20 | VSM | -0.89 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 65 | 131 | 0.36 | | 32 | P 2 | TWD 25 | 02H | -1.25 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 111 | 131 | 0.14 | | 89 | P 2 | TWD 10 | 08H | -0.82 | TEC | TEH | | | | 46 | | HOT | 600UL |
| | | 0.17 | | 89 | P 2 | TWD 12 | 08H | +0.78 | TEC | TEH | | | | 46 | | HOT | 600UL |
| | | 0.20 | | 130 | P 2 | TWD 14 | VH2 | -0.82 | TEC | TEH | | | | 46 | | HOT | 600UL |
| 127 | 131 | 0.13 | | 35 | P 3 | TWD 11 | DBH | +1.76 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 68 | 132 | 0.56 | | 82 | P 2 | TWD 24 | VC3 | +0.77 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 76 | 132 | 0.28 | | 113 | P 2 | TWD 15 | VH3 | -0.75 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 112 | 132 | 0.34 | | 137 | P 2 | TWD 21 | 08H | +0.80 | TEC | TEH | | | | 4 | | HOT | 600UL |
| | | 0.43 | | 88 | P 2 | TWD 25 | 07H | +0.89 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 114 | 132 | 0.81 | | 123 | P 2 | TWD 29 | 07H | +0.75 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 45 | 133 | 0.16 | | 92 | P 3 | TWD 7 | DBC | -1.09 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 47 | 133 | 0.55 | | 104 | P 2 | TWD 31 | VSM | -0.78 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.56 | | 129 | P 2 | TWD 32 | VSM | +0.00 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.48 | | 117 | P 2 | TWD 29 | VSM | +0.73 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 71 | 133 | 0.35 | | 145 | P 2 | TWD 24 | VH3 | +0.70 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.40 | | 100 | P 2 | TWD 26 | VH3 | -0.88 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.32 | | 151 | P 2 | TWD 23 | VC3 | -0.64 | TEC | TEH | | | | 18 | | HOT | 600UL |
| | | 0.18 | | 12 | P 2 | TWD 16 | VC3 | -0.16 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 111 | 133 | 0.31 | | 121 | P 2 | TWD 15 | 08H | +0.81 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 44 | 134 | 0.23 | | 52 | P 2 | TWD 13 | VSM | -0.71 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 76 | 134 | 0.20 | | 160 | P 3 | TWD 9 | DBC | -2.09 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 108 | 134 | 0.23 | | 102 | P 2 | TWD 18 | VH2 | -0.86 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 65 | 135 | 0.43 | | 10 | P 3 | TWD 16 | DBC | +1.96 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 111 | 135 | 0.26 | | 63 | P 2 | TWD 14 | VH2 | +0.24 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 56 | 136 | 0.33 | | 114 | P 2 | TWD 16 | VSM | +0.79 | TEC | TEH | | | | 17 | | HOT | 600UL |
| | | 0.42 | | 82 | P 2 | TWD 20 | VSM | -0.79 | TEC | TEH | | | | 17 | | HOT | 600UL |
| 110 | 136 | 0.33 | | 142 | P 2 | TWD 16 | 08H | +0.94 | TEC | TEH | | | | 3 | | HOT | 600UL |
| | | 0.32 | | 42 | P 2 | TWD 16 | 08H | -0.84 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 89 | 137 | 0.43 | | 113 | P 3 | TWD 17 | DBH | +1.43 | TEC | TEH | | | | 3 | | HOT | 600UL |
| | | 0.36 | | 124 | P 2 | TWD 17 | VH2 | +0.91 | TEC | TEH | | | | 3 | | HOT | 600UL |
| | | 0.39 | | 84 | P 2 | TWD 18 | VH2 | -0.96 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 91 | 137 | 0.18 | | 60 | P 3 | TWD 14 | DBH | +1.75 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 109 | 137 | 0.23 | | 123 | P 2 | TWD 12 | 08H | +0.88 | TEC | TEH | | | | 3 | | HOT | 600UL |
| | | 0.57 | | 84 | P 2 | TWD 24 | 08H | -0.83 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 111 | 137 | 0.38 | | 128 | P 2 | TWD 23 | VH2 | +1.05 | TEC | TEH | | | | 4 | | HOT | 600UL |
| 46 | 138 | 0.28 | | 105 | P 2 | TWD 21 | 04C | -0.14 | TEC | TEH | | | | 18 | | HOT | 600UL |
| 108 | 138 | 0.22 | | 122 | P 2 | TWD 12 | 08H | -0.98 | TEC | TEH | | | | 3 | | HOT | 600UL |
| 110 | 138 | 0.20 | | 75 | P 2 | TWD 14 | 08H | +0.00 | TEC | TEH | | | | 4 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.gry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|-------|------|---|-----|---|-----|-------|
| 107 | 139 | 0.32 | 104 | P 2 | TWD 20 | 09H | +0.52 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 109 | 139 | 0.14 | 170 | P 3 | TWD 6 | DBH | +1.61 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 119 | 139 | 0.40 | 120 | P 2 | TWD 24 | 10C | -1.31 | TEC | TEH | | LOCOK | | | 4 | | HOT | 600UL |
| 74 | 140 | 0.17 | 146 | P 2 | TWD 12 | VC3 | +0.77 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 111 | 141 | 0.29 | 80 | P 3 | TWD 12 | DBH | -1.57 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 106 | 142 | 0.89 | 110 | P 2 | TWD 31 | VH2 | -0.88 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 112 | 142 | 0.31 | 0 | P 3 | TWD 21 | DBC | +1.88 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| | | 0.27 | 161 | P 2 | TWD 18 | VC2 | -0.94 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 57 | 143 | 0.52 | 83 | P 2 | TWD 22 | VH3 | +0.73 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 111 | 143 | 0.19 | 130 | P 2 | TWD 14 | VC3 | +0.76 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 36 | 144 | 0.25 | 119 | P 2 | TWD 17 | VSM | -1.00 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 42 | 144 | 0.44 | 85 | P 2 | TWD 19 | VSM | +0.89 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 86 | 144 | 0.42 | 38 | P 2 | TWD 19 | VH2 | +0.83 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 98 | 144 | 0.25 | 79 | P 2 | TWD 12 | 09H | -0.84 | TEC | TEH | | | | | 3 | | HOT | 600UL |
| 37 | 145 | 0.37 | 97 | P 2 | TWD 17 | VSM | +0.98 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 43 | 145 | 0.63 | 106 | P 2 | TWD 31 | VSM | +0.65 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| | | 0.25 | 140 | P 2 | TWD 17 | VSM | -0.93 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 49 | 145 | 0.21 | 15 | P 3 | TWD 14 | DBC | +1.82 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 67 | 145 | 0.44 | 133 | P 2 | TWD 20 | VC3 | +1.16 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 107 | 145 | 0.19 | 96 | P 2 | TWD 14 | 08H | -0.02 | TEC | TEH | | | | | 4 | | HOT | 600UL |
| 30 | 146 | 0.54 | 31 | P 1 | SCI | TSH | -0.14 | TSH | TSH | 0.28 | 17.89 | | | 110 | | HOT | 580PP |
| 36 | 146 | 0.23 | 73 | P 2 | TWD 12 | VSM | +0.82 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 40 | 146 | 0.32 | 43 | P 2 | TWD 15 | VSM | +0.86 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 46 | 146 | 0.41 | 117 | P 2 | TWD 24 | VSM | +0.99 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| | | 0.47 | 126 | P 2 | TWD 26 | VSM | -0.80 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 76 | 146 | 0.40 | 39 | P 2 | TWD 18 | VH3 | +0.73 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| | | 0.45 | 112 | P 2 | TWD 20 | VH3 | -0.75 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 102 | 146 | 0.26 | 134 | P 2 | TWD 11 | VH2 | -0.83 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 106 | 146 | 0.34 | 105 | P 2 | TWD 14 | VH2 | -0.84 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 39 | 147 | 0.33 | 127 | P 2 | TWD 16 | VSM | +0.90 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 75 | 147 | 0.54 | 75 | P 2 | TWD 23 | VC3 | +0.69 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 105 | 147 | 0.56 | 118 | P 2 | TWD 21 | VH2 | -0.83 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 34 | 148 | 0.28 | 158 | P 2 | TWD 18 | VSM | -0.84 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 42 | 148 | 0.19 | 111 | P 2 | TWD 13 | VSM | +0.82 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| | | 0.34 | 148 | P 2 | TWD 21 | VSM | +0.14 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 58 | 148 | 0.35 | 135 | P 2 | TWD 21 | VSM | +0.65 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| | | 0.27 | 97 | P 2 | TWD 18 | VC3 | -1.02 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 90 | 148 | 0.49 | 96 | P 2 | TWD 19 | VH2 | -0.72 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 102 | 148 | 0.45 | 43 | P 2 | TWD 18 | VH2 | +0.69 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 103 | 149 | 0.36 | 125 | P 2 | TWD 23 | 08H | -0.13 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 102 | 150 | 0.15 | 18 | P 3 | TWD 13 | DBC | +1.97 | TEC | TEH | | | | | 6 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icores_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL | # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|-----|-----|------|---|------|---|-----|---|-----|-------|
| 65 | 151 | 0.28 | 23 | P 2 | TWD 14 | VSM | -0.95 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| | | 0.38 | 120 | P 2 | TWD 17 | VSM | +0.99 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| | | 0.17 | 163 | P 2 | TWD 8 | VSM | +0.14 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 99 | 151 | 0.24 | 145 | P 2 | TWD 17 | 08H | -0.91 | TEC | TEH | | | | | 6 | | HOT | 600UL |
| 66 | 152 | 0.31 | 138 | P 2 | TWD 20 | VH3 | -0.65 | TEC | TEH | | | | | 14 | | HOT | 600UL |
| 76 | 152 | 0.24 | 71 | P 2 | TWD 12 | VC3 | -0.59 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 80 | 152 | 0.21 | 52 | P 3 | TWD 9 | DBC | +1.75 | TEC | TEH | | | | | 13 | | HOT | 600UL |
| 81 | 153 | 0.43 | 103 | P 2 | TWD 17 | VH3 | +0.91 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| | | 0.25 | 101 | P 2 | TWD 11 | VH3 | -0.87 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| | | 0.15 | 39 | P 3 | TWD 6 | DBC | +1.78 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 67 | 155 | 0.20 | 135 | P 2 | TWD 15 | VSM | +0.67 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 77 | 155 | 0.69 | 115 | P 2 | TWD 26 | VH3 | +0.76 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| | | 0.44 | 124 | P 2 | TWD 19 | VH3 | -0.99 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 86 | 156 | 0.36 | 37 | P 2 | TWD 16 | VH2 | -0.71 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 37 | 157 | 0.22 | 37 | P 2 | TWD 11 | VSM | +0.73 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 41 | 157 | 0.49 | 120 | P 2 | TWD 21 | VSM | +0.72 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 73 | 157 | 0.21 | 86 | P 2 | TWD 11 | VC3 | +0.91 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 87 | 157 | 0.32 | 137 | P 2 | TWD 15 | 03H | -1.19 | TEC | TEH | | | | | 5 | | HOT | 600UL |
| 44 | 158 | 0.30 | 128 | P 2 | TWD 14 | VSM | +0.92 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| | | 0.16 | 127 | P 2 | TWD 9 | VSM | -0.08 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| | | 0.33 | 84 | P 2 | TWD 16 | VSM | -0.78 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 54 | 158 | 0.18 | 124 | P 2 | TWD 14 | VSM | +0.76 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 68 | 158 | 0.59 | 109 | P 2 | TWD 23 | VH3 | -0.04 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 78 | 158 | 0.31 | 147 | P 2 | TWD 21 | VH3 | -0.85 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 43 | 159 | 0.31 | 22 | P 2 | TWD 21 | 02H | -0.85 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 66 | 160 | 0.30 | 111 | P 2 | TWD 20 | VH3 | +0.81 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 68 | 160 | 0.59 | 131 | P 2 | TWD 24 | VH3 | -0.04 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 78 | 160 | 0.54 | 131 | P 2 | TWD 30 | VH3 | -0.92 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 38 | 162 | 0.21 | 151 | P 2 | TWD 16 | VSM | -0.75 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| | | 0.20 | 99 | P 2 | TWD 15 | VSM | -0.06 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 40 | 162 | 0.21 | 57 | P 2 | TWD 11 | VSM | -0.08 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| | | 0.34 | 79 | P 2 | TWD 16 | VSM | -0.69 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 58 | 162 | 0.18 | 131 | P 2 | TWD 14 | VH3 | -0.79 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 62 | 162 | 0.20 | 68 | P 2 | TWD 15 | VH3 | -0.90 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 76 | 162 | 0.24 | 71 | P 2 | TWD 12 | 08H | +1.00 | TEC | TEH | | | | | 9 | | HOT | 600UL |
| 71 | 163 | 0.13 | 44 | P 2 | TWD 11 | 02C | +0.08 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 46 | 164 | 0.15 | 60 | P 2 | TWD 12 | VSM | -0.17 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| | | 0.24 | 152 | P 2 | TWD 17 | VSM | -0.75 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 60 | 164 | 0.18 | 155 | P 2 | TWD 14 | 08C | +0.77 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 68 | 164 | 0.34 | 128 | P 2 | TWD 22 | VH3 | -0.79 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| | | 0.32 | 100 | P 2 | TWD 22 | 01C | +0.86 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| | | 0.17 | 102 | P 2 | TWD 13 | 01C | -0.08 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 55 | 165 | 0.19 | 133 | P 2 | TWD 14 | VH3 | -0.94 | TEC | TEH | | | | | 10 | | HOT | 600UL |
| 67 | 165 | 0.70 | 102 | P 2 | TWD 26 | 01C | -0.08 | TEC | TEH | | | | | 9 | | HOT | 600UL |

MAI, MCI, MMI, MVI, SAI, SCI, SVI, 0-100% TWD

QUERY: rpc_icode_and_0-100%twd.qry

| ROW | LINE | VOLTS | DEG | CHN | IND | %TW | LOCATION | | EXT | EXT | UTIL | 1 | UTIL | 2 | CAL # | LEG | PROBE |
|-----|------|-------|-----|-----|--------|-----|----------|--|-----|-----|------|---|------|---|-------|-----|-------|
| 20 | 166 | 0.25 | 87 | P 2 | TWD 13 | 02H | +0.88 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| 62 | 166 | 0.20 | 120 | P 2 | TWD 15 | 02H | -0.27 | | TEC | TEH | | | | | 6 | HOT | 600UL |
| | | 0.28 | 107 | P 2 | TWD 19 | 02H | -0.98 | | TEC | TEH | | | | | 6 | HOT | 600UL |
| 64 | 166 | 0.24 | 19 | P 2 | TWD 11 | 07H | +0.67 | | TEC | TEH | | | | | 5 | HOT | 600UL |
| 45 | 167 | 0.19 | 134 | P 2 | TWD 10 | VSM | +0.98 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| 40 | 168 | 0.53 | 50 | P 2 | TWD 23 | VSM | +0.88 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| | | 0.18 | 155 | P 2 | TWD 10 | VSM | -0.74 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| | | 0.23 | 135 | P 2 | TWD 12 | VSM | -0.16 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| 45 | 169 | 0.34 | 53 | P 2 | TWD 17 | 01C | +0.98 | | TEC | TEH | | | | | 46 | HOT | 600UL |
| 22 | 170 | 0.23 | 56 | P 2 | TWD 10 | 01C | +0.88 | | TEC | TEH | | | | | 5 | HOT | 600UL |
| 40 | 170 | 0.31 | 139 | P 2 | TWD 21 | 01C | +0.88 | | TEC | TEH | | | | | 6 | HOT | 600UL |
| 42 | 170 | 0.20 | 83 | P 2 | TWD 8 | 01H | -0.13 | | TEC | TEH | | | | | 5 | HOT | 600UL |
| 46 | 170 | 0.23 | 41 | P 2 | TWD 10 | 05C | +0.84 | | TEC | TEH | | | | | 5 | HOT | 600UL |
| 33 | 171 | 0.38 | 133 | P 2 | TWD 16 | 01C | -0.51 | | TEC | TEH | | | | | 5 | HOT | 600UL |
| 37 | 171 | 0.52 | 110 | P 2 | TWD 20 | VSM | -0.82 | | TEC | TEH | | | | | 5 | HOT | 600UL |

Total Tubes : 606
 Total Records: 789